

Air Conditioning
Technical Data

RZAG-NV1



TABLE OF CONTENTS

RZAG-NV1

| | | |
|----|--|----|
| 1 | Features | 4 |
| 2 | Specifications | 5 |
| | Capacity and Power input | 5 |
| | Capacity and Power input | 6 |
| | Capacity and Power input | 8 |
| | Capacity and Power input | 9 |
| | Capacity and Power input | 11 |
| | Capacity and Power input | 12 |
| | Capacity and Power input | 14 |
| | Capacity and Power input | 15 |
| | Technical Specifications | 17 |
| | Electrical Specifications | 18 |
| 3 | Electrical data | 19 |
| 4 | Options | 24 |
| 5 | Combination table | 25 |
| 6 | Capacity tables | 26 |
| | Cooling/Heating Capacity Tables | 26 |
| | Capacity Correction Factor | 30 |
| 7 | Dimensional drawings | 31 |
| 8 | Centre of gravity | 32 |
| 9 | Piping diagrams | 33 |
| | Piping Diagrams | 33 |
| | Piping Diagram Twin Application | 34 |
| | Piping Diagram Triple Application | 35 |
| | Piping Diagram Double Twin Application | 36 |
| 10 | Wiring diagrams | 37 |
| | Wiring Diagrams - Single Phase | 37 |
| 11 | Sound data | 39 |
| | Sound Power Spectrum | 39 |
| | Sound Pressure Spectrum - Cooling | 41 |
| | Sound Pressure Spectrum - Heating | 43 |
| | Sound Pressure Spectrum Quiet Mode | 45 |
| 12 | Installation | 51 |
| | Installation Method | 51 |
| 13 | Operation range | 54 |
| | Operation Range | 54 |
| | Technical cooling application | 55 |
| 14 | Appropriate Indoors | 56 |

1 Features

Industry leading technology in the most compact casing ever

- Unique, low-height single fan range
- Compact dimensions allow almost unnoticeable installation
- Market-leading serviceability and handling, thanks to wide access area, 7-segment display and additional handle
- Top efficiency: - Energy labels up to A++ in both cooling and heating - compressor offers substantial efficiency improvements
- Choosing for an R-32 product, reduces the environmental impact with 68% compared to R-410A, leads directly to lower energy consumption thanks to its high energy efficiency and has a lower refrigerant charge

- The perfect balance in efficiency and comfort thanks to Variable Refrigerant Temperature: top seasonal efficiency throughout most of the year and quick reaction speed on the hottest days.
- Suits high sensible, infrastructure cooling applications
- Replace existing systems with R-32 technology without needing to replace the piping
- Guarantees operation in both heating and cooling mode down to -20°C
- Refrigerant cooled PCB guarantees reliable cooling, as it is not influenced by ambient temperature.
- Maximum piping length up to 85m
- Outdoor units for pair, twin, triple, double twin application



Infrastructure cooling



Inverter



Auto cooling-heating changeover

2 Specifications

| 2-1 Capacity and Power input | | | FCAHG71H/ RZAG71NV1 | FCAHG100H/ RZAG71NV1 | FCAHG100H/ RZAG100NV1 | FCAHG140H/ RZAG100NV1 | FCAHG125H/ RZAG125NV1 | FCAHG140H/ RZAG140NV1 | |
|------------------------------------|---|-----------------------------------|------------------------|-------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------|
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | |
| Space cooling | Energy efficiency class | | A++ | | | | - | | |
| | Capacity | Pdesign | 6.80 | | 9.50 | | 12.1 | 13.4 | |
| | SEER | | 7.90 | 7.05 | 7.70 | 7.49 | 8.02 | 7.93 | |
| | ηs,c | | - | | | | 318 | 314 | |
| | Annual energy consumption | | kWh/a | 301 | 338 | 432 | 444 | 905 | 1,014 |
| | A Condition (35°C - 27/19) | Pdc | kW | 6.80 | | 9.50 | | 12.10 | 13.40 |
| | | EERd | | 4.13 | 4.14 | 4.23 | 4.04 | 3.84 | 3.68 |
| | | Power input | kW | 1.65 | 1.64 | 2.25 | 2.35 | 3.15 | 3.64 |
| | B Condition (30°C - 27/19) | Pdc | kW | 5.01 | 5.03 | 7.00 | 7.03 | 8.92 | 9.88 |
| | | EERd | | 5.96 | 6.00 | 6.14 | 5.96 | 5.81 | 5.77 |
| | | Power input | kW | 0.84 | | 1.14 | 1.18 | 1.54 | 1.71 |
| | C Condition (25°C - 27/19) | Pdc | kW | 3.22 | 3.20 | 4.50 | 4.46 | 5.74 | 6.35 |
| | | EERd | | 10.19 | 8.66 | 9.32 | 9.12 | 9.63 | 9.37 |
| | | Power input | kW | 0.32 | 0.37 | 0.48 | 0.49 | 0.60 | 0.68 |
| | D Condition (20°C - 27/19) | Pdc | kW | 2.64 | 2.72 | 3.71 | 3.59 | 3.61 | |
| EERd | | 14.60 | 10.83 | 12.87 | 12.38 | 13.99 | 14.07 | | |
| Power input | | kW | 0.18 | 0.25 | 0.29 | | 0.26 | | |
| Space heating (Average climate) | Energy efficiency class | | A++ | A+ | A++ | | - | | |
| | Capacity | Pdesign | 4.70 | | 9.52 | 7.80 | 9.52 | | |
| | SCOP/A | | 4.61 | 4.20 | 4.75 | 4.70 | 4.53 | 4.44 | |
| | SCOPnet/A | | 4.61 | 4.20 | 4.75 | 4.70 | 4.53 | 4.44 | |
| | ηs,h | | - | | | | 178 | 175 | |
| | Annual energy consumption | | kWh/a | 1,427 | 1,567 | 2,805 | 2,324 | 2,943 | 3,002 |
| | Required back up heating cap at design conditions | | kW | 0.00 | | | | | |
| | TOL | Tol (temperature operating limit) | °C | -10 | | | | | |
| | | Pdh (declared heating cap) | kW | 4.70 | | 9.52 | 7.80 | 9.52 | |
| | | COPd (declared COP) | | 2.97 | 2.94 | 2.79 | 2.95 | 2.22 | 2.23 |
| | | Power input | kW | 1.58 | 1.60 | 3.42 | 2.64 | 4.29 | 4.27 |
| | TBivalent | Tbiv (bivalent temperature) | °C | -10 | | | | | |
| | | Pdh (declared heating cap) | kW | 4.70 | | 9.52 | 7.80 | 9.52 | |
| | | COPd (declared COP) | | 2.97 | 2.94 | 2.79 | 2.95 | 2.22 | 2.23 |
| | | Power input | kW | 1.58 | 1.60 | 3.42 | 2.64 | 4.29 | 4.27 |
| | A Condition (-7°C) | Pdh (declared heating cap) | kW | 4.16 | 4.14 | 8.42 | 6.86 | 8.42 | |
| | | COPd (declared COP) | | 3.32 | 3.30 | 3.14 | 3.26 | 2.84 | 2.80 |
| | | Power input | kW | 1.25 | | 2.69 | 2.10 | 2.97 | 3.01 |
| | B Condition (2°C) | Pdh (declared heating cap) | kW | 2.53 | 2.54 | 5.13 | 4.21 | 5.13 | |
| | | COPd (declared COP) | | 4.57 | 4.30 | 4.79 | 4.75 | 4.58 | 4.42 |
| | | Power input | kW | 0.55 | 0.59 | 1.07 | 0.89 | 1.12 | 1.16 |
| | C Condition (7°C) | Pdh (declared heating cap) | kW | 1.79 | 1.89 | 3.30 | 2.73 | 3.30 | |
| | | COPd (declared COP) | | 5.48 | 4.73 | 5.81 | 5.59 | 5.79 | 5.78 |
| Power input | | kW | 0.33 | 0.40 | 0.57 | 0.49 | 0.57 | | |
| D Condition (12°C) | Pdh (declared heating cap) | kW | 2.01 | 2.11 | 2.58 | 2.60 | | | |
| | COPd (declared COP) | | 7.02 | 5.75 | 6.86 | 6.64 | 6.62 | 6.60 | |
| | Power input | kW | 0.29 | 0.37 | 0.38 | 0.39 | | | |
| Cooling | Cdc (Degradation cooling) | | 0.25 | | | | | | |
| Heating | Cdh (Degradation heating) | | 0.25 | | | | | | |
| Cooling function included | | Yes | | | | | | | |
| Heating function included | | Yes | | | | | | | |

2 Specifications

2

| 2-1 Capacity and Power input | | | | | FCAHG71H/ RZAG71NV1 | FCAHG100H/ RZAG71NV1 | FCAHG100H/ RZAG100NV1 | FCAHG140H/ RZAG100NV1 | FCAHG125H/ RZAG125NV1 | FCAHG140H/ RZAG140NV1 |
|---|---------------------|---------|------|----|------------------------|-------------------------|--------------------------|--------------------------|--------------------------|--------------------------|
| Average climate included | | | | | Yes | | | | | |
| Cold season included | | | | | No | | | | | |
| Warm season included | | | | | No | | | | | |
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.009 | | | | | |
| | | Heating | POFF | kW | 0.009 | | | | | |
| | Standby mode | Cooling | PSB | kW | 0.009 | | | | | |
| | | Heating | PSB | kW | 0.009 | | | | | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | | | | | |
| | | Heating | PTO | kW | 0.013 | | | | | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | | No | | | | | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | | | | | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

| 2-2 Capacity and Power input | | | | FCAG71B/ RZAG71NV1 | FCAG100B/ RZAG71NV1 | FCAG100B/ RZAG100NV1 | FCAG140B/ RZAG100NV1 | FCAG125B/ RZAG125NV1 | FCAG140B/ RZAG140NV1 | | |
|------------------------------|----------------------------|-------------|-------|-----------------------|------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------|-----|
| Cooling capacity | Nom. | | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | | |
| Heating capacity | Nom. | | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | | |
| Space cooling | Energy efficiency class | | | A++ | | | | | | - | |
| | Capacity | Pdesign | kW | 6.80 | | 9.50 | | 12.1 | 13.4 | | |
| | SEER | | | 6.83 | 7.50 | 7.14 | 7.86 | 7.15 | 6.80 | | |
| | ηs,c | | | - | | | | | | 283 | 269 |
| | Annual energy consumption | | | kWh/a | 348 | 317 | 466 | 423 | 1,016 | 1,182 | |
| | A Condition (35°C - 27/19) | Pdc | kW | 6.80 | | 9.50 | | 12.10 | 13.40 | | |
| | | EERd | | 3.54 | 4.14 | 3.59 | 4.13 | 3.32 | 3.12 | | |
| | | Power input | | kW | 1.92 | 1.64 | 2.65 | 2.30 | 3.65 | 4.29 | |
| | B Condition (30°C - 27/19) | Pdc | kW | 5.03 | | 7.03 | | 8.92 | 9.88 | | |
| | | EERd | | 5.43 | 5.65 | 5.83 | 5.76 | 5.65 | 4.47 | | |
| | | Power input | | kW | 0.93 | 0.89 | 1.21 | 1.22 | 1.58 | 2.21 | |
| | C Condition (25°C - 27/19) | Pdc | kW | 3.20 | | 4.46 | | 5.74 | 6.35 | | |
| | | EERd | | 8.32 | 9.57 | 8.18 | 9.72 | 7.87 | 8.17 | | |
| | | Power input | | kW | 0.38 | 0.33 | 0.55 | 0.46 | 0.73 | 0.78 | |
| D Condition (20°C - 27/19) | Pdc | kW | 2.40 | 2.65 | 3.31 | 3.61 | 3.25 | 3.32 | | | |
| | EERd | | 12.31 | 13.42 | 13.03 | 14.70 | 12.77 | 13.55 | | | |
| | Power input | | kW | 0.20 | | 0.25 | | | | | |

2 Specifications

| 2-2 Capacity and Power input | | | | | FCAG71B/ RZAG71NV1 | FCAG100B/ RZAG71NV1 | FCAG100B/ RZAG100NV1 | FCAG140B/ RZAG100NV1 | FCAG125B/ RZAG125NV1 | FCAG140B/ RZAG140NV1 | | | |
|---|---|-----------------------------------|------|-------|-----------------------|------------------------|-------------------------|-------------------------|-------------------------|-------------------------|------|------|--|
| Space heating (Average climate) | Energy efficiency class | | | | A+ | | | A++ | | - | | | |
| | Capacity | Pdesign | kW | | 4.70 | | 7.80 | | 9.52 | | | | |
| | SCOP/A | | | | 4.22 | 4.45 | 4.53 | 4.66 | 4.34 | | | | |
| | SCOPnet/A | | | | 4.22 | 4.45 | 4.53 | 4.66 | 4.34 | | | | |
| | ηs,h | | | % | - | | | | | 171 | | | |
| | Annual energy consumption | | | kWh/a | 1,560 | 1,479 | 2,413 | 2,343 | 3,071 | | | | |
| | Required back up heating cap at design conditions | | | | kW | | | | | | | 0.00 | |
| | TOL | Tol (temperature operating limit) | °C | | -10 | | | | | | | | |
| | | Pdh (declared heating cap) | kW | | 4.70 | | 7.80 | | 9.52 | | | | |
| | | COPd (declared COP) | | | | 2.54 | 2.88 | 2.51 | 2.73 | 1.91 | 1.93 | | |
| | | Power input | kW | | 1.85 | 1.63 | 3.11 | 2.85 | 4.98 | 4.93 | | | |
| | TBivalent | Tbiv (bivalent temperature) | °C | | -10 | | | | | | | | |
| | | Pdh (declared heating cap) | kW | | 4.70 | | 7.80 | | 9.52 | | | | |
| | | COPd (declared COP) | | | | 2.54 | 2.88 | 2.51 | 2.73 | 1.91 | 1.93 | | |
| | | Power input | kW | | 1.85 | 1.63 | 3.11 | 2.85 | 4.98 | 4.93 | | | |
| | A Condition (-7°C) | Pdh (declared heating cap) | kW | | 4.13 | 4.14 | 6.86 | | 8.43 | 8.42 | | | |
| | | COPd (declared COP) | | | | 2.96 | 3.25 | 2.87 | 3.04 | 2.59 | 2.52 | | |
| | | Power input | kW | | 1.40 | 1.27 | 2.39 | 2.26 | 3.25 | 3.34 | | | |
| | B Condition (2°C) | Pdh (declared heating cap) | kW | | 2.54 | | 4.21 | | 5.12 | | | | |
| | | COPd (declared COP) | | | | 4.23 | 4.46 | 4.37 | 4.65 | 4.29 | 4.33 | | |
| | | Power input | kW | | 0.60 | 0.57 | 0.96 | 0.91 | 1.20 | 1.18 | | | |
| | C Condition (7°C) | Pdh (declared heating cap) | kW | | 1.77 | 1.80 | 2.73 | | 3.29 | | | | |
| | | COPd (declared COP) | | | | 5.11 | 5.30 | 6.01 | 5.82 | 5.92 | | | |
| | | Power input | kW | | 0.35 | 0.34 | 0.45 | 0.47 | 0.56 | | | | |
| | D Condition (12°C) | Pdh (declared heating cap) | kW | | 1.96 | 2.02 | 2.47 | 2.51 | 2.52 | | | | |
| | | COPd (declared COP) | | | | 6.01 | 6.60 | 7.75 | 7.16 | 6.94 | | | |
| | | Power input | kW | | 0.33 | 0.31 | 0.32 | 0.35 | 0.36 | | | | |
| Cooling | Cdc (Degradation cooling) | | | | 0.25 | | | | | | | | |
| Heating | Cdh (Degradation heating) | | | | 0.25 | | | | | | | | |
| Cooling function included | | | | Yes | | | | | | | | | |
| Heating function included | | | | Yes | | | | | | | | | |
| Average climate included | | | | Yes | | | | | | | | | |
| Cold season included | | | | No | | | | | | | | | |
| Warm season included | | | | No | | | | | | | | | |
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.009 | | | | | | | | |
| | | Heating | POFF | kW | 0.009 | | | | | | | | |
| | Standby mode | Cooling | PSB | kW | 0.009 | | | | | | | | |
| | | Heating | PSB | kW | 0.009 | | | | | | | | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | | | | | | | | |
| | | Heating | PTO | kW | 0.013 | | | | | | | | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | No | | | | | | | | | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | | | | | | | | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

2

| 2-3 Capacity and Power input | | | FBA71A9/ RZAG71NV1 | FBA100A/ RZAG71NV1 | FBA100A/ RZAG100NV1 | FBA140A/ RZAG100NV1 | FBA125A/ RZAG125NV1 | FBA140A/ RZAG140NV1 | | |
|------------------------------------|---|-----------------------------------|-----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|-------|-----|
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | | |
| Space cooling | Energy efficiency class | | A++ | A+ | A++ | | - | | | |
| | Capacity | Pdesign | 6.80 | | 9.50 | | 12.1 | 13.4 | | |
| | SEER | | 6.50 | 5.81 | 6.47 | 6.39 | 6.56 | 6.42 | | |
| | ηs,c | | % | | - | | 259 | 254 | | |
| | Annual energy consumption | | kWh/a | 366 | 410 | 514 | 520 | 1,107 | 1,252 | |
| | A Condition (35°C - 27/19) | Pdc | kW | 6.80 | | 9.50 | | 12.10 | 13.40 | |
| | | EERd | | 3.40 | 4.15 | 3.69 | 4.18 | 3.27 | 2.86 | |
| | | Power input | kW | 2.00 | 1.64 | 2.58 | 2.27 | 3.70 | 4.69 | |
| | B Condition (30°C - 27/19) | Pdc | kW | 5.03 | | 7.03 | | 8.92 | 9.88 | |
| | | EERd | | 5.07 | 4.39 | 4.92 | 4.69 | 4.95 | 4.64 | |
| | | Power input | kW | 0.99 | 1.15 | 1.43 | 1.50 | 1.80 | 2.13 | |
| | C Condition (25°C - 27/19) | Pdc | kW | 3.20 | | 4.46 | 4.47 | 5.74 | 6.35 | |
| | | EERd | | 7.94 | 7.06 | 7.80 | 7.62 | 7.45 | 7.47 | |
| | | Power input | kW | 0.40 | 0.45 | 0.57 | 0.59 | 0.77 | 0.85 | |
| | D Condition (20°C - 27/19) | Pdc | kW | 2.44 | 2.68 | 3.33 | 3.66 | 3.34 | 3.50 | |
| EERd | | 12.41 | 9.51 | 11.22 | 11.10 | 11.49 | 12.13 | | | |
| Power input | | kW | 0.20 | 0.28 | 0.30 | 0.33 | 0.29 | | | |
| Space heating (Average climate) | Energy efficiency class | | A+ | | | | - | | | |
| | Capacity | Pdesign | 4.70 | | 7.80 | | 9.52 | | | |
| | SCOP/A | | 4.20 | 4.06 | 4.36 | 4.20 | 4.37 | 4.34 | | |
| | SCOPnet/A | | 4.20 | 4.06 | 4.36 | 4.20 | 4.37 | 4.34 | | |
| | ηs,h | | % | | - | | 172 | 171 | | |
| | Annual energy consumption | | kWh/a | 1,566 | 1,621 | 2,505 | 2,600 | 3,050 | 3,070 | |
| | Required back up heating cap at design conditions | | kW | 0.00 | | | | | | |
| | TOL | Tol (temperature operating limit) | | °C | | | | | | -10 |
| | | Pdh (declared heating cap) | | 4.70 | | 7.80 | | 9.52 | | |
| | | COPd (declared COP) | | 2.50 | 2.69 | 2.46 | 2.52 | 1.97 | 2.01 | |
| | | Power input | | 1.88 | 1.75 | 3.17 | 3.09 | 4.83 | 4.74 | |
| | TBivalent | Tbiv (bivalent temperature) | | °C | | | | | | -10 |
| | | Pdh (declared heating cap) | | 4.70 | | 7.80 | | 9.52 | | |
| | | COPd (declared COP) | | 2.50 | 2.69 | 2.46 | 2.52 | 1.97 | 2.01 | |
| | | Power input | | 1.88 | 1.75 | 3.17 | 3.09 | 4.83 | 4.74 | |
| | A Condition (-7°C) | Pdh (declared heating cap) | | 4.14 | | 6.87 | 6.86 | 8.42 | 8.43 | |
| | | COPd (declared COP) | | 2.92 | 3.04 | 2.82 | 2.80 | 2.67 | 2.58 | |
| | | Power input | | 1.42 | 1.36 | 2.43 | 2.45 | 3.15 | 3.26 | |
| | B Condition (2°C) | Pdh (declared heating cap) | | 2.54 | | 4.21 | | 5.12 | | |
| | | COPd (declared COP) | | 4.21 | 4.10 | 4.33 | 4.20 | 4.37 | 4.32 | |
| | | Power input | | 0.60 | 0.62 | 0.97 | 1.00 | 1.17 | 1.18 | |
| | C Condition (7°C) | Pdh (declared heating cap) | | 1.76 | 1.83 | 2.73 | | 3.29 | | |
| | | COPd (declared COP) | | 5.12 | 4.74 | 5.47 | 5.16 | 5.76 | 5.83 | |
| | | Power input | | 0.34 | 0.39 | 0.50 | 0.53 | 0.57 | | |
| | D Condition (12°C) | Pdh (declared heating cap) | | 1.96 | 2.05 | 2.51 | 2.55 | | 2.56 | |
| | | COPd (declared COP) | | 6.12 | 5.85 | 6.91 | 6.28 | 6.73 | 6.86 | |
| | | Power input | | 0.32 | 0.35 | 0.36 | 0.41 | 0.38 | 0.37 | |
| Cooling | Cdc (Degradation cooling) | | 0.25 | | | | | | | |
| Heating | Cdh (Degradation heating) | | 0.25 | | | | | | | |
| Cooling function included | | | Yes | | | | | | | |
| Heating function included | | | Yes | | | | | | | |

2 Specifications

| 2-3 Capacity and Power input | | | | | FBA71A9/ RZAG71NV1 | FBA100A/ RZAG71NV1 | FBA100A/ RZAG100NV1 | FBA140A/ RZAG100NV1 | FBA125A/ RZAG125NV1 | FBA140A/ RZAG140NV1 |
|---|---------------------|---------|------|----|-----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|
| Average climate included | | | | | Yes | | | | | |
| Cold season included | | | | | No | | | | | |
| Warm season included | | | | | No | | | | | |
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.011 | | | | | |
| | | Heating | POFF | kW | 0.011 | | | | | |
| | Standby mode | Cooling | PSB | kW | 0.011 | | | | | |
| | | Heating | PSB | kW | 0.011 | | | | | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | | | | | |
| | | Heating | PTO | kW | 0.015 | | | | | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | | No | | | | | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | | | | | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

| 2-4 Capacity and Power input | | | | FDA125A/RZAG125NV1 | | |
|------------------------------|----------------------------|-------------|------|--------------------|------|-------|
| Cooling capacity | Nom. | | kW | 12.1 (1) | | |
| Heating capacity | Nom. | | kW | 13.5 (2) | | |
| Space cooling | Capacity | Pdesign | kW | 12.1 | | |
| | SEER | | | 6.59 | | |
| | ηs,c | | | 261 | | |
| | Annual energy consumption | | | kWh/a | | 1,102 |
| | A Condition (35°C - 27/19) | Pdc | kW | 12.10 | | |
| | | EERd | | 3.25 | | |
| | | Power input | | kW | 3.73 | |
| | B Condition (30°C - 27/19) | Pdc | kW | 8.92 | | |
| | | EERd | | 4.99 | | |
| | | Power input | | kW | 1.79 | |
| | C Condition (25°C - 27/19) | Pdc | kW | 5.73 | | |
| | | EERd | | 7.67 | | |
| | | Power input | | kW | 0.75 | |
| | D Condition (20°C - 27/19) | Pdc | kW | 3.34 | | |
| EERd | | 11.04 | | | | |
| Power input | | kW | 0.30 | | | |

2 Specifications

| 2-4 Capacity and Power input | | | | | FDA125A/RZAG125NV1 | |
|---|---|-----------------------------------|-------|------|--------------------|------|
| Space heating (Average climate) | Capacity | Pdesign | kW | | 9.52 | |
| | SCOP/A | | | | 4.35 | |
| | SCOPnet/A | | | | 4.35 | |
| | ηs,h | | % | | 171 | |
| | Annual energy consumption | | kWh/a | | 3,064 | |
| | Required back up heating cap at design conditions | | kW | | 0.00 | |
| | TOL | Tol (temperature operating limit) | °C | | -10 | |
| | | Pdh (declared heating cap) | kW | | 9.52 | |
| | | COPd (declared COP) | | | | 1.99 |
| | | Power input | kW | | 4.78 | |
| | TBivalent | Tbiv (bivalent temperature) | °C | | -10 | |
| | | Pdh (declared heating cap) | kW | | 9.52 | |
| | | COPd (declared COP) | | | | 1.99 |
| | | Power input | kW | | 4.78 | |
| | A Condition (-7°C) | Pdh (declared heating cap) | kW | | 8.42 | |
| | | COPd (declared COP) | | | | 2.69 |
| | | Power input | kW | | 3.13 | |
| | B Condition (2°C) | Pdh (declared heating cap) | kW | | 5.12 | |
| | | COPd (declared COP) | | | | 4.33 |
| | | Power input | kW | | 1.18 | |
| C Condition (7°C) | Pdh (declared heating cap) | kW | | 3.29 | | |
| | COPd (declared COP) | | | | 5.73 | |
| | Power input | kW | | 0.58 | | |
| D Condition (12°C) | Pdh (declared heating cap) | kW | | 2.58 | | |
| | COPd (declared COP) | | | | 6.68 | |
| | Power input | kW | | 0.39 | | |
| Cooling | Cdc (Degradation cooling) | | | | 0.25 | |
| Heating | Cdh (Degradation heating) | | | | 0.25 | |
| Cooling function included | | | | | Yes | |
| Heating function included | | | | | Yes | |
| Average climate included | | | | | Yes | |
| Cold season included | | | | | No | |
| Warm season included | | | | | No | |
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.012 | |
| | | Heating | POFF | kW | 0.012 | |
| | Standby mode | Cooling | PSB | kW | 0.012 | |
| | | Heating | PSB | kW | 0.012 | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | |
| | | Heating | PTO | kW | 0.016 | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | | No | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

| 2-5 Capacity and Power input | | | FAA71A/RZAG71NV1 | FAA100A/RZAG71NV1 | FAA100A/RZAG100NV1 | |
|------------------------------------|---|-----------------------------------|------------------|-------------------|--------------------|-------|
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | |
| Space cooling | Energy efficiency class | | A++ | | | |
| | Capacity | Pdesign | 6.80 | | 9.50 | |
| | SEER | | 6.58 | 6.43 | 6.42 | |
| | Annual energy consumption | | kWh/a | 362 | 370 | 518 |
| | A Condition (35°C - 27/19) | Pdc | kW | 6.80 | | 9.50 |
| | | EERd | | 3.27 | 3.77 | 3.74 |
| | | Power input | kW | 2.08 | 1.80 | 2.54 |
| | B Condition (30°C - 27/19) | Pdc | kW | 5.03 | | 7.03 |
| | | EERd | | 4.54 | 4.85 | 4.76 |
| | | Power input | kW | 1.11 | 1.04 | 1.48 |
| | C Condition (25°C - 27/19) | Pdc | kW | 3.22 | 3.20 | 4.46 |
| | | EERd | | 9.30 | 8.05 | 7.70 |
| | | Power input | kW | 0.35 | 0.40 | 0.58 |
| | D Condition (20°C - 27/19) | Pdc | kW | 2.40 | 2.48 | 3.43 |
| EERd | | 11.11 | 10.79 | 11.08 | | |
| Power input | | kW | 0.22 | 0.23 | 0.31 | |
| Space heating (Average climate) | Energy efficiency class | | A+ | | | |
| | Capacity | Pdesign | 4.70 | | 7.80 | |
| | SCOP/A | | 4.20 | 4.10 | 4.01 | |
| | SCOPnet/A | | 4.20 | 4.10 | 4.01 | |
| | Annual energy consumption | | kWh/a | 1,567 | 1,605 | 2,723 |
| | Required back up heating cap at design conditions | | kW | 0.00 | | |
| | TOL | Tol (temperature operating limit) | °C | -10 | | |
| | | Pdh (declared heating cap) | kW | 4.70 | | 7.80 |
| | | COPd (declared COP) | | 2.51 | 2.74 | 2.19 |
| | | Power input | kW | 1.88 | 1.71 | 3.57 |
| | TBivalent | Tbiv (bivalent temperature) | °C | -10 | | |
| | | Pdh (declared heating cap) | kW | 4.70 | | 7.80 |
| | | COPd (declared COP) | | 2.51 | 2.74 | 2.19 |
| | | Power input | kW | 1.88 | 1.71 | 3.57 |
| | A Condition (-7°C) | Pdh (declared heating cap) | kW | 4.14 | | 6.86 |
| | | COPd (declared COP) | | 2.91 | 3.07 | 2.53 |
| | | Power input | kW | 1.42 | 1.35 | 2.71 |
| | B Condition (2°C) | Pdh (declared heating cap) | kW | 2.54 | | 4.21 |
| | | COPd (declared COP) | | 4.20 | 4.11 | 3.94 |
| | | Power input | kW | 0.60 | 0.62 | 1.07 |
| | C Condition (7°C) | Pdh (declared heating cap) | kW | 1.76 | 1.79 | 2.73 |
| | | COPd (declared COP) | | 5.14 | 4.81 | 5.19 |
| | | Power input | kW | 0.34 | 0.37 | 0.53 |
| | D Condition (12°C) | Pdh (declared heating cap) | kW | 1.96 | 2.02 | 2.47 |
| | | COPd (declared COP) | | 6.09 | 5.94 | 6.61 |
| | | Power input | kW | 0.32 | 0.34 | 0.37 |
| | Cooling | Cdc (Degradation cooling) | | | | 0.25 |
| Heating | Cdh (Degradation heating) | | | | 0.25 | |
| Cooling function included | | | Yes | | | |
| Heating function included | | | Yes | | | |
| Average climate included | | | Yes | | | |
| Cold season included | | | No | | | |
| Warm season included | | | No | | | |

2 Specifications

2

| 2-5 Capacity and Power input | | | | | FAA71A/RZAG71NV1 | FAA100A/RZAG71NV1 | FAA100A/RZAG100NV1 |
|---|---------------------|---------|------|----|------------------|-------------------|--------------------|
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.009 | | |
| | | Heating | POFF | kW | 0.009 | | |
| | Standby mode | Cooling | PSB | kW | 0.009 | | |
| | | Heating | PSB | kW | 0.009 | | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | | |
| | | Heating | PTO | kW | 0.013 | | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | | No | | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

| 2-6 Capacity and Power input | | | | FHA71A9/ RZAG71NV1 | FHA100A/ RZAG71NV1 | FHA100A/ RZAG100NV1 | FHA140A/ RZAG100NV1 | FHA125A/ RZAG125NV1 | FHA140A/ RZAG140NV1 | | | | | | |
|------------------------------|----------------------------|-------------|----|-----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|----------|----------|------|------|-------|-------|
| Cooling capacity | Nom. | | | kW | | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | | | | |
| Heating capacity | Nom. | | | kW | | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | | | | |
| Space cooling | Energy efficiency class | | | A++ | | | | - | | | | | | | |
| | Capacity | Pdesign | kW | 6.80 | | 9.50 | | 12.1 | | 13.4 | | | | | |
| | SEER | | | 7.11 | | 6.69 | | 6.42 | | 7.35 | | 7.14 | 6.42 | | |
| | ηs,c | | | % | | - | | | | 283 | | 254 | | | |
| | Annual energy consumption | | | kWh/a | | 335 | | 356 | | 518 | | 453 | | 1,017 | 1,253 |
| | A Condition (35°C - 27/19) | Pdc | kW | | 6.80 | | 9.50 | | 12.10 | | 13.40 | | | | |
| | | EERd | | 3.75 | | 4.02 | | 4.10 | | 4.05 | | 3.40 | 3.11 | | |
| | | Power input | | kW | | 1.81 | | 1.69 | | 2.31 | | 2.34 | | 3.56 | 4.31 |
| | B Condition (30°C - 27/19) | Pdc | kW | | 5.03 | | 7.03 | | 8.92 | | 9.87 | | | | |
| | | EERd | | 5.46 | | 5.34 | | 4.92 | | 6.03 | | 5.55 | 4.94 | | |
| | | Power input | | kW | | 0.92 | | 0.94 | | 1.43 | | 1.17 | | 1.61 | 2.00 |
| | C Condition (25°C - 27/19) | Pdc | kW | | 3.20 | | 4.47 | | 4.46 | | 5.73 | | 6.35 | | |
| | | EERd | | 8.99 | | 8.27 | | 7.62 | | 8.88 | | 8.20 | 7.48 | | |
| | | Power input | | kW | | 0.36 | | 0.39 | | 0.59 | | 0.50 | | 0.70 | 0.85 |
| | D Condition (20°C - 27/19) | Pdc | kW | | 2.48 | | 2.62 | | 3.54 | | 3.61 | | 3.36 | 3.35 | |
| EERd | | 12.58 | | 10.71 | | 10.27 | | 11.63 | | 12.00 | 10.13 | | | | |
| Power input | | kW | | 0.20 | | 0.24 | | 0.34 | | 0.31 | | 0.28 | 0.33 | | |

2 Specifications

| 2-6 Capacity and Power input | | | | | FHA71A9/ RZAG71NV1 | FHA100A/ RZAG71NV1 | FHA100A/ RZAG100NV1 | FHA140A/ RZAG100NV1 | FHA125A/ RZAG125NV1 | FHA140A/ RZAG140NV1 | | |
|---|---|-----------------------------------|----------------------------|----|-----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|-------|-------|
| Space heating (Average climate) | Energy efficiency class | | | | A+ | | A++ | A+ | - | | | |
| | Capacity | Pdesign | kW | | 4.70 | | 7.80 | | 9.52 | | | |
| | SCOP/A | | | | 4.32 | 4.26 | 4.61 | 4.50 | 4.20 | 4.30 | | |
| | SCOPnet/A | | | | 4.32 | 4.26 | 4.61 | 4.50 | 4.20 | 4.30 | | |
| | ηs,h | | | | % | | | | - | | 165 | 169 |
| | Annual energy consumption | | | | kWh/a | | 1,523 | 1,545 | 2,369 | 2,429 | 3,174 | 3,100 |
| | Required back up heating cap at design conditions | | | | kW | | 0.00 | | | | | |
| | TOL | Tol (temperature operating limit) | °C | | -10 | | | | | | | |
| | | | Pdh (declared heating cap) | kW | | 4.70 | | 7.80 | | 9.52 | | |
| | | COPd (declared COP) | | | | 2.43 | 2.90 | 2.65 | 2.85 | 1.87 | 2.13 | |
| | | Power input | | | | kW | | 1.93 | 1.62 | 2.94 | 2.73 | 5.10 |
| | TBivalent | Tbiv (bivalent temperature) | °C | | -10 | | | | | | | |
| | | | Pdh (declared heating cap) | kW | | 4.70 | | 7.80 | | 9.52 | | |
| | | COPd (declared COP) | | | | 2.43 | 2.90 | 2.65 | 2.85 | 1.87 | 2.13 | |
| | | Power input | | | | kW | | 1.93 | 1.62 | 2.94 | 2.73 | 5.10 |
| | A Condition (-7°C) | Pdh (declared heating cap) | kW | | 4.14 | | 6.86 | | 8.42 | | | |
| | | | COPd (declared COP) | | | | 2.95 | 3.26 | 3.03 | 3.15 | 2.55 | 2.70 |
| | | Power input | | | | kW | | 1.40 | 1.27 | 2.27 | 2.18 | 3.30 |
| | B Condition (2°C) | Pdh (declared heating cap) | kW | | 2.54 | | 4.21 | | 5.12 | | | |
| | | | COPd (declared COP) | | | | 4.44 | 4.32 | 4.61 | 4.57 | 4.26 | 4.33 |
| | | Power input | | | | kW | | 0.57 | 0.59 | 0.91 | 0.92 | 1.20 |
| | C Condition (7°C) | Pdh (declared heating cap) | kW | | 1.79 | 1.84 | 2.73 | | 3.29 | | | |
| | | | COPd (declared COP) | | | | 5.15 | 4.90 | 5.70 | 5.30 | 5.49 | 5.54 |
| | | Power input | | | | kW | | 0.35 | 0.38 | 0.48 | 0.52 | 0.60 |
| | D Condition (12°C) | Pdh (declared heating cap) | kW | | 1.97 | 2.07 | 2.54 | 2.60 | 2.55 | 2.64 | | |
| | | | COPd (declared COP) | | | | 5.99 | 6.00 | 7.06 | 6.21 | 6.13 | 6.25 |
| | | Power input | | | | kW | | 0.33 | 0.34 | 0.36 | 0.42 | |
| Cooling | Cdc (Degradation cooling) | | | | 0.25 | | | | | | | |
| Heating | Cdh (Degradation heating) | | | | 0.25 | | | | | | | |
| Cooling function included | | | | | Yes | | | | | | | |
| Heating function included | | | | | Yes | | | | | | | |
| Average climate included | | | | | Yes | | | | | | | |
| Cold season included | | | | | No | | | | | | | |
| Warm season included | | | | | No | | | | | | | |
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.009 | | | | | | | |
| | | Heating | POFF | kW | 0.009 | | | | | | | |
| | Standby mode | Cooling | PSB | kW | 0.009 | | | | | | | |
| | | Heating | PSB | kW | 0.009 | | | | | | | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | | | | | | | |
| | | Heating | PTO | kW | 0.013 | | | | | | | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | | No | | | | | | | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | | | | | | | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

2

| 2-7 Capacity and Power input | | | FUA71A/RZAG71NV1 | FUA100A/RZAG71NV1 | FUA100A/RZAG100NV1 | FUA125A/RZAG125NV1 | |
|------------------------------------|---|-----------------------------------|------------------|-------------------|--------------------|--------------------|-------|
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | 12.1 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | 13.5 (2) | |
| Space cooling | Energy efficiency class | | A++ | | | - | |
| | Capacity | Pdesign | 6.80 | | 9.50 | 12.1 | |
| | SEER | | 7.02 | 6.89 | 6.42 | 6.39 | |
| | η _{s,c} | | - | | | 253 | |
| | Annual energy consumption | | 339 | 345 | 518 | 1,136 | |
| | A Condition (35°C - 27/19) | Pdc | 6.80 | | 9.50 | 12.10 | |
| | | EERd | | 3.83 | 4.02 | 3.57 | 3.02 |
| | | Power input | 1.77 | | 1.69 | 2.66 | 4.00 |
| | B Condition (30°C - 27/19) | Pdc | 5.03 | | 7.03 | 8.91 | |
| | | EERd | | 5.34 | 5.65 | 4.93 | 5.08 |
| | | Power input | 0.94 | | 0.89 | 1.43 | 1.76 |
| | C Condition (25°C - 27/19) | Pdc | 3.20 | | 3.19 | 4.46 | 5.74 |
| | | EERd | | 8.83 | 8.54 | 7.75 | 7.22 |
| | | Power input | 0.36 | | 0.37 | 0.58 | 0.79 |
| | D Condition (20°C - 27/19) | Pdc | 2.59 | | 2.64 | 3.36 | 3.23 |
| | | EERd | | 12.48 | 10.88 | 10.65 | 10.56 |
| Power input | | 0.21 | | 0.24 | 0.32 | 0.31 | |
| Space heating (Average climate) | Energy efficiency class | | A+ | | | - | |
| | Capacity | Pdesign | 4.70 | | 7.80 | 9.52 | |
| | SCOP/A | | 4.20 | 4.28 | 4.50 | 4.26 | |
| | SCOPnet/A | | 4.20 | 4.28 | 4.50 | 4.26 | |
| | η _{s,h} | | - | | | 167 | |
| | Annual energy consumption | | 1,567 | 1,538 | 2,427 | 3,129 | |
| | Required back up heating cap at design conditions | | 0.00 | | | | |
| | TOL | Tol (temperature operating limit) | | -10 | | | |
| | | Pdh (declared heating cap) | 4.70 | | 7.80 | 9.52 | |
| | | COPd (declared COP) | | 2.58 | 2.95 | 2.62 | 1.97 |
| | | Power input | 1.82 | | 1.59 | 2.97 | 4.83 |
| | TBivalent | Tbiv (bivalent temperature) | | -10 | | | |
| | | Pdh (declared heating cap) | 4.70 | | 7.80 | 9.52 | |
| | | COPd (declared COP) | | 2.58 | 2.95 | 2.62 | 1.97 |
| | | Power input | 1.82 | | 1.59 | 2.97 | 4.83 |
| | A Condition (-7°C) | Pdh (declared heating cap) | 4.14 | | 6.86 | 8.43 | |
| | | COPd (declared COP) | | 2.99 | 3.31 | 3.00 | 2.66 |
| | | Power input | 1.38 | | 1.25 | 2.29 | 3.17 |
| | B Condition (2°C) | Pdh (declared heating cap) | 2.54 | | 4.21 | 5.12 | |
| | | COPd (declared COP) | | 4.27 | 4.36 | 4.53 | 4.31 |
| | | Power input | 0.60 | | 0.58 | 0.93 | 1.19 |
| | C Condition (7°C) | Pdh (declared heating cap) | 1.80 | | 1.86 | 2.73 | 3.29 |
| | | COPd (declared COP) | | 5.03 | 4.87 | 5.47 | |
| | | Power input | 0.36 | | 0.38 | 0.50 | 0.60 |
| | D Condition (12°C) | Pdh (declared heating cap) | 2.00 | | 2.09 | 2.55 | 2.58 |
| | | COPd (declared COP) | | 6.00 | 5.94 | 6.76 | 6.18 |
| | | Power input | 0.33 | | 0.35 | 0.38 | 0.42 |
| Cooling | Cdc (Degradation cooling) | | 0.25 | | | | |
| Heating | Cdh (Degradation heating) | | 0.25 | | | | |
| Cooling function included | | | Yes | | | | |
| Heating function included | | | Yes | | | | |
| Average climate included | | | Yes | | | | |

2 Specifications

| 2-7 Capacity and Power input | | | | | FUA71A/RZAG71NV1 | FUA100A/RZAG71NV1 | FUA100A/RZAG100NV1 | FUA125A/RZAG125NV1 |
|---|---------------------|---------|------|----|------------------|-------------------|--------------------|--------------------|
| Cold season included | | | | | No | | | |
| Warm season included | | | | | No | | | |
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.009 | | | |
| | | Heating | POFF | kW | 0.009 | | | |
| | Standby mode | Cooling | PSB | kW | 0.009 | | | |
| | | Heating | PSB | kW | 0.009 | | | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | | | |
| | | Heating | PTO | kW | 0.013 | | | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | | No | | | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | | | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

| 2-8 Capacity and Power input | | | | FVA71A/RZAG71NV1 | FVA100A/RZAG71NV1 | FVA100A/RZAG100NV1 | FVA140A/RZAG100NV1 | FVA125A/RZAG125NV1 | FVA140A/RZAG140NV1 | |
|------------------------------|----------------------------|-------------|----------|------------------|-------------------|--------------------|--------------------|--------------------|--------------------|-------|
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | | 13.4 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | | 15.5 (2) | |
| Space cooling | Energy efficiency class | | | A++ | | | | - | | |
| | Capacity | Pdesign | kW | 6.80 | | 9.50 | | 12.1 | | 13.4 |
| | SEER | | | 6.34 | 6.41 | 6.40 | 6.43 | 6.41 | 6.12 | |
| | ηs,c | | | - | | | | 253 | 242 | |
| | Annual energy consumption | | | 376 | 371 | 520 | 517 | 1,133 | 1,314 | |
| | A Condition (35°C - 27/19) | Pdc | kW | 6.80 | | 9.50 | | 12.10 | | 13.40 |
| | | EERd | | 3.27 | 3.95 | 3.57 | 3.93 | 3.21 | 3.03 | |
| | | Power input | | 2.08 | 1.72 | 2.66 | 2.42 | 3.77 | 4.42 | |
| | B Condition (30°C - 27/19) | Pdc | kW | 5.03 | | 7.03 | | 8.92 | | 9.87 |
| | | EERd | | 5.15 | 5.40 | 5.21 | 5.13 | 5.23 | 4.89 | |
| | | Power input | | 0.98 | 0.93 | 1.35 | 1.37 | 1.70 | 2.02 | |
| | C Condition (25°C - 27/19) | Pdc | kW | 3.20 | | 4.46 | | 5.73 | | 6.35 |
| | | EERd | | 7.53 | 7.81 | 7.67 | 7.63 | 7.07 | 6.90 | |
| | | Power input | | 0.42 | 0.41 | 0.58 | 0.59 | 0.81 | 0.92 | |
| | D Condition (20°C - 27/19) | Pdc | kW | 2.33 | 2.61 | 3.20 | 3.54 | 3.23 | 3.24 | |
| EERd | | 11.27 | 9.56 | 9.85 | 10.01 | 10.28 | 9.46 | | | |
| Power input | | 0.21 | 0.27 | 0.33 | 0.35 | 0.31 | 0.34 | | | |

2 Specifications

2

| 2-8 Capacity and Power input | | | | | FVA71A/ RZAG71NV1 | FVA100A/ RZAG71NV1 | FVA100A/ RZAG100NV1 | FVA140A/ RZAG100NV1 | FVA125A/ RZAG125NV1 | FVA140A/ RZAG140NV1 | |
|---|---|-----------------------------------|------|-------|----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|--|
| Space heating (Average climate) | Energy efficiency class | | | | A+ | | | | - | | |
| | Capacity | Pdesign | kW | | 4.70 | | 7.80 | | 9.52 | | |
| | SCOP/A | | | | 4.05 | 4.03 | 4.20 | 4.05 | 4.15 | 3.94 | |
| | SCOPnet/A | | | | 4.05 | 4.03 | 4.20 | 4.05 | 4.15 | 3.94 | |
| | ηs,h | | | % | - | | | | 163 | 155 | |
| | Annual energy consumption | | | kWh/a | 1,625 | 1,634 | 2,600 | 2,697 | 3,209 | 3,383 | |
| | Required back up heating cap at design conditions | | | kW | 0.00 | | | | | | |
| | TOL | Tol (temperature operating limit) | | °C | -10 | | | | | | |
| | | Pdh (declared heating cap) | | kW | 4.70 | | 7.80 | | 9.52 | | |
| | | COPd (declared COP) | | | 2.42 | 2.85 | 2.45 | 2.57 | 1.86 | | |
| | | Power input | | kW | 1.94 | 1.65 | 3.19 | 3.04 | 5.11 | | |
| | TBivalent | Tbiv (bivalent temperature) | | °C | -10 | | | | | | |
| | | Pdh (declared heating cap) | | kW | 4.70 | | 7.80 | | 9.52 | | |
| | | COPd (declared COP) | | | 2.42 | 2.85 | 2.45 | 2.57 | 1.86 | | |
| | | Power input | | kW | 1.94 | 1.65 | 3.19 | 3.04 | 5.11 | | |
| | A Condition (-7°C) | Pdh (declared heating cap) | | kW | 4.14 | | 6.86 | | 8.43 | 8.42 | |
| | | COPd (declared COP) | | | 2.83 | 3.18 | 2.82 | 2.84 | 2.55 | 2.42 | |
| | | Power input | | kW | 1.46 | 1.30 | 2.43 | 2.42 | 3.30 | 3.48 | |
| | B Condition (2°C) | Pdh (declared heating cap) | | kW | 2.54 | | 4.21 | | 5.12 | | |
| | | COPd (declared COP) | | | 4.07 | 4.11 | 4.21 | 4.11 | 4.20 | 3.99 | |
| | | Power input | | kW | 0.62 | | 1.00 | 1.02 | 1.22 | 1.28 | |
| | C Condition (7°C) | Pdh (declared heating cap) | | kW | 1.76 | 1.88 | 2.73 | | 3.29 | | |
| | | COPd (declared COP) | | | 4.92 | 4.54 | 5.13 | 4.77 | 5.42 | 5.12 | |
| | | Power input | | kW | 0.36 | 0.41 | 0.53 | 0.57 | 0.61 | 0.64 | |
| | D Condition (12°C) | Pdh (declared heating cap) | | kW | 1.96 | 2.10 | 2.56 | 2.60 | 2.57 | 2.61 | |
| | | COPd (declared COP) | | | 5.77 | 5.48 | 6.22 | 5.58 | 6.00 | 5.67 | |
| | | Power input | | kW | 0.34 | 0.38 | 0.41 | 0.47 | 0.43 | 0.46 | |
| Cooling | Cdc (Degradation cooling) | | | | 0.25 | | | | | | |
| Heating | Cdh (Degradation heating) | | | | 0.25 | | | | | | |
| Cooling function included | | | | | Yes | | | | | | |
| Heating function included | | | | | Yes | | | | | | |
| Average climate included | | | | | Yes | | | | | | |
| Cold season included | | | | | No | | | | | | |
| Warm season included | | | | | No | | | | | | |
| Power consumption in other than active mode | Off mode | Cooling | POFF | kW | 0.009 | | | | | | |
| | | Heating | POFF | kW | 0.009 | | | | | | |
| | Standby mode | Cooling | PSB | kW | 0.009 | | | | | | |
| | | Heating | PSB | kW | 0.009 | | | | | | |
| | Thermostat-off mode | Cooling | PTO | kW | 0.005 | | | | | | |
| | | Heating | PTO | kW | 0.013 | | | | | | |
| Indication if the heater is equipped with a supplementary heater (pair application) | | | | | No | | | | | | |
| Supplementary heater (pair application) | Back-up capacity | Heating | elbu | kW | 0.0 | | | | | | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

| 2-9 Technical Specifications | | | | RZAG71NV1 | RZAG100NV1 | RZAG125NV1 | RZAG140NV1 | |
|-------------------------------|---------------------|------------|---------------------------|--------------------------------------|------------|------------|------------|----|
| Capacity control | Method | | | Inverter controlled | | | | |
| Casing | Colour | | | Ivory white | | | | |
| | Material | | | Painted galvanized steel plate | | | | |
| Dimensions | Unit | Height | mm | 870 | | | | |
| | | Width | mm | 1,100 | | | | |
| | | Depth | mm | 460 | | | | |
| | Packed unit | Height | mm | 1,043 | | | | |
| | | Width | mm | 1,205 | | | | |
| | | Depth | mm | 509 | | | | |
| Weight | Unit | | kg | 81 | 85 | 95 | | |
| | Packed unit | | kg | 92 | 95 | 106 | | |
| Packing | Weight | | kg | 10 | | | | |
| Heat exchanger | Fin | Type | | WF fin | | | | |
| | | Treatment | | Anti-corrosion treatment (PE) | | | | |
| Compressor | Quantity | | | 1 | | | | |
| | Type | | | Hermetically sealed swing compressor | | | | |
| Fan | Type | | | Propeller | | | | |
| | Discharge direction | | | Horizontal | | | | |
| | Quantity | | | 1 | | | | |
| | Air flow rate | Cooling | Nom. | m ³ /min | 68 | 67 | 80 | 87 |
| | | Heating | Nom. | m ³ /min | 75 | 82 | 80 | 87 |
| Fan motor | Quantity | | | 1 | | | | |
| | Model | | | Brushless DC motor | | | | |
| | Output | | W | 234 | | | | |
| | Drive | | | Direct drive | | | | |
| Sound power level | Cooling | | dBA | 64 | 66 | 69 | 70 | |
| | Heating | | dBA | - | | 68 (1) | 71 (1) | |
| Sound pressure level | Cooling | Nom. | dBA | 46 | 47 | 49 | 50 | |
| | Heating | Nom. | dBA | 48 | 50 | 52 | | |
| Operation range | Cooling | Ambient | Min. | °CDB | -20 | | | |
| | | | Max. | °CDB | 52 | | | |
| | Heating | Ambient | Min. | °CWB | -20 | | | |
| | | | Max. | °CWB | 18 | | | |
| Refrigerant | Type | | | R-32 | | | | |
| | Charge | | kg | 3.20 | | 3.70 | | |
| | | | TCO ₂ eq | 2.16 | | 2.50 | | |
| | Control | | | Expansion valve (electronic type) | | | | |
| | GWP | | | 675 | | | | |
| | Circuits | Quantity | | 1 | | | | |
| Piping connections | Liquid | Quantity | | 1 | | | | |
| | | Type | | Flare connection | | | | |
| | | OD | mm | 9,52 | | | | |
| | Gas | Quantity | | 1 | | | | |
| | | Type | | Flare connection | | | | |
| | | OD | mm | 15.9 | | | | |
| | Drain | Quantity | | 8 | | | | |
| | | Type | | Hole | | | | |
| | | OD | mm | 26 | | | | |
| | Piping length | OU - IU | Min. | m | 3 | | | |
| Max. | | | m | 55 | 85 | | | |
| System | | Equivalent | m | 75 | 100 | | | |
| | | Chargeless | m | 40 | | | | |
| Additional refrigerant charge | | | kg/m | See installation manual | | | | |
| Level difference | IU - OU | Max. | m | 30 | | | | |
| | IU - IU | Max. | m | 0.5 | | | | |
| Heat insulation | | | Both liquid and gas pipes | | | | | |

2 Specifications

| 2-9 Technical Specifications | | | RZAG71NV1 | RZAG100NV1 | RZAG125NV1 | RZAG140NV1 |
|------------------------------|----------------|--------|---|------------|------------|------------|
| Refrigerant oil | Type | FW68DA | | | | |
| | Charged volume | l | 0.9 | | 1.4 | |
| Defrost method | | | Reversed cycle | | | |
| Defrost control | | | Sensor for outdoor heat exchanger temperature | | | |
| Safety devices | Item | 01 | High pressure switch | | | |
| | | 02 | Low pressure switch | | | |
| | | 03 | Fan driver overload protector | | | |
| | | 04 | Fuse | | | |
| | | 05 | Compressor motor thermal protector | | | |

Standard Accessories : Tie-wraps; Quantity : 2;

Standard Accessories : Installation manual; Quantity : 1;

Standard Accessories : General safety precautions; Quantity : 1;

Standard Accessories : Peel off F-gas label; Quantity : 1;

Standard Accessories : Refrigerant label for F-gas regulation; Quantity : 1;

| 2-10 Electrical Specifications | | | RZAG71NV1 | RZAG100NV1 | RZAG125NV1 | RZAG140NV1 |
|--------------------------------|----------------------------|--------|--------------------------------------|------------|------------|------------|
| Power supply | Name | V1 | | | | |
| | Phase | 1~ | | | | |
| | Frequency | Hz | 50 | | | |
| | Voltage | V | 220-240 | | | |
| Current - 50Hz | Maximum fuse amps (MFA) | A | 20 | 32 | | |
| Current | Zmax | List | Complies to EN61000-3-11 | | | |
| Wiring connections | For power supply | Remark | See installation manual outdoor unit | | | |
| | For connection with indoor | Remark | See installation manual outdoor unit | | | |
| Power supply intake | | | See installation manual outdoor unit | | | |

Notes

(1) According to ENER Lot 21

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1

RZAG-NY1

Symbols

- MCA: Minimum Circuit Ampere [A]
- TOCA: Total overcurrent amps [A]
- MFA: Maximum Fuse Ampere [A]
- MSC: Maximum current of the starting compressor [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full Load Ampere [A]
- KW: Fan motor rated output [kW]

Notes

1. The 'RLA' is based on the following conditions.
 - Cooling
 - Indoor temperature :27.0°C DB / -19.0°C WB
 - Outdoor temperature :35.0°C DB
 - Heating
 - Indoor temperature :20.0°C DB
 - Outdoor temperature :7.0°C DB / -6.0°C WB
2. 'TOCA' is the total value of each overcurrent set.
3. Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
4. The maximum allowable voltage that is unbalanced between phases is -2%.
5. 'MCA' is the maximum input current.
 - The capacity of the 'MFA' must be greater than that of the 'MCA'.
 - Select the 'MFA' according to the table.
6. Select the wire size according to the MCA.
7. 'MFA' is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D120943

RZAG-NV1

| Indoor | Outdoor | Power supply | Voltage range | | Compressor | | OFM | | IFM | | | | | | | |
|--------------|-----------------|--------------------|----------------|----------------|--------------------|----------------|----------------|------|----------|--------|-----|----------|--------|-----|----------|--------|
| | | | | | MCA | TOCA | MFA | MSC | RLA | kW | FLA | kW | FLA | | | |
| FCAHG71HVEB | RZAG71N7V1B | 50Hz ~ 220-240V | Minimum :198 V | Maximum :264 V | 17,7 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,091 | 0,7 | | | |
| FCAG35BVEB | x2 RZAG71N7V1B | | | | 17,6 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,044 x2 | 0,3 x2 | | | |
| FCAG71BVEB | RZAG71N7V1B | | | | 17,4 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,054 | 0,4 | | | |
| FFA35A2VEB | x2 RZAG71N7V1B | | | | 17,4 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,050 x2 | 0,2 x2 | | | |
| FBA35A2VEB | x2 RZAG71N7V1B | | | | 19,9 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,089 x2 | 1,4 x2 | | | |
| FBA71A2VEB | RZAG71N7V1B | | | | 18,3 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,070 | 1,3 | | | |
| FNA35A2VEB | x2 RZAG71N7V1B | | | | 18,0 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,034 x2 | 0,5 x2 | | | |
| FUA71AVEB | RZAG71N7V1B | | | | 17,9 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,046 | 0,9 | | | |
| FAA71AUEB | RZAG71N7V1B | | | | 17,5 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,048 | 0,5 | | | |
| FVA71AMVEB | RZAG71N7V1B | | | | 17,8 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,117 | 0,8 | | | |
| FDXM35F3V1B | x2 RZAG71N7V1B | | | | 17,6 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,034 x2 | 0,3 x2 | | | |
| FHA35AVEB | x2 RZAG71N7V1B | | | | 18,2 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,060 x2 | 0,6 x2 | | | |
| FHA71AVEB | RZAG71N7V1B | | | | 17,8 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,091 | 0,8 | | | |
| FCAHG100HVEB | RZAG100N7V1B | | | | 50Hz ~ 220-240V | Minimum :198 V | Maximum :264 V | 22,2 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,221 | 1,3 |
| FCAG35BVEB | x3 RZAG100N7V1B | | | | | | | 21,7 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,044 x3 | 0,3 x3 |
| FCAG50BVEB | x2 RZAG100N7V1B | | | | | | | 21,4 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,039 x2 | 0,3 x2 |
| FCAG100BVEB | RZAG100N7V1B | 21,5 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,117 | 0,7 | | | |
| FFA35A2VEB | x3 RZAG100N7V1B | 21,4 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,050 x3 | 0,2 x3 | | | |
| FFA50A2VEB | x2 RZAG100N7V1B | 21,6 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,050 x2 | 0,4 x2 | | | |
| FBA35A2VEB | x3 RZAG100N7V1B | 25,2 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,089 x3 | 1,4 x3 | | | |
| FBA50A2VEB | x2 RZAG100N7V1B | 23,7 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,089 x2 | 1,4 x2 | | | |
| FBA100A2VEB | RZAG100N7V1B | 24,4 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,127 | 3,5 | | | |
| FNA35A2VEB | x3 RZAG100N7V1B | 22,4 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,034 x3 | 0,5 x3 | | | |
| FNA50A2VEB | x2 RZAG100N7V1B | 21,8 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,060 x2 | 0,5 x2 | | | |
| FUA100AVEB | RZAG100N7V1B | 22,2 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,106 | 1,3 | | | |
| FAA100AUEB | RZAG100N7V1B | 21,3 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,064 | 0,5 | | | |
| FVA100AMVEB | RZAG100N7V1B | 22,4 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,238 | 1,5 | | | |
| FDXM35F3V1B | x3 RZAG100N7V1B | 21,7 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,034 x3 | 0,3 x3 | | | |
| FDXM50F3V1B | x2 RZAG100N7V1B | 22,7 | — | 32 | | | | — | 18,8 | 0,234 | 1,2 | 0,060 x2 | 0,9 x2 | | | |
| FHA35AVEB | x3 RZAG100N7V1B | 22,7 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,060 x3 | 0,6 x3 | | | | | | |
| FHA50AVEB | x2 RZAG100N7V1B | 22,0 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,060 x2 | 0,6 x2 | | | | | | |
| FHA100AVEB | RZAG100N7V1B | 22,2 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,150 | 1,3 | | | | | | |

3D120943

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1

| Indoor | Outdoor | Power supply | Voltage range | | Compressor | | | | | OFM | | IFM | | |
|-------------|-----------------|-----------------|-----------------|-----------------|----------------|------|------|-------|------|----------|--------|----------|----------|--------|
| | | | | | MCA | TOCA | MFA | MSC | RLA | kW | FLA | kW | FLA | |
| FCAG125HVEB | RZAG125N7V1B | 50Hz ~ 220-240V | Minimum: ~198 V | Maximum: 264 V | 27.5 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.244 | 1.4 | |
| FCAG358VEB | x4 RZAG125N7V1B | | | | 27.2 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.044 x4 | 0.3 x4 | |
| FCAG508VEB | x3 RZAG125N7V1B | | | | 26.9 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.039 x3 | 0.3 x3 | |
| FCAG608VEB | x2 RZAG125N7V1B | | | | 26.6 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.044 x2 | 0.3 x2 | |
| FCAG125HVEB | RZAG125N7V1B | | | | 27.0 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.168 | 1.0 | |
| FFA35A2VEB | x4 RZAG125N7V1B | | | | 26.8 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.050 x4 | 0.2 x4 | |
| FFA50A2VEB | x3 RZAG125N7V1B | | | | 27.2 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.050 x3 | 0.4 x3 | |
| FFA60A2VEB | x2 RZAG125N7V1B | | | | 27.2 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.050 x2 | 0.6 x2 | |
| FBA35A2VEB | x4 RZAG125N7V1B | | | | 31.8 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.089 x4 | 1.4 x4 | |
| FBA50A2VEB | x3 RZAG125N7V1B | | | | 30.4 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.089 x3 | 1.4 x3 | |
| FBA60A2VEB | x2 RZAG125N7V1B | | | | 28.7 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.070 x2 | 1.3 x2 | |
| FBA125A2VEB | RZAG125N7V1B | | | | 30.1 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.187 | 3.9 | |
| FNA35A2VEB | x4 RZAG125N7V1B | | | | 28.1 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.034 x4 | 0.5 x4 | |
| FNA50A2VEB | x3 RZAG125N7V1B | | | | 27.6 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.060 x3 | 0.5 x3 | |
| FNA60A2VEB | x2 RZAG125N7V1B | | | | 27.2 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.060 x2 | 0.6 x2 | |
| FUA125AVEB | RZAG125N7V1B | | | | 27.5 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.106 | 1.4 | |
| FDA125AVEB | RZAG125N7V1B | | 28.2 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.350 | 2.1 | | | |
| FVA125AMVEB | RZAG125N7V1B | | 27.6 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.238 | 1.5 | | | |
| FDXM35F3V1B | x4 RZAG125N7V1B | | 27.2 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.034 x4 | 0.3 x4 | | | |
| FDXM50F3V1B | x3 RZAG125N7V1B | | 28.8 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.060 x3 | 0.9 x3 | | | |
| FDXM60F3V1B | x2 RZAG125N7V1B | | 27.9 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.060 x2 | 0.9 x2 | | | |
| FHA35AVEB | x4 RZAG125N7V1B | | 28.5 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.060 x4 | 0.6 x4 | | | |
| FHA50AVEB | x3 RZAG125N7V1B | | 27.9 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.060 x3 | 0.6 x3 | | | |
| FHA60AVEB | x2 RZAG125N7V1B | | 27.2 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.091 x2 | 0.6 x2 | | | |
| FHA125AVEB | RZAG125N7V1B | | 27.6 | -- | 32 | -- | 23.8 | 0.234 | 1.2 | 0.150 | 1.5 | | | |
| FCAG71HVEB | RZAG140N7V1B | | 50Hz ~ 220-240V | Minimum: ~198 V | Maximum: 264 V | 27.5 | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.091 x2 | 0.7 x2 |
| FCAG140HVEB | RZAG140N7V1B | | | | | 27.5 | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.244 | 1.4 |
| FCAG358VEB | x4 RZAG140N7V1B | | | | | 27.2 | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.044 x4 | 0.3 x4 |
| FCAG508VEB | x3 RZAG140N7V1B | | | | | 26.9 | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.039 x3 | 0.3 x3 |
| FCAG71BVEB | x2 RZAG140N7V1B | | | | | 26.8 | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.054 x2 | 0.4 x2 |
| FCAG140HVEB | RZAG140N7V1B | | | | | 27.4 | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.168 | 1.3 |
| FFA35A2VEB | x4 RZAG140N7V1B | | | | | 26.8 | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.050 x4 | 0.2 x4 |
| FFA50A2VEB | x3 RZAG140N7V1B | 27.2 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.050 x3 | 0.4 x3 | |
| FBA35A2VEB | x4 RZAG140N7V1B | 31.8 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.089 x4 | 1.4 x4 | |
| FBA50A2VEB | x3 RZAG140N7V1B | 30.4 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.089 x3 | 1.4 x3 | |
| FBA71A2VEB | x2 RZAG140N7V1B | 28.7 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.070 x2 | 1.3 x2 | |
| FBA140A2VEB | RZAG140N7V1B | 30.1 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.187 | 3.9 | |
| FNA35A2VEB | x4 RZAG140N7V1B | 28.1 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.034 x4 | 0.5 x4 | |
| FNA50A2VEB | x3 RZAG140N7V1B | 27.6 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.060 x3 | 0.5 x3 | |
| FUA71AVEB | x2 RZAG140N7V1B | 27.9 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.046 x2 | 0.9 x2 | |
| FAA71A1AVEB | x2 RZAG140N7V1B | 27.0 | | | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.048 x2 | 0.5 x2 | |
| FVA71AMVEB | x2 RZAG140N7V1B | 27.7 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.117 x2 | 0.8 x2 | | | |
| FVA140AMVEB | RZAG140N7V1B | 27.9 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.276 | 1.8 | | | |
| FDXM35F3V1B | x4 RZAG140N7V1B | 27.2 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.034 x4 | 0.3 x4 | | | |
| FDXM50F3V1B | x3 RZAG140N7V1B | 28.8 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.060 x3 | 0.9 x3 | | | |
| FHA35AVEB | x4 RZAG140N7V1B | 28.5 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.060 x4 | 0.6 x4 | | | |
| FHA50AVEB | x3 RZAG140N7V1B | 27.9 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.060 x3 | 0.6 x3 | | | |
| FHA71AVEB | x2 RZAG140N7V1B | 27.7 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.091 x2 | 0.8 x2 | | | |
| FHA140AVEB | RZAG140N7V1B | 27.9 | | -- | 32 | -- | 23.6 | 0.234 | 1.4 | 0.150 | 1.8 | | | |

3D120943

RZAG-NY1

| Indoor | Outdoor | Power supply | Voltage range | | Compressor | | | | | OFM | | IFM | | |
|-------------|-----------------|----------------------|----------------------|-----------------|-----------------|------|-------|-------|----------|----------|--------|----------|----------|--------|
| | | | | | MCA | TOCA | MFA | MSC | RLA | kW | FLA | kW | FLA | |
| FCAG71HVEB | RZAG71N7Y1B | 3N~ 50Hz 380-415V | Minimum: ~342 V | Maximum: ~457 V | 11.1 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.091 | 0.7 | |
| FCAG358VEB | x2 RZAG71N7Y1B | | | | 11.0 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.044 x2 | 0.3 x2 | |
| FCAG71BVEB | RZAG71N7Y1B | | | | 10.8 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.054 | 0.4 | |
| FFA35A2VEB | x2 RZAG71N7Y1B | | | | 10.8 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.050 x2 | 0.2 x2 | |
| FBA35A2VEB | x2 RZAG71N7Y1B | | | | (10.4)* | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.089 x2 | 1.4 x2 | |
| FBA71A2VEB | RZAG71N7Y1B | | | | (10.4)* | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.070 | 1.3 | |
| FNA35A2VEB | x2 RZAG71N7Y1B | | | | 11.4 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.034 x2 | 0.5 x2 | |
| FUA71AVEB | RZAG71N7Y1B | | | | 11.3 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.046 | 0.9 | |
| FAA71A1AVEB | RZAG71N7Y1B | | 10.9 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.048 | 0.5 | | | |
| FVA71AMVEB | RZAG71N7Y1B | | 11.2 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.117 | 0.8 | | | |
| FDXM35F3V1B | x2 RZAG71N7Y1B | | 11.0 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.034 x2 | 0.3 x2 | | | |
| FHA35AVEB | x2 RZAG71N7Y1B | | 11.6 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.060 x2 | 0.6 x2 | | | |
| FHA71AVEB | RZAG71N7Y1B | | 11.2 | -- | 16 | -- | 9.2 | 0.234 | 0.8 | 0.091 | 0.8 | | | |
| FCAG100HVEB | RZAG100N7Y1B | | 3N~ 50Hz 380-415V | Minimum: ~342 V | Maximum: ~457 V | 14.9 | -- | 16 | -- | 11.8 | 0.234 | 1.2 | 0.221 | 1.3 |
| FCAG358VEB | x3 RZAG100N7Y1B | | | | | 13.0 | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.044 x3 | 0.3 x3 |
| FCAG508VEB | x2 RZAG100N7Y1B | | | | | 12.7 | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.039 x2 | 0.3 x2 |
| FCAG100BVEB | RZAG100N7Y1B | 14.2 | | | | -- | 16 | -- | 11.8 | 0.234 | 1.2 | 0.117 | 0.7 | |
| FFA35A2VEB | x3 RZAG100N7Y1B | 12.7 | | | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.050 x3 | 0.2 x3 | |
| FFA50A2VEB | x2 RZAG100N7Y1B | 12.9 | | | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.050 x2 | 0.4 x2 | |
| FBA35A2VEB | x3 RZAG100N7Y1B | (12.1)* | | | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.089 x3 | 1.4 x3 | |
| FBA50A2VEB | x2 RZAG100N7Y1B | (12.1)* | | | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.089 x2 | 1.4 x2 | |
| FBA100A2VEB | RZAG100N7Y1B | (13.5)* | | -- | 16 | -- | 11.8 | 0.234 | 1.2 | 0.127 | 3.5 | | | |
| FNA35A2VEB | x3 RZAG100N7Y1B | 13.6 | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.034 x3 | 0.5 x3 | | | |
| FNA50A2VEB | x2 RZAG100N7Y1B | 13.1 | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.060 x2 | 0.5 x2 | | | |
| FUA100AVEB | RZAG100N7Y1B | 14.9 | | -- | 16 | -- | 11.8 | 0.234 | 1.2 | 0.106 | 1.3 | | | |
| FAA100AVEB | RZAG100N7Y1B | 14.0 | | -- | 16 | -- | 11.8 | 0.234 | 1.2 | 0.064 | 0.5 | | | |
| FVA100AMVEB | RZAG100N7Y1B | 15.1 | | -- | 16 | -- | 11.8 | 0.234 | 1.2 | 0.238 | 1.5 | | | |
| FDXM35F3V1B | x3 RZAG100N7Y1B | 13.0 | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.034 x3 | 0.3 x3 | | | |
| FDXM50F3V1B | x2 RZAG100N7Y1B | 13.9 | | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.060 x2 | 0.9 x2 | | | |
| FHA35AVEB | x3 RZAG100N7Y1B | 13.9 | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.060 x3 | 0.6 x3 | | | | |
| FHA50AVEB | x2 RZAG100N7Y1B | 13.3 | -- | 16 | -- | 10.4 | 0.234 | 1.2 | 0.060 x2 | 0.6 x2 | | | | |
| FHA100AVEB | RZAG100N7Y1B | 14.9 | -- | 16 | -- | 11.8 | 0.234 | 1.2 | 0.150 | 1.3 | | | | |

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the outdoor unit. For the MCA of the indoor unit, see the installation manual of the indoor unit.

3D120943

3 Electrical data

3 - 1 Electrical Data

RZAG-NY1

| Indoor | Outdoor | Power supply | Voltage range | MCA | TOCA | MFA | Compressor | | OFM | | IFM | |
|--------------|-----------------|----------------------|--|---------|------|------|------------|------|----------|--------|----------|--------|
| | | | | | | | MSC | RLA | kW | FLA | kW | FLA |
| FCAG125HVEB | RZAG125N7Y1B | 3N~ 50Hz 380-415V | Minimum: -34.2 V. Maximum: -45.7 V. | 15.0 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.244 | 1.4 |
| FCAG35BVEB | x4 RZAG125N7Y1B | | | 12.2 | — | 16 | — | 9.3 | 0.234 | 1.2 | 0.044 x4 | 0.3 x4 |
| FCAG50BVEB | x3 RZAG125N7Y1B | | | 12.9 | — | 16 | — | 10.3 | 0.234 | 1.2 | 0.039 x3 | 0.3 x3 |
| FCAG60BVEB | x2 RZAG125N7Y1B | | | 14.1 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.044 x2 | 0.3 x2 |
| FCAG125BVEB | RZAG125N7Y1B | | | 14.6 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.168 | 1.0 |
| FFA35A2VEB | x4 RZAG125N7Y1B | | | 11.8 | — | 16 | — | 9.3 | 0.234 | 1.2 | 0.050 x4 | 0.2 x4 |
| FFA50A2VEB | x3 RZAG125N7Y1B | | | 13.2 | — | 16 | — | 10.3 | 0.234 | 1.2 | 0.050 x3 | 0.4 x3 |
| FFA60A2VEB | x2 RZAG125N7Y1B | | | 14.8 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.050 x2 | 0.6 x2 |
| FBA35A2VEB | x4 RZAG125N7Y1B | | | (10.9)* | — | 16 | — | 9.3 | 0.234 | 1.2 | 0.089 x4 | 1.4 x4 |
| FBA50A2VEB | x3 RZAG125N7Y1B | | | (12.0)* | — | 16 | — | 10.3 | 0.234 | 1.2 | 0.089 x3 | 1.4 x3 |
| FBA60A2VEB | x2 RZAG125N7Y1B | | | (13.5)* | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.070 x2 | 1.3 x2 |
| FBA125A2VEB | RZAG125N7Y1B | | | (13.5)* | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.187 | 3.9 |
| FNA35A2VEB | x4 RZAG125N7Y1B | | | 13.0 | — | 16 | — | 9.3 | 0.234 | 1.2 | 0.034 x4 | 0.5 x4 |
| FNA50A2VEB | x3 RZAG125N7Y1B | | | 13.5 | — | 16 | — | 10.3 | 0.234 | 1.2 | 0.060 x3 | 0.5 x3 |
| FNA60A2VEB | x2 RZAG125N7Y1B | | | 14.8 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.060 x2 | 0.6 x2 |
| FUA125AVEB | RZAG125N7Y1B | | | 15.0 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.106 | 1.4 |
| FDA125AVEB | RZAG125N7Y1B | | | 15.7 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.350 | 2.1 |
| FVA125AMVEB | RZAG125N7Y1B | | | 15.1 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.238 | 1.5 |
| FDXM35F3V1B | x4 RZAG125N7Y1B | | | 12.2 | — | 16 | — | 9.3 | 0.234 | 1.2 | 0.034 x4 | 0.3 x4 |
| FDXM50F3V1B | x3 RZAG125N7Y1B | | | 14.8 | — | 16 | — | 10.3 | 0.234 | 1.2 | 0.060 x3 | 0.9 x3 |
| FDXM60F3V1B | x2 RZAG125N7Y1B | | | 15.4 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.060 x2 | 0.9 x2 |
| FHA35AVEB | x4 RZAG125N7Y1B | | | 13.4 | — | 16 | — | 9.3 | 0.234 | 1.2 | 0.060 x4 | 0.6 x4 |
| FHA50AVEB | x3 RZAG125N7Y1B | | | 13.8 | — | 16 | — | 10.3 | 0.234 | 1.2 | 0.060 x3 | 0.6 x3 |
| FHA60AVEB | x2 RZAG125N7Y1B | | | 14.8 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.091 x2 | 0.6 x2 |
| FHA125AVEB | RZAG125N7Y1B | | | 15.1 | — | 16 | — | 11.8 | 0.234 | 1.2 | 0.150 | 1.5 |
| FCAGH71HVEB | x2 RZAG140N7Y1B | | | 15.0 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.091 x2 | 0.7 x2 |
| FCAGH140HVEB | RZAG140N7Y1B | | | 15.0 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.244 | 1.4 |
| FCAG35BVEB | x4 RZAG140N7Y1B | | | 12.2 | — | 16 | — | 9.1 | 0.234 | 1.4 | 0.044 x4 | 0.3 x4 |
| FCAG50BVEB | x3 RZAG140N7Y1B | | | 12.9 | — | 16 | — | 10.1 | 0.234 | 1.4 | 0.039 x3 | 0.3 x3 |
| FCAG71BVEB | x2 RZAG140N7Y1B | | | 14.4 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.054 x2 | 0.4 x2 |
| FCAG140BVEB | RZAG140N7Y1B | | | 14.9 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.168 | 1.3 |
| FBA35A2VEB | x4 RZAG140N7Y1B | | | 11.8 | — | 16 | — | 9.1 | 0.234 | 1.4 | 0.050 x4 | 0.2 x4 |
| FBA50A2VEB | x3 RZAG140N7Y1B | | | 13.2 | — | 16 | — | 10.1 | 0.234 | 1.4 | 0.050 x3 | 0.4 x3 |
| FBA60A2VEB | x2 RZAG140N7Y1B | | | (10.9)* | — | 16 | — | 9.1 | 0.234 | 1.4 | 0.089 x4 | 1.4 x4 |
| FBA125A2VEB | x3 RZAG140N7Y1B | | | (12.0)* | — | 16 | — | 10.1 | 0.234 | 1.4 | 0.089 x3 | 1.4 x3 |
| FBA71A2VEB | x2 RZAG140N7Y1B | | | (13.5)* | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.070 x2 | 1.3 x2 |
| FBA140A2VEB | RZAG140N7Y1B | | | (13.5)* | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.187 | 3.9 |
| FNA35A2VEB | x4 RZAG140N7Y1B | | | 13.0 | — | 16 | — | 9.1 | 0.234 | 1.4 | 0.034 x4 | 0.5 x4 |
| FNA50A2VEB | x3 RZAG140N7Y1B | | | 13.5 | — | 16 | — | 10.1 | 0.234 | 1.4 | 0.060 x3 | 0.5 x3 |
| FUA71AVEB | x2 RZAG140N7Y1B | | | 15.4 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.046 x2 | 0.9 x2 |
| FAA71AUVEB | x2 RZAG140N7Y1B | 14.6 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.048 x2 | 0.5 x2 | | |
| FVA71AMVEB | x2 RZAG140N7Y1B | 15.2 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.117 x2 | 0.8 x2 | | |
| FVA140AMVEB | RZAG140N7Y1B | 15.4 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.276 | 1.8 | | |
| FDXM35F3V1B | x4 RZAG140N7Y1B | 12.2 | — | 16 | — | 9.1 | 0.234 | 1.4 | 0.034 x4 | 0.3 x4 | | |
| FDXM50F3V1B | x3 RZAG140N7Y1B | 14.8 | — | 16 | — | 10.1 | 0.234 | 1.4 | 0.060 x3 | 0.9 x3 | | |
| FHA35AVEB | x4 RZAG140N7Y1B | 13.4 | — | 16 | — | 9.1 | 0.234 | 1.4 | 0.060 x4 | 0.6 x4 | | |
| FHA50AVEB | x3 RZAG140N7Y1B | 13.8 | — | 16 | — | 10.1 | 0.234 | 1.4 | 0.060 x3 | 0.6 x3 | | |
| FHA71AVEB | x2 RZAG140N7Y1B | 15.2 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.091 x2 | 0.8 x2 | | |
| FHA140AVEB | RZAG140N7Y1B | 15.4 | — | 16 | — | 11.6 | 0.234 | 1.4 | 0.150 | 1.8 | | |

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the outdoor unit. For the MCA of the indoor unit, see the installation manual of the indoor unit.

3D120943

RZAG-NV1 RZAG-NY1

Symbols

- MCA: Minimum Circuit Ampere [A]
- TOCA: Total overcurrent amps [A]
- MFA: Maximum Fuse Ampere [A]
- MSC: Maximum current of the starting compressor [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full Load Ampere [A]
- KW: Fan motor rated output [kW]

Notes

1. The ·RLA· is based on the following conditions.
 - Cooling
 - Indoor temperature ·27.0°C DB / ·19.0°C WB
 - Outdoor temperature ·35.0°C DB
 - Heating
 - Indoor temperature ·20.0°C DB
 - Outdoor temperature ·7.0°C DB / ·6.0°C WB
2. ·TOCA· is the total value of each overcurrent set.
3. Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
4. The maximum allowable voltage that is unbalanced between phases is ·2·%.
5. ·MCA· is the maximum input current.
 - The capacity of the ·MFA· must be greater than that of the ·MCA·.
 - Select the ·MFA· according to the table.
6. Select the wire size according to the MCA.
7. ·MFA· is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D120944

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1

| Indoor | Outdoor | Power supply | Voltage range | | MCA | TOCA | MFA | Compressor | | OFM | | IFM | |
|--------------|-----------------|-----------------|-----------------|----------------|------|------|-------|------------|----------|--------|-----|----------|--------|
| | | | | | | | | MSC | RLA | kW | FLA | kW | FLA |
| FCAHG100HVEB | RZAG71N7V1B | 50Hz ~ 220-240V | Minimum: -198 V | Maximum: 264 V | 18,3 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,221 | 1,3 |
| FCAG35BVEB | x3 RZAG71N7V1B | | | | 17,9 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,044 x3 | 0,3 x3 |
| FCAG50BVEB | x2 RZAG71N7V1B | | | | 17,6 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,039 x2 | 0,3 x2 |
| FCAG100BVEB | RZAG71N7V1B | | | | 17,7 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,117 | 0,7 |
| FFA35A2VEB | x3 RZAG71N7V1B | | | | 17,6 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,050 x3 | 0,2 x3 |
| FFA50A2VEB | x2 RZAG71N7V1B | | | | 17,8 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,050 x2 | 0,4 x2 |
| FBA35A2VEB | x3 RZAG71N7V1B | | | | 21,3 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,089 x3 | 1,4 x3 |
| FBA50A2VEB | x2 RZAG71N7V1B | | | | 19,9 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,089 x2 | 1,4 x2 |
| FBA100A2VEB | RZAG71N7V1B | | | | 20,6 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,127 | 3,5 |
| FUA100AVEB | RZAG71N7V1B | | | | 18,3 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,106 | 1,3 |
| FAA100AVEB | RZAG71N7V1B | | | | 17,5 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,064 | 0,5 |
| FVA100AMVEB | RZAG71N7V1B | | | | 18,5 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,238 | 1,5 |
| FDXM35F3V1B | x3 RZAG71N7V1B | | | | 17,9 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,034 x3 | 0,3 x3 |
| FDXM50F3V1B | x2 RZAG71N7V1B | | | | 18,8 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,060 x2 | 0,9 x2 |
| FHA35AVEB | x3 RZAG71N7V1B | | | | 18,8 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,060 x3 | 0,6 x3 |
| FHA50AVEB | x2 RZAG71N7V1B | | | | 18,2 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,060 x2 | 0,6 x2 |
| FHA100AVEB | RZAG71N7V1B | | | | 18,3 | — | 20 | — | 15,5 | 0,234 | 0,8 | 0,15 | 1,3 |
| FCAHG71HVEB | x2 RZAG100N7V1B | | | | 22,3 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,091 x2 | 0,7 x2 |
| FCAHG140HVEB | RZAG100N7V1B | | | | 22,3 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,244 | 1,4 |
| FCAG35BVEB | x4 RZAG100N7V1B | | | | 22,0 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,044 x4 | 0,3 x4 |
| FCAG50BVEB | x3 RZAG100N7V1B | 21,7 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,039 x3 | 0,3 x3 | | | |
| FCAG71BVEB | x2 RZAG100N7V1B | 21,6 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,054 x2 | 0,4 x2 | | | |
| FCAG140BVEB | RZAG100N7V1B | 22,2 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,168 | 1,3 | | | |
| FFA35A2VEB | x4 RZAG100N7V1B | 21,6 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,050 x4 | 0,8 | | | |
| FFA50A2VEB | x3 RZAG100N7V1B | 22,0 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,050 x3 | 0,4 x3 | | | |
| FBA35A2VEB | x4 RZAG100N7V1B | 26,6 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,089 x4 | 1,4 x4 | | | |
| FBA50A2VEB | x3 RZAG100N7V1B | 25,2 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,089 x3 | 1,4 x3 | | | |
| FBA71A2VEB | x2 RZAG100N7V1B | 23,5 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,07 x2 | 1,3 x2 | | | |
| FBA140A2VEB | RZAG100N7V1B | 24,9 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,187 | 3,9 | | | |
| FUA71AVEB | x2 RZAG100N7V1B | 22,7 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,046 x2 | 0,9 x2 | | | |
| FAA71AUVEB | x2 RZAG100N7V1B | 21,8 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,048 x2 | 0,5 x2 | | | |
| FVA140AMVEB | RZAG100N7V1B | 22,7 | — | 32 | — | 18,8 | 0,234 | 1,2 | 0,276 | 1,8 | | | |
| FDXM35F3V1B | x4 RZAG100N7V1B | 22,0 | — | 32 | — | 18,8 | 0,234 | 1,19523 | 0,034 x4 | 0,3 x4 | | | |
| FDXM50F3V1B | x3 RZAG100N7V1B | 23,6 | — | 32 | — | 18,8 | 0,234 | 1,19523 | 0,060 x3 | 0,9 x3 | | | |
| FHA35AVEB | x4 RZAG100N7V1B | 23,3 | — | 32 | — | 18,8 | 0,234 | 1,19523 | 0,060 x4 | 0,6 x4 | | | |
| FHA50AVEB | x3 RZAG100N7V1B | 22,7 | — | 32 | — | 18,8 | 0,234 | 1,19523 | 0,060 x3 | 0,6 x3 | | | |
| FHA71AVEB | x2 RZAG100N7V1B | 22,5 | — | 32 | — | 18,8 | 0,234 | 1,19523 | 0,091 x2 | 0,8 x2 | | | |
| FHA140AVEB | RZAG100N7V1B | 22,7 | — | 32 | — | 18,8 | 0,234 | 1,19523 | 0,15 | 1,8 | | | |

3D120944

RZAG-NV1

| Indoor | Outdoor | Power supply | Voltage range | | MCA | TOCA | MFA | Compressor | | OFM | | IFM | |
|--------------|-----------------|-----------------|-----------------|----------------|------|------|-------|------------|----------|--------|-----|----------|--------|
| | | | | | | | | MSC | RLA | kW | FLA | kW | FLA |
| FCAHG71HVEB | x2 RZAG125N7V1B | 50Hz ~ 220-240V | Minimum: -198 V | Maximum: 264 V | 27,5 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,091 x2 | 0,7 x2 |
| FCAHG140HVEB | RZAG125N7V1B | | | | 27,5 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,244 | 1,4 |
| FCAG35BVEB | x4 RZAG125N7V1B | | | | 27,2 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,044 x4 | 0,3 x4 |
| FCAG50BVEB | x3 RZAG125N7V1B | | | | 26,9 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,039 x3 | 0,3 x3 |
| FCAG71BVEB | x2 RZAG125N7V1B | | | | 26,8 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,054 x2 | 0,4 x2 |
| FCAG140BVEB | RZAG125N7V1B | | | | 27,4 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,168 | 1,3 |
| FFA35A2VEB | x4 RZAG125N7V1B | | | | 26,8 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,050 x4 | 0,2 x4 |
| FFA50A2VEB | x3 RZAG125N7V1B | | | | 27,2 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,050 x3 | 0,4 x3 |
| FBA35A2VEB | x4 RZAG125N7V1B | | | | 31,8 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,089 x4 | 1,4 x4 |
| FBA50A2VEB | x3 RZAG125N7V1B | | | | 30,4 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,089 x3 | 1,4 x3 |
| FBA71A2VEB | x2 RZAG125N7V1B | | | | 28,7 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,07 x2 | 1,3 x2 |
| FBA140A2VEB | RZAG125N7V1B | | | | 30,1 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,187 | 3,9 |
| FUA71AVEB | x2 RZAG125N7V1B | | | | 27,9 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,046 x2 | 0,9 x2 |
| FAA71AUVEB | x2 RZAG125N7V1B | | | | 27,0 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,048 x2 | 0,5 x2 |
| FVA140AMVEB | RZAG125N7V1B | | | | 27,9 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,276 | 1,8 |
| FDXM35F3V1B | x4 RZAG125N7V1B | | | | 27,2 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,034 x4 | 0,3 x4 |
| FDXM50F3V1B | x3 RZAG125N7V1B | | | | 28,8 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,060 x3 | 0,9 x3 |
| FHA35AVEB | x4 RZAG125N7V1B | | | | 28,5 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,060 x4 | 0,6 x4 |
| FHA50AVEB | x3 RZAG125N7V1B | | | | 27,9 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,060 x3 | 0,6 x3 |
| FHA71AVEB | x2 RZAG125N7V1B | | | | 27,7 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,091 x2 | 0,8 x2 |
| FHA140AVEB | RZAG125N7V1B | 27,9 | — | 32 | — | 23,8 | 0,234 | 1,2 | 0,15 | 1,8 | | | |
| FCAHG71HVEB | x2 RZAG140N7V1B | 27,5 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,091 x2 | 0,7 x2 | | | |
| FCAHG140HVEB | RZAG140N7V1B | 27,5 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,244 | 1,4 | | | |
| FCAG35BVEB | x4 RZAG140N7V1B | 27,2 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,044 x4 | 0,3 x4 | | | |
| FCAG50BVEB | x3 RZAG140N7V1B | 26,9 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,039 x3 | 0,3 x3 | | | |
| FCAG71BVEB | x2 RZAG140N7V1B | 26,8 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,054 x2 | 0,4 x2 | | | |
| FCAG140BVEB | RZAG140N7V1B | 27,4 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,168 | 1,3 | | | |
| FFA35A2VEB | x4 RZAG140N7V1B | 26,8 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,050 x4 | 0,2 x4 | | | |
| FFA50A2VEB | x3 RZAG140N7V1B | 27,2 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,050 x3 | 0,4 x3 | | | |
| FBA35A2VEB | x4 RZAG140N7V1B | 31,8 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,089 x4 | 1,4 x4 | | | |
| FBA50A2VEB | x3 RZAG140N7V1B | 30,4 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,089 x3 | 1,4 x3 | | | |
| FBA71A2VEB | x2 RZAG140N7V1B | 28,7 | — | 32 | — | 23,6 | 0,234 | 1,4 | 0,07 x2 | 1,3 x2 | | | |
| FBA140A2VEB | RZAG140N7V1B | 30,1 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,187 | 3,9 | | | |
| FUA71AVEB | x2 RZAG140N7V1B | 27,9 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,046 x2 | 0,9 x2 | | | |
| FAA71AUVEB | x2 RZAG140N7V1B | 27,0 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,048 x2 | 0,5 x2 | | | |
| FVA140AMVEB | RZAG140N7V1B | 27,9 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,276 | 1,8 | | | |
| FDXM35F3V1B | x4 RZAG140N7V1B | 27,2 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,034 x4 | 0,3 x4 | | | |
| FDXM50F3V1B | x3 RZAG140N7V1B | 28,8 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,060 x3 | 0,9 x3 | | | |
| FHA35AVEB | x4 RZAG140N7V1B | 28,5 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,060 x4 | 0,6 x4 | | | |
| FHA50AVEB | x3 RZAG140N7V1B | 27,9 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,060 x3 | 0,6 x3 | | | |
| FHA71AVEB | x2 RZAG140N7V1B | 27,7 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,091 x2 | 0,8 x2 | | | |
| FHA140AVEB | RZAG140N7V1B | 27,9 | — | 32 | — | 23,6 | 0,234 | 1,41271 | 0,15 | 1,8 | | | |

3D120944

3 Electrical data

3 - 1 Electrical Data

RZAG-NY1

| Indoor | Outdoor | Power supply | Voltage range | | Compressor | | | OFM | | IFM | | | | | | |
|-------------|---------|----------------------|--------------------------------------|----|----------------------|--------------------------------------|-------|---------|------|-------|---------|----------|--------|-----|----------|--------|
| | | | | | MCA | TOCA | MFA | MSC | RLA | kW | FLA | kW | FLA | | | |
| FCAG100HVEB | | 3N~ 50Hz 380-415V | Minimum: -342 V. Maximum: -456 V. | | 11,8 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,221 | 1,3 | | | |
| FCAG35BVEB | x3 | | | | 11,3 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,044 x3 | 0,3 x3 | | | |
| FCAG50BVEB | x2 | | | | 11,0 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,039 x2 | 0,3 x2 | | | |
| FCAG100BVEB | | | | | 11,1 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,117 | 0,7 | | | |
| FFA35A2VEB | x3 | | | | 11,0 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,050 x3 | 0,2 x3 | | | |
| FFA50A2VEB | x2 | | | | 11,2 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,050 x2 | 0,4 x2 | | | |
| FBA35A2VEB | x3 | | | | (10,4)* | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,089 x3 | 1,4 x3 | | | |
| FBA50A2VEB | x2 | | | | (10,4)* | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,089 x2 | 1,4 x2 | | | |
| FBA100A2VEB | | | | | (10,4)* | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,127 | 3,5 | | | |
| FUA100AVEB | | | | | 11,8 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,106 | 1,3 | | | |
| FAA100AVEB | | | | | 10,9 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,064 | 0,5 | | | |
| FVA100AMVEB | | | | | 12,0 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,238 | 1,5 | | | |
| FDXM35F3V1B | x3 | | | | 11,3 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,034 x3 | 0,3 x3 | | | |
| FDXM50F3V1B | x2 | | | | 12,3 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,060 x2 | 0,9 x2 | | | |
| FHA35AVEB | x3 | | | | 12,3 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,060 x3 | 0,6 x3 | | | |
| FHA50AVEB | x2 | | | | 11,6 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,060 x2 | 0,6 x2 | | | |
| FHA100AVEB | | | | | 11,8 | — | 16 | — | 9,2 | 0,234 | 0,8 | 0,15 | 1,3 | | | |
| FCAG71HVEB | x2 | | | | 3N~ 50Hz 380-415V | Minimum: -342 V. Maximum: -456 V. | | 13,5 | — | 16 | — | 10,4 | 0,234 | 1,2 | 0,091 x2 | 0,7 x2 |
| FCAG140HVEB | | | | | | | | 15,0 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,244 | 1,4 |
| FCAG35BVEB | x4 | | | | | | | 13,3 | — | 16 | — | 10,4 | 0,234 | 1,2 | 0,044 x4 | 0,3 x4 |
| FCAG50BVEB | x3 | 13,0 | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,039 x3 | 0,3 x3 | | | |
| FCAG71BVEB | x2 | 12,9 | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,054 x2 | 0,4 x2 | | | |
| FCAG140BVEB | | 14,9 | — | 16 | | | | — | 11,8 | 0,234 | 1,2 | 0,168 | 1,3 | | | |
| FFA35A2VEB | x4 | 12,9 | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,050 x4 | 0,8 | | | |
| FFA50A2VEB | x3 | 13,3 | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,050 x3 | 0,4 x3 | | | |
| FBA35A2VEB | x4 | (12,1)* | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,089 x4 | 1,4 x4 | | | |
| FBA50A2VEB | x3 | (12,1)* | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,089 x3 | 1,4 x3 | | | |
| FBA71A2VEB | x2 | (12,1)* | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,07 x2 | 1,3 x2 | | | |
| FBA140A2VEB | | (13,5)* | — | 16 | | | | — | 11,8 | 0,234 | 1,2 | 0,187 | 3,9 | | | |
| FUA71AVEB | x2 | 13,9 | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,046 x2 | 0,9 x2 | | | |
| FAA71AVEB | x2 | 13,1 | — | 16 | | | | — | 10,4 | 0,234 | 1,2 | 0,048 x2 | 0,5 x2 | | | |
| FVA140AMVEB | | 15,4 | — | 16 | | | | — | 11,8 | 0,234 | 1,2 | 0,276 | 1,8 | | | |
| FDXM35F3V1B | x4 | 13,3 | — | 16 | | | | — | 10,4 | 0,234 | 1,19523 | 0,034 x4 | 0,3 x4 | | | |
| FDXM50F3V1B | x3 | 14,9 | — | 16 | | | | — | 10,4 | 0,234 | 1,19523 | 0,060 x3 | 0,9 x3 | | | |
| FHA35AVEB | x4 | 14,6 | — | 16 | | | | — | 10,4 | 0,234 | 1,19523 | 0,060 x4 | 0,6 x4 | | | |
| FHA50AVEB | x3 | 13,9 | — | 16 | | | | — | 10,4 | 0,234 | 1,19523 | 0,060 x3 | 0,6 x3 | | | |
| FHA71AVEB | x2 | 13,7 | — | 16 | | | | — | 10,4 | 0,234 | 1,19523 | 0,091 x2 | 0,8 x2 | | | |
| FHA140AVEB | | 15,4 | — | 16 | — | 11,8 | 0,234 | 1,19523 | 0,15 | 1,8 | | | | | | |

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the indoor unit. For the actual MCA value, see the installation manual of the indoor unit.

3D120944

RZAG-NV1

| Indoor | Outdoor | Power supply | Voltage range | | Compressor | | | OFM | | IFM | | | |
|-------------|---------|----------------------|--------------------------------------|----|------------|------|-------|---------|------|-------|---------|----------|--------|
| | | | | | MCA | TOCA | MFA | MSC | RLA | kW | FLA | kW | FLA |
| FCAG71HVEB | x2 | 3N~ 50Hz 380-415V | Minimum: -342 V. Maximum: -456 V. | | 15,0 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,091 x2 | 0,7 x2 |
| FCAG140HVEB | | | | | 15,0 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,244 | 1,4 |
| FCAG35BVEB | x4 | | | | 12,2 | — | 16 | — | 9,3 | 0,234 | 1,2 | 0,044 x4 | 0,3 x4 |
| FCAG50BVEB | x3 | | | | 12,9 | — | 16 | — | 10,3 | 0,234 | 1,2 | 0,039 x3 | 0,3 x3 |
| FCAG71BVEB | x2 | | | | 14,4 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,054 x2 | 0,4 x2 |
| FCAG140BVEB | | | | | 14,9 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,168 | 1,3 |
| FFA35A2VEB | x4 | | | | 11,8 | — | 16 | — | 9,3 | 0,234 | 1,2 | 0,050 x4 | 0,2 x4 |
| FFA50A2VEB | x3 | | | | 13,2 | — | 16 | — | 10,3 | 0,234 | 1,2 | 0,050 x3 | 0,4 x3 |
| FBA35A2VEB | x4 | | | | (10,9)* | — | 16 | — | 9,3 | 0,234 | 1,2 | 0,089 x4 | 1,4 x4 |
| FBA50A2VEB | x3 | | | | (12,0)* | — | 16 | — | 10,3 | 0,234 | 1,2 | 0,089 x3 | 1,4 x3 |
| FBA71A2VEB | x2 | | | | (13,5)* | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,07 x2 | 1,3 x2 |
| FBA140A2VEB | | | | | (13,5)* | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,187 | 3,9 |
| FUA71AVEB | x2 | | | | 15,4 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,046 x2 | 0,9 x2 |
| FAA71AVEB | x2 | | | | 14,6 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,048 x2 | 0,5 x2 |
| FVA140AMVEB | | | | | 15,4 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,276 | 1,8 |
| FDXM35F3V1B | x4 | | | | 12,2 | — | 16 | — | 9,3 | 0,234 | 1,2 | 0,034 x4 | 0,3 x4 |
| FDXM50F3V1B | x3 | | | | 14,8 | — | 16 | — | 10,3 | 0,234 | 1,2 | 0,060 x3 | 0,9 x3 |
| FHA35AVEB | x4 | | | | 13,4 | — | 16 | — | 9,3 | 0,234 | 1,2 | 0,060 x4 | 0,6 x4 |
| FHA50AVEB | x3 | | | | 13,8 | — | 16 | — | 10,3 | 0,234 | 1,2 | 0,060 x3 | 0,6 x3 |
| FHA71AVEB | x2 | | | | 15,2 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,091 x2 | 0,8 x2 |
| FHA140AVEB | | 15,4 | — | 16 | — | 11,8 | 0,234 | 1,2 | 0,15 | 1,8 | | | |
| FCAG71HVEB | x2 | 3N~ 50Hz 380-415V | Minimum: -342 V. Maximum: -456 V. | | 15,0 | — | 16 | — | 11,6 | 0,234 | 1,4 | 0,091 x2 | 0,7 x2 |
| FCAG140HVEB | | | | | 15,0 | — | 16 | — | 11,6 | 0,234 | 1,4 | 0,244 | 1,4 |
| FCAG35BVEB | x4 | | | | 12,2 | — | 16 | — | 9,1 | 0,234 | 1,4 | 0,044 x4 | 0,3 x4 |
| FCAG50BVEB | x3 | | | | 12,9 | — | 16 | — | 10,1 | 0,234 | 1,4 | 0,039 x3 | 0,3 x3 |
| FCAG71BVEB | x2 | | | | 14,4 | — | 16 | — | 11,6 | 0,234 | 1,4 | 0,054 x2 | 0,4 x2 |
| FCAG140BVEB | | | | | 14,9 | — | 16 | — | 11,6 | 0,234 | 1,4 | 0,168 | 1,3 |
| FFA35A2VEB | x4 | | | | 11,4 | — | 16 | — | 9,1 | 0,234 | 1,4 | 0,050 x4 | 0,2 x4 |
| FFA50A2VEB | x3 | | | | 13,2 | — | 16 | — | 10,1 | 0,234 | 1,4 | 0,050 x3 | 0,4 x3 |
| FBA35A2VEB | x4 | | | | (10,9)* | — | 16 | — | 9,1 | 0,234 | 1,4 | 0,089 x4 | 1,4 x4 |
| FBA50A2VEB | x3 | | | | (12,0)* | — | 16 | — | 10,1 | 0,234 | 1,4 | 0,089 x3 | 1,4 x3 |
| FBA71A2VEB | x2 | | | | (13,5)* | — | 16 | — | 11,6 | 0,234 | 1,4 | 0,07 x2 | 1,3 x2 |
| FBA140A2VEB | | | | | (13,5)* | — | 16 | — | 11,6 | 0,234 | 1,4 | 0,187 | 3,9 |
| FUA71AVEB | x2 | | | | 15,4 | — | 16 | — | 11,6 | 0,234 | 1,41171 | 0,046 x2 | 0,9 x2 |
| FAA71AVEB | x2 | | | | 14,6 | — | 16 | — | 11,6 | 0,234 | 1,41171 | 0,048 x2 | 0,5 x2 |
| FVA140AMVEB | | | | | 15,4 | — | 16 | — | 11,6 | 0,234 | 1,41171 | 0,276 | 1,8 |
| FDXM35F3V1B | x4 | | | | 12,2 | — | 16 | — | 9,1 | 0,234 | 1,41171 | 0,034 x4 | 0,3 x4 |
| FDXM50F3V1B | x3 | | | | 14,8 | — | 16 | — | 10,1 | 0,234 | 1,41171 | 0,060 x3 | 0,9 x3 |
| FHA35AVEB | x4 | | | | 13,4 | — | 16 | — | 9,1 | 0,234 | 1,41171 | 0,060 x4 | 0,6 x4 |
| FHA50AVEB | x3 | | | | 13,8 | — | 16 | — | 10,1 | 0,234 | 1,41171 | 0,060 x3 | 0,6 x3 |
| FHA71AVEB | x2 | | | | 15,2 | — | 16 | — | 11,6 | 0,234 | 1,41171 | 0,091 x2 | 0,8 x2 |
| FHA140AVEB | | 15,4 | — | 16 | — | 11,6 | 0,234 | 1,41171 | 0,15 | 1,8 | | | |

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the indoor unit. For the actual MCA value, see the installation manual of the indoor unit.

3D120944

4 Options

4 - 1 Options

4

RZAG-NV1

RZAG-NY1

| | | EKBPH140N | EKMKSA2 | KHRQ58H | KHRQ58T | KHRQM58H | KHRQM58T | KRP58M51 | SB.KRP58M52 |
|--------------|--------------|-----------|---------|---------|---------|----------|----------|----------|-------------|
| RZAG71N7V1B | RZAG71N7Y1B | V | V(1) | V | V(2) | V | V(2) | V(1) | V(1) |
| RZAG100N7V1B | RZAG100N7Y1B | V | V(1) | V(3) | V(2) | V(3) | V(2) | V(1) | V(1) |
| RZAG125N7V1B | RZAG125N7Y1B | V | V(1) | V(3) | V(2) | V(3) | V(2) | V(1) | V(1) |
| RZAG140N7V1B | RZAG140N7Y1B | V | V(1) | V(3) | V(2) | V(3) | V(2) | V(1) | V(1) |

NOTES

1. To mount KRP58M51, an additional mounting kit (EKMKSA2) needs to be used (obligatory). This will be offered as sales bom SB.KRP58M52 = KRP58M51 + EKMKSA2
2. For twin combinations use 1 KHRQ(M)58T, for double twin use 3.
3. For triple combinations use 1 KHRQ(M)58H.

3D120932

5 Combination table

5 - 1 Combination Table

RZAG-NV1

RZAG-NY1

Comfort cooling combination table

| | High COP round flow cassette | | | | Round flow cassette | | | | | | Fully flat cassette | | | Slim concealed ceiling unit | | | Concealed ceiling unit with medium ESP | | | | | | | |
|------------------------------|------------------------------|--------------|--------------|--------------|---------------------|------------|------------|------------|-------------|-------------|---------------------|-------------|-------------|-----------------------------|--------------|--------------|--|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| | FCAHG71HVEB | FCAHG100HVEB | FCAHG125HVEB | FCAHG140HVEB | FCAG35BVEB | FCAG50BVEB | FCAG60BVEB | FCAG71BVEB | FCAG100BVEB | FCAG125BVEB | FCAG140BVEB | FFA35A2VEB9 | FFA50A2VEB9 | FFA60A2VEB9 | FDXM35F3V1B9 | FDXM50F3V1B9 | FDXM60F3V1B9 | FBA35A2VEB9 | FBA50A2VEB9 | FBA60A2VEB9 | FBA71A2VEB9 | FBA100A2VEB | FBA125A2VEB | FBA140A2VEB |
| RZAG71N7V1B RZAG71N7Y1B | P | | | | 2 | | | P | | | | 2 | | | 2 | | | 2 | | | P | | | |
| RZAG100N7V1B RZAG100N7Y1B | | P | | | 3 | 2 | | | P | | | 3 | 2 | | 3 | 2 | | 3 | 2 | | | P | | |
| RZAG125N7V1B RZAG125N7Y1B | | | P | | 4 | 3 | 2 | | | P | | 4 | 3 | 2 | 4 | 3 | 2 | 4 | 3 | 2 | | | P | |
| RZAG140N7V1B RZAG140N7Y1B | 2 | | | P | 4 | 3 | | 2 | | | P | 4 | 3 | | 4 | 3 | | 4 | 3 | | 2 | | | P |

| | Concealed ceiling unit with high ESP | Wall mounted unit | | | Ceiling suspended unit | | | | | | 4-way blow ceiling suspended unit | | | Floor standing unit | | | | Concealed floor standing unit | | |
|------------------------------|--------------------------------------|-------------------|-------------|------------|------------------------|------------|------------|------------|------------|------------|-----------------------------------|------------|------------|---------------------|-------------|-------------|-------------|-------------------------------|-------------|-------------|
| | FDA125A5VEB | FAA71AUVEB | FAA100AUVEB | FHA35AVEB9 | FHA50AVEB9 | FHA60AVEB9 | FHA71AVEB9 | FHA100AVEB | FHA125AVEB | FHA140AVEB | FUA71AVEB | FUA100AVEB | FUA125AVEB | FVA71AMVEB | FVA100AMVEB | FVA125AMVEB | FVA140AMVEB | FNA35A2VEB9 | FNA50A2VEB9 | FNA60A2VEB9 |
| RZAG71N7V1B RZAG71N7Y1B | | P | | | 2 | | | P | | | | | P | | | | | 2 | | |
| RZAG100N7V1B RZAG100N7Y1B | | | P | | 3 | 2 | | P | | | | P | | | P | | | 3 | 2 | |
| RZAG125N7V1B RZAG125N7Y1B | P | | | | 4 | 3 | 2 | | P | | | P | | | P | | | 4 | 3 | 2 |
| RZAG140N7V1B RZAG140N7Y1B | | 2 | | | 4 | 3 | | 2 | | | P | | 2 | | | | P | 4 | 3 | |

COMBINATIONS

P = Pair 3 = Triple
2 = Twin 4 = Double Twin

3D120926

RZAG-NV1

RZAG-NY1

Infrastructure cooling combination table

| | High COP round flow cassette | | | | Round flow cassette | | | | Fully flat cassette | | Slim concealed ceiling unit | | Concealed ceiling unit with medium ESP | | | | | |
|------------------------------|------------------------------|-------------|--------------|--------------|---------------------|------------|------------|-------------|---------------------|-------------|-----------------------------|--------------|--|-------------|-------------|-------------|-------------|--|
| | FCAG140BVEB | FCAHG71HVEB | FCAHG100HVEB | FCAHG140HVEB | FCAG35BVEB | FCAG50BVEB | FCAG71BVEB | FCAG100BVEB | FFA35A2VEB9 | FFA50A2VEB9 | FDXM35F3V1B9 | FDXM50F3V1B9 | FBA35A2VEB9 | FBA50A2VEB9 | FBA71A2VEB9 | FBA100A2VEB | FBA140A2VEB | |
| RZAG71N7V1B RZAG71N7Y1B | | | P | | 3 | 2 | | P | 3 | 2 | 3 | 2 | 3 | 2 | | P | | |
| RZAG100N7V1B RZAG100N7Y1B | P | 2 | | P | 4 | 3 | 2 | | 4 | 3 | 4 | 3 | 4 | 3 | 2 | | P | |
| RZAG125N7V1B RZAG125N7Y1B | P | 2 | | P | 4 | 3 | 2 | | 4 | 3 | 4 | 3 | 4 | 3 | 2 | | P | |
| RZAG140N7V1B RZAG140N7Y1B | P | 2 | | P | 4 | 3 | 2 | | 4 | 3 | 4 | 3 | 4 | 3 | 2 | | P | |

| | Wall mounted unit | | Ceiling suspended unit | | | | | | 4-way blow ceiling suspended unit | | Floor standing unit | |
|------------------------------|-------------------|-------------|------------------------|------------|------------|------------|------------|-----------|-----------------------------------|-------------|---------------------|--|
| | FAA71AUVEB | FAA100AUVEB | FHA35AVEB9 | FHA50AVEB9 | FHA71AVEB9 | FHA100AVEB | FHA140AVEB | FUA71AVEB | FUA100AVEB | FVA100AMVEB | FVA140AMVEB | |
| RZAG71N7V1B RZAG71N7Y1B | | P | 3 | 2 | | P | | | P | | | |
| RZAG100N7V1B RZAG100N7Y1B | 2 | | 4 | 3 | 2 | | P | 2 | | | P | |
| RZAG125N7V1B RZAG125N7Y1B | 2 | | 4 | 3 | 2 | | P | 2 | | | P | |
| RZAG140N7V1B RZAG140N7Y1B | 2 | | 4 | 3 | 2 | | P | 2 | | | P | |

COMBINATIONS

P = Pair 2 = Twin 3 = Triple 4 = Double Twin


3D120926

6 Capacity tables


6 - 1 Cooling/Heating Capacity Tables

RZAG71NV1 RZAG71NY1

Cooling

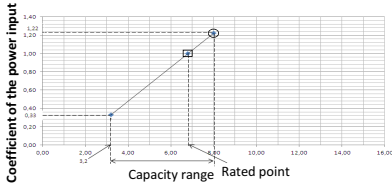

Heating

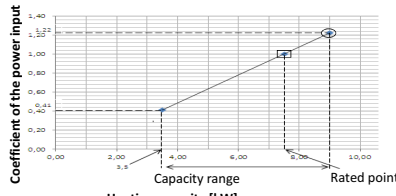

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Maximum total cooling/heating capacity [kW]
- SHC: Sensible heat capacity [kW]
- CPI: Coefficient of the power input
- PI: Power input [kW]

Cooling capacity [kW]

| Indoor | Outdoor temperature [°C DB] | | | | | | | | | | | | |
|--------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 35 | | | | 30 | | | | 25 | | | | |
| | TC | SHC | CPI | PI | TC | SHC | CPI | PI | TC | SHC | CPI | PI | |
| 16.0 | 22 | 8.08 | 5.45 | 1.00 | 7.76 | 5.32 | 1.11 | 7.28 | 5.20 | 1.21 | 7.21 | 5.06 | 1.32 |
| 18.0 | 25 | 8.40 | 5.45 | 1.00 | 8.11 | 5.32 | 1.11 | 7.83 | 5.19 | 1.22 | 7.54 | 5.05 | 1.33 |
| 19.0 | 27 | 8.59 | 5.44 | 1.03 | 8.30 | 5.32 | 1.12 | 8.00 | 5.18 | 1.22 | 7.70 | 5.05 | 1.33 |
| 19.5 | 27 | 8.58 | 5.43 | 1.03 | 8.29 | 5.31 | 1.12 | 8.05 | 5.17 | 1.22 | 7.79 | 5.05 | 1.33 |
| 22.0 | 30 | 9.15 | 5.38 | 1.03 | 8.84 | 5.25 | 1.12 | 8.52 | 5.13 | 1.23 | 8.21 | 4.99 | 1.34 |
| 24.0 | 32 | 9.53 | 5.31 | 1.03 | 9.20 | 5.19 | 1.13 | 8.87 | 5.06 | 1.25 | 8.54 | 4.92 | 1.35 |

Heating capacity [kW]

| Indoor | Outdoor temperature [°C WB] | | | | | | | | | | | |
|--------|-----------------------------|------|------|------|-------|------|------|------|------|------|------|------|
| | -15.0 | | | | -10.0 | | | | 0.0 | | | |
| | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI |
| 16 | 6.44 | 0.98 | 7.09 | 0.99 | 7.55 | 1.02 | 7.79 | 1.06 | 9.00 | 1.12 | 9.71 | 1.19 |
| 18 | 6.43 | 0.98 | 7.09 | 1.03 | 7.54 | 1.07 | 7.79 | 1.10 | 9.00 | 1.17 | 9.71 | 1.24 |
| 20 | 6.42 | 1.01 | 7.07 | 1.07 | 7.53 | 1.12 | 7.77 | 1.14 | 9.00 | 1.22 | 9.71 | 1.28 |
| 21 | 6.42 | 1.03 | 7.07 | 1.09 | 7.53 | 1.13 | 7.77 | 1.16 | 9.00 | 1.24 | 9.71 | 1.31 |
| 22 | 6.42 | 1.05 | 7.06 | 1.11 | 7.52 | 1.15 | 7.76 | 1.19 | 9.00 | 1.27 | 9.71 | 1.33 |
| 24 | 6.41 | 1.09 | 7.05 | 1.15 | 7.51 | 1.20 | 7.75 | 1.23 | 9.00 | 1.32 | 9.67 | 1.38 |

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions
□ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units: EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*.
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.

Corresponding refrigerant piping length: 5.0 m

Level difference: 0 m

| Pair | FCAG71H | FCAG71B | FAA71A | FVA71A | FHA71A | FUA71A | FBA71A |
|------|---------|---------|--------|--------|--------|--------|--------|
| AFR | 21.2 | 15.3 | 19.0 | 18.0 | 20.5 | 23.0 | 19.0 |
| (BF) | (0.20) | (0.14) | (0.16) | (0.16) | (0.13) | (0.24) | (0.13) |

| Twin | FCAG35B X 2 | FHA35A X 2 | FFA35A X 2 | FDXM35F X 2 | FBA35A X 2 | FNA35A X 2 |
|------|-------------|------------|------------|-------------|------------|------------|
| AFR | 12.5 x 2 | 14.0 x 2 | 10.0 x 2 | 8.7 x 2 | 15.0 x 2 | 8.7 x 2 |
| (BF) | (0.40 x 2) | (0.17 x 2) | (0.25 x 2) | (0.17 x 2) | (0.08 x 2) | (0.17 x 2) |


| Pair | FCAG71H | FCAG71B | FAA71A | FVA71A | FHA71A | FUA71A | FBA71A |
|---------|---------|---------|--------|--------|--------|--------|--------|
| Cooling | 1.65 | 1.92 | 2.08 | 2.08 | 1.67 | 1.77 | 2.00 |
| Heating | 1.60 | 2.02 | 2.19 | 2.21 | 1.90 | 1.73 | 1.99 |

| Twin | FCAG35B X 2 | FHA35A X 2 | FFA35A X 2 | FDXM35F X 2 | FBA35A X 2 | FNA35A X 2 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 1.56 | 1.53 | 1.75 | 1.64 | 1.67 | 1.68 |
| Heating | 1.59 | 1.69 | 2.25 | 1.84 | 1.90 | 1.85 |


3D125180

RZAG100NV1 RZAG100NY1

Cooling

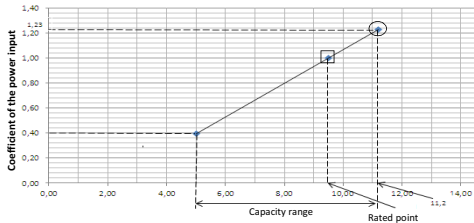

Heating

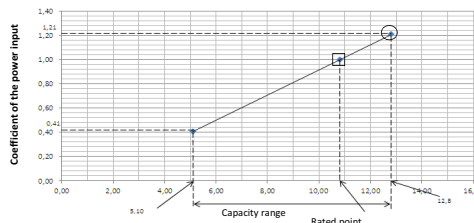

Symbols

- AFR: Air flow rate [m³/min]
- BF: Bypass factor
- EWB: Entering wet-bulb temperature (°C WB)
- EDB: Entering dry-bulb temperature (°C DB)
- TC: Maximum total cooling/heating capacity [kW]
- SHC: Sensible heat capacity [kW]
- CPI: Coefficient of the power input
- PI: Power input [kW]

Cooling capacity [kW]

| Indoor | Outdoor temperature [°C DB] | | | | | | | | | | | | |
|--------|-----------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|
| | 35 | | | | 30 | | | | 25 | | | | |
| | TC | SHC | CPI | PI | TC | SHC | CPI | PI | TC | SHC | CPI | PI | |
| 16.0 | 22 | 11.20 | 7.61 | 1.01 | 10.85 | 7.45 | 1.11 | 10.50 | 7.29 | 1.22 | 10.11 | 7.09 | 1.33 |
| 18.0 | 25 | 11.80 | 7.59 | 1.01 | 11.37 | 7.49 | 1.12 | 11.00 | 7.27 | 1.23 | 10.55 | 7.09 | 1.33 |
| 19.0 | 27 | 12.00 | 7.57 | 1.03 | 11.62 | 7.46 | 1.12 | 11.20 | 7.25 | 1.23 | 10.80 | 7.08 | 1.33 |
| 19.5 | 27 | 12.05 | 7.57 | 1.03 | 11.74 | 7.47 | 1.13 | 11.43 | 7.24 | 1.23 | 10.91 | 7.08 | 1.34 |
| 22.0 | 30 | 12.80 | 7.52 | 1.02 | 12.37 | 7.36 | 1.13 | 11.90 | 7.16 | 1.24 | 11.52 | 7.03 | 1.35 |
| 24.0 | 32 | 13.30 | 7.42 | 1.03 | 12.88 | 7.27 | 1.14 | 12.40 | 7.06 | 1.25 | 11.97 | 6.93 | 1.36 |

Heating capacity [kW]

| Indoor | Outdoor temperature [°C WB] | | | | | | | | | | | |
|--------|-----------------------------|------|------|------|-------|------|------|------|------|------|------|------|
| | -15.0 | | | | -10.0 | | | | 0.0 | | | |
| | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI |
| 16 | 8.59 | 0.92 | 9.45 | 0.95 | 10.1 | 1.02 | 10.4 | 1.05 | 12.8 | 1.11 | 13.8 | 1.18 |
| 18 | 8.57 | 0.97 | 9.44 | 1.02 | 10.0 | 1.06 | 10.3 | 1.09 | 12.8 | 1.16 | 13.8 | 1.23 |
| 20 | 8.56 | 1.00 | 9.43 | 1.06 | 10.0 | 1.11 | 10.3 | 1.13 | 12.8 | 1.21 | 13.8 | 1.27 |
| 21 | 8.55 | 1.02 | 9.42 | 1.08 | 10.0 | 1.12 | 10.3 | 1.15 | 12.8 | 1.23 | 13.8 | 1.30 |
| 22 | 8.55 | 1.04 | 9.42 | 1.10 | 10.0 | 1.14 | 10.3 | 1.18 | 12.8 | 1.26 | 13.8 | 1.32 |
| 24 | 8.54 | 1.08 | 9.41 | 1.14 | 10.0 | 1.19 | 10.3 | 1.22 | 12.8 | 1.31 | 13.8 | 1.37 |

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions
□ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units: EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*.
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
Outdoor air: 85% RH.
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.

Corresponding refrigerant piping length: 5.0 m

Level difference: 0 m

| Pair | FCAG100H | FCAG100B | FAA100A | FVA100A | FHA100A | FUA100A | FBA100A |
|------|----------|----------|---------|---------|---------|---------|---------|
| AFR | 34.2 | 22.8 | 26.0 | 28.0 | 31.0 | 29.0 | 28.0 |
| (BF) | (0.17) | (0.17) | (0.10) | (0.20) | (0.09) | (0.20) | (0.03) |

| Twin | FCAG50B X 2 | FHA50A X 2 | FFA50A X 2 | FDXM50F X 2 | FBA50A X 2 | FNA50A X 2 |
|------|-------------|------------|------------|-------------|------------|------------|
| AFR | 12.6 x 2 | 15.0 x 2 | 12.0 x 2 | 15.8 x 2 | 15.0 x 2 | 16.0 x 2 |
| (BF) | (0.22 x 2) | (0.18 x 2) | (0.16 x 2) | (0.11 x 2) | (0.13 x 2) | (0.11 x 2) |

| Triple | FCAG35B X 3 | FHA35A X 3 | FFA35A X 3 | FDXM35F X 3 | FBA35A X 3 | FNA35A X 3 |
|--------|-------------|------------|------------|-------------|------------|------------|
| AFR | 12.5 x 3 | 14.0 x 3 | 10.0 x 3 | 8.7 x 3 | 15.0 x 3 | 8.7 x 3 |
| (BF) | (0.40 x 3) | (0.17 x 3) | (0.25 x 3) | (0.17 x 3) | (0.08 x 3) | (0.17 x 3) |

| Pair | FCAG100H | FCAG100B | FAA100A | FVA100A | FHA100A | FUA100A | FBA100A |
|---------|----------|----------|---------|---------|---------|---------|---------|
| Cooling | 2.25 | 2.65 | 2.54 | 2.66 | 2.31 | 2.66 | 2.58 |
| Heating | 2.16 | 3.01 | 3.41 | 2.73 | 2.72 | 2.68 | 2.79 |

| Twin | FCAG50B X 2 | FHA50A X 2 | FFA50A X 2 | FDXM50F X 2 | FBA50A X 2 | FNA50A X 2 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 2.16 | 2.35 | 2.51 | 2.00 | 2.29 | 2.10 |
| Heating | 2.37 | 2.65 | 2.75 | 2.57 | 2.79 | 2.57 |

| Triple | FCAG35B X 3 | FHA35A X 3 | FFA35A X 3 | FDXM35F X 3 | FBA35A X 3 | FNA35A X 3 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 2.05 | 2.03 | 2.23 | 2.11 | 2.20 | 2.17 |
| Heating | 2.16 | 2.15 | 2.76 | 2.91 | 2.32 | 2.91 |



3D125181

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

RZAG125NV1

RZAG125NY1

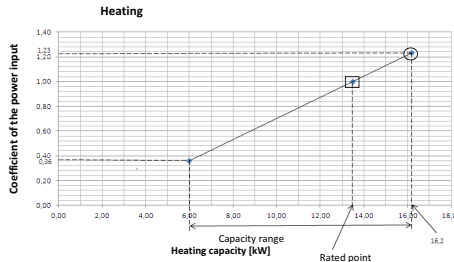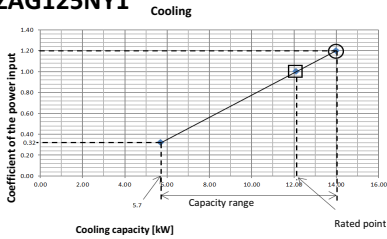

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

| Indoor | Outdoor temperature [°C DB] | | | | | | | | | | | | |
|--------|-----------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|
| | 25 | | | 30 | | | 35 | | | 40 | | | |
| TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | | |
| 16.0 | 22 | 14.30 | 9.54 | 0.99 | 13.60 | 9.30 | 1.09 | 13.10 | 9.12 | 1.19 | 12.60 | 8.78 | 1.29 |
| 18.0 | 25 | 14.70 | 9.50 | 0.99 | 14.20 | 9.27 | 1.09 | 13.70 | 9.08 | 1.20 | 13.20 | 8.89 | 1.30 |
| 19.0 | 27 | 15.00 | 9.52 | 1.00 | 14.50 | 9.34 | 1.10 | 14.00 | 9.06 | 1.20 | 13.50 | 8.97 | 1.31 |
| 19.5 | 27 | 15.21 | 9.52 | 1.00 | 14.68 | 9.26 | 1.11 | 14.15 | 9.08 | 1.20 | 13.64 | 8.81 | 1.31 |
| 22.0 | 30 | 16.00 | 9.39 | 1.00 | 15.47 | 9.14 | 1.11 | 14.90 | 8.95 | 1.21 | 14.38 | 8.74 | 1.32 |
| 24.0 | 32 | 16.70 | 9.31 | 1.01 | 16.10 | 9.09 | 1.11 | 15.50 | 8.89 | 1.21 | 14.97 | 8.63 | 1.33 |

| Indoor | Outdoor temperature [°C WB] | | | | | | | | | | | | | | | | | |
|--------|-----------------------------|------|------|-------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | -15.0 | | | -10.0 | | | -5.0 | | | 0.0 | | | 6.0 | | | 10.0 | | |
| TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | |
| 16 | 11.0 | 0.94 | 12.1 | 1.00 | 12.9 | 1.03 | 13.2 | 1.06 | 13.2 | 1.06 | 13.2 | 1.06 | 13.2 | 1.06 | 13.2 | 1.06 | 13.2 | 1.06 |
| 18 | 11.0 | 0.98 | 12.1 | 1.03 | 12.9 | 1.08 | 13.2 | 1.11 | 13.2 | 1.11 | 13.2 | 1.11 | 13.2 | 1.11 | 13.2 | 1.11 | 13.2 | 1.11 |
| 20 | 11.0 | 1.02 | 12.0 | 1.08 | 12.9 | 1.13 | 13.2 | 1.16 | 13.2 | 1.16 | 13.2 | 1.16 | 13.2 | 1.16 | 13.2 | 1.16 | 13.2 | 1.16 |
| 21 | 11.0 | 1.04 | 12.0 | 1.10 | 12.9 | 1.14 | 13.2 | 1.17 | 13.2 | 1.17 | 13.2 | 1.17 | 13.2 | 1.17 | 13.2 | 1.17 | 13.2 | 1.17 |
| 22 | 11.0 | 1.06 | 12.0 | 1.12 | 12.8 | 1.16 | 13.2 | 1.20 | 13.2 | 1.20 | 13.2 | 1.20 | 13.2 | 1.20 | 13.2 | 1.20 | 13.2 | 1.20 |
| 24 | 11.0 | 1.10 | 12.0 | 1.16 | 12.8 | 1.21 | 13.2 | 1.24 | 13.2 | 1.24 | 13.2 | 1.24 | 13.2 | 1.24 | 13.2 | 1.24 | 13.2 | 1.24 |

Notes
 1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 2. ○ = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
 3. -SHC is based on indoor units: EWB & EDB.
 -SHC for other dry-bulb temperatures = SHC + SHC*.
 SHC* = SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 4. The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m

5. -CPI is a percentage value compared to the rated value which is 1.00.
 6. The error rate for this value is less than 5% and depends on the indoor unit type.
 7. The heating performance takes into account the drop that occurs during defrost operation.
 8. The air flow rate and bypass factor are mentioned in the table.
 9. The rated power input for each model is mentioned in the table below.

Pair

| Pair | FCAG125H | FCAG125B | FDJ125A | FVA125A | FHA125A | FUA125A | FBA125A |
|------|----------|----------|----------|----------|----------|----------|---------|
| AFR | 33.5 | 45.0 | 12.0 x 3 | 15.8 x 3 | 15.0 x 3 | 16.0 x 3 | 34.0 |
| (BF) | (0.19) | (0.21) | (0.16) | (0.16) | (0.14) | (0.19) | (0.06) |

Twin

| Pair | FCAG60B X 2 | FHA60A X 2 | FFA60A X 2 | FDXM60F X 2 | FBA60A X 2 | FNA60A X 2 |
|------|-------------|------------|------------|-------------|------------|------------|
| AFR | 13.6 x 2 | 19.5 x 2 | 14.5 x 2 | 16.0 x 2 | 18.0 x 2 | 16.0 x 2 |
| (BF) | (0.20 x 2) | (0.20 x 2) | (0.11 x 2) | (0.12 x 2) | (0.18 x 2) | (0.12 x 2) |

Triple

| Pair | FCAG50A X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F X 3 | FBA50A X 3 | FNA50A X 3 |
|------|-------------|------------|------------|-------------|------------|------------|
| AFR | 12.8 x 3 | 15.0 x 3 | 12.0 x 3 | 15.8 x 3 | 15.0 x 3 | 16.0 x 3 |
| (BF) | (0.22 x 3) | (0.18 x 3) | (0.16 x 3) | (0.11 x 3) | (0.13 x 3) | (0.11 x 3) |

Double twin

| Pair | FCAG35B X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F X 4 | FBA35A X 4 | FNA35A X 4 |
|------|-------------|------------|------------|-------------|------------|------------|
| AFR | 12.5 x 4 | 14.0 x 4 | 10.0 x 4 | 8.7 x 4 | 15.0 x 4 | 8.7 x 4 |
| (BF) | (0.40 x 4) | (0.17 x 4) | (0.25 x 4) | (0.17 x 4) | (0.08 x 4) | (0.17 x 4) |

Pair

| Pair | FCAG125H | FCAG125B | FDJ125A | FVA125A | FHA125A | FUA125A | FBA125A |
|---------|----------|----------|---------|---------|---------|---------|---------|
| Cooling | 3.15 | 3.65 | 3.73 | 3.77 | 3.56 | 4.00 | 3.70 |
| Heating | 3.08 | 3.82 | 3.25 | 3.84 | 3.36 | 3.40 | 3.15 |

Twin

| Pair | FCAG60B X 2 | FHA60A X 2 | FFA60A X 2 | FDXM60F X 2 | FBA60A X 2 | FNA60A X 2 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 2.76 | 2.83 | 3.35 | 2.60 | 2.78 | 2.65 |
| Heating | 3.49 | 3.27 | 3.58 | 3.03 | 2.82 | 3.04 |

Triple

| Pair | FCAG50A X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F X 3 | FBA50A X 3 | FNA50A X 3 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 2.57 | 2.79 | 2.97 | 2.36 | 2.74 | 2.50 |
| Heating | 2.86 | 2.73 | 3.19 | 2.46 | 2.69 | 2.53 |



Double twin

| Pair | FCAG35B X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F X 4 | FBA35A X 4 | FNA35A X 4 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 2.51 | 2.45 | 2.71 | 2.55 | 2.96 | 2.62 |
| Heating | 2.63 | 2.41 | 3.44 | 2.88 | 2.84 | 2.91 |

3D125182

RZAG140NV1

RZAG140NY1

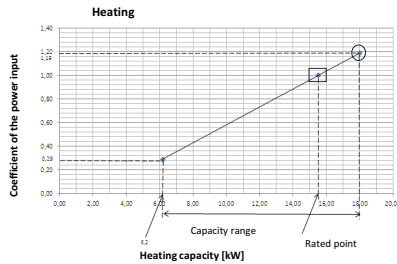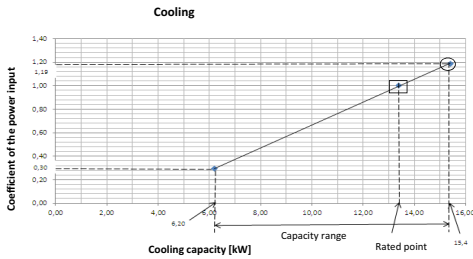

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

| Indoor | Outdoor temperature [°C DB] | | | | | | | | | | | | |
|--------|-----------------------------|-------|-------|------|-------|-------|------|-------|-------|------|-------|------|------|
| | 25 | | | 30 | | | 35 | | | 40 | | | |
| TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | | |
| 16.0 | 22 | 15.50 | 10.47 | 0.98 | 14.93 | 10.25 | 1.08 | 14.44 | 10.03 | 1.18 | 13.86 | 9.69 | 1.28 |
| 18.0 | 25 | 16.17 | 10.55 | 0.98 | 15.62 | 10.21 | 1.09 | 15.11 | 10.01 | 1.19 | 14.52 | 9.71 | 1.30 |
| 19.0 | 27 | 16.56 | 10.43 | 0.99 | 15.96 | 10.18 | 1.09 | 15.40 | 9.98 | 1.19 | 14.83 | 9.76 | 1.30 |
| 19.5 | 27 | 16.74 | 10.49 | 0.99 | 16.14 | 10.16 | 1.10 | 15.57 | 10.00 | 1.19 | 14.98 | 9.66 | 1.30 |
| 22.0 | 30 | 17.61 | 10.37 | 0.99 | 17.01 | 10.16 | 1.10 | 16.36 | 9.83 | 1.21 | 15.76 | 9.60 | 1.31 |
| 24.0 | 32 | 18.38 | 10.20 | 1.00 | 17.72 | 10.00 | 1.11 | 17.08 | 9.67 | 1.22 | 16.83 | 9.47 | 1.32 |

| Indoor | Outdoor temperature [°C WB] | | | | | | | | | | | | | | | | |
|--------|-----------------------------|------|------|-------|------|------|------|------|------|------|------|------|-----|-----|----|------|-----|
| | -15.0 | | | -10.0 | | | -5.0 | | | 0.0 | | | 6.0 | | | 10.0 | |
| TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI |
| 16 | 11.6 | 0.91 | 12.7 | 0.97 | 13.6 | 1.00 | 13.9 | 1.03 | 18.0 | 1.09 | 19.4 | 1.16 | | | | | |
| 18 | 11.6 | 0.95 | 12.7 | 1.00 | 13.6 | 1.04 | 13.9 | 1.07 | 18.0 | 1.14 | 19.4 | 1.21 | | | | | |
| 20 | 11.6 | 0.99 | 12.7 | 1.06 | 13.5 | 1.09 | 13.9 | 1.11 | 18.0 | 1.19 | 19.4 | 1.26 | | | | | |
| 21 | 11.6 | 1.00 | 12.7 | 1.06 | 13.5 | 1.11 | 13.9 | 1.13 | 18.0 | 1.21 | 19.4 | 1.28 | | | | | |
| 22 | 11.6 | 1.02 | 12.7 | 1.08 | 13.5 | 1.12 | 13.9 | 1.16 | 18.0 | 1.24 | 19.4 | 1.30 | | | | | |
| 24 | 11.6 | 1.07 | 12.6 | 1.12 | 13.5 | 1.17 | 13.9 | 1.20 | 18.0 | 1.29 | 19.4 | 1.36 | | | | | |

Notes
 1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 2. ○ = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
 3. -SHC is based on indoor units: EWB & EDB.
 -SHC for other dry-bulb temperatures = SHC + SHC*.
 SHC* = SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 4. The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m

5. -CPI is a percentage value compared to the rated value which is 1.00.
 6. The error rate for this value is less than 5% and depends on the indoor unit type.
 7. The heating performance takes into account the drop that occurs during defrost operation.
 8. The air flow rate and bypass factor are mentioned in the table.
 9. The rated power input for each model is mentioned in the table below.

Pair

| Pair | FCAG140H | FCAG140B | FVA140A | FHA140A | FBA140A |
|------|----------|----------|---------|---------|---------|
| AFR | 33.5 | 26.0 | 34.0 | 34.0 | 46.9 |
| (BF) | (0.15) | (0.23) | (0.18) | (0.17) | (0.06) |

Twin

| Pair | FCAG71H X 2 | FCAG71B X 2 | FA71A X 2 | FHA71A X 2 | FUA71A X 2 | FBA71A X 2 | FVA71A X 2 |
|------|-------------|-------------|------------|------------|------------|------------|------------|
| AFR | 21.5 x 2 | 14.0 x 2 | 18.0 x 2 | 20.5 x 2 | 23.0 x 2 | 18.0 x 2 | 18.0 x 2 |
| (BF) | (0.20 x 2) | (0.14 x 2) | (0.16 x 2) | (0.13 x 2) | (0.24 x 2) | (0.12 x 2) | (0.16 x 2) |

Triple

| Pair | FCAG50B X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F X 3 | FBA50A X 3 | FNA50A X 3 |
|------|-------------|------------|------------|-------------|------------|------------|
| AFR | 12.6 x 3 | 15.0 x 3 | 12.0 x 3 | 15.8 x 3 | 15.0 x 3 | 16.0 x 3 |
| (BF) | (0.22 x 3) | (0.18 x 3) | (0.16 x 3) | (0.11 x 3) | (0.13 x 3) | (0.11 x 3) |

Double twin

| Pair | FCAG35B X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F X 4 | FBA35A X 4 | FNA35A X 4 |
|------|-------------|------------|------------|-------------|------------|------------|
| AFR | 12.5 x 4 | 14.0 x 4 | 10.0 x 4 | 8.7 x 4 | 15.0 x 4 | 8.7 x 4 |
| (BF) | (0.40 x 4) | (0.20 x 4) | (0.25 x 4) | (0.17 x 4) | (0.08 x 4) | (0.17 x 4) |

Pair

| Pair | FCAG140H | FCAG140B | FVA140A | FHA140A | FBA140A | |
|---------|----------|----------|---------|---------|---------|------|
| Cooling | 3.64 | 4.29 | 3.40 | 4.42 | 4.31 | 4.69 |
| Heating | 3.64 | 4.55 | 4.48 | 4.33 | 4.32 | |

Twin

| Pair | FCAG71H X 2 | FCAG71B X 2 | FA71A X 2 | FHA71A X 2 | FUA71A X 2 | FBA71A X 2 | FVA71A X 2 |
|---------|-------------|-------------|-----------|------------|------------|------------|------------|
| Cooling | 3.03 | 3.69 | 3.67 | 3.50 | 3.28 | 3.55 | 3.92 |
| Heating | 3.03 | 3.69 | 3.67 | 3.50 | 3.28 | 3.55 | 3.92 |

Triple

| Pair | FCAG50B X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F X 3 | FBA50A X 3 | FNA50A X 3 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 2.88 | 3.15 | 3.27 | 3.01 | 3.02 | 2.97 |
| Heating | 3.44 | 3.29 | 3.87 | 2.96 | 3.23 | 3.03 |

Double twin

| Pair | FCAG35B X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F X 4 | FBA35A X 4 | FNA35A X 4 |
|---------|-------------|------------|------------|-------------|------------|------------|
| Cooling | 2.88 | 2.73 | 3.04 | 2.87 | 3.02 | 2.97 |
| Heating | 3.97 | 2.89 | 4.19 | 3.49 | 4.22 | 3.53 |

3D125183


6 Capacity tables

6 - 2 Capacity Correction Factor

6

RZAG-NV1
RZAG-NY1

Capacity in function of field piping length

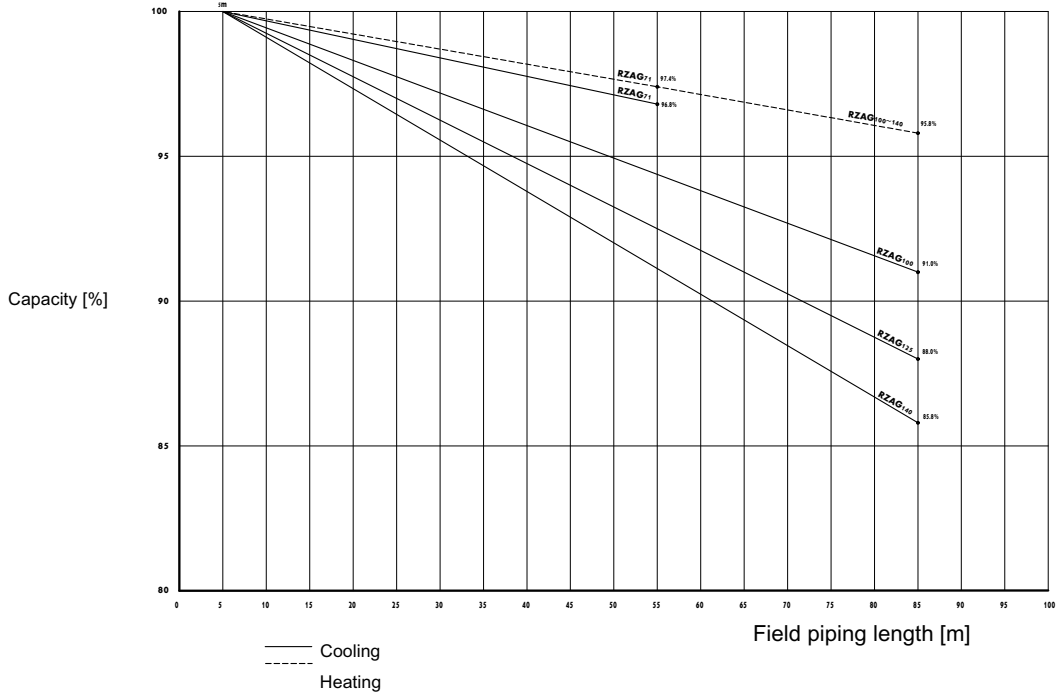


3D112162

7 Dimensional drawings

7 - 1 Dimensional Drawings

RZAG-NV1
RZAG-NY1

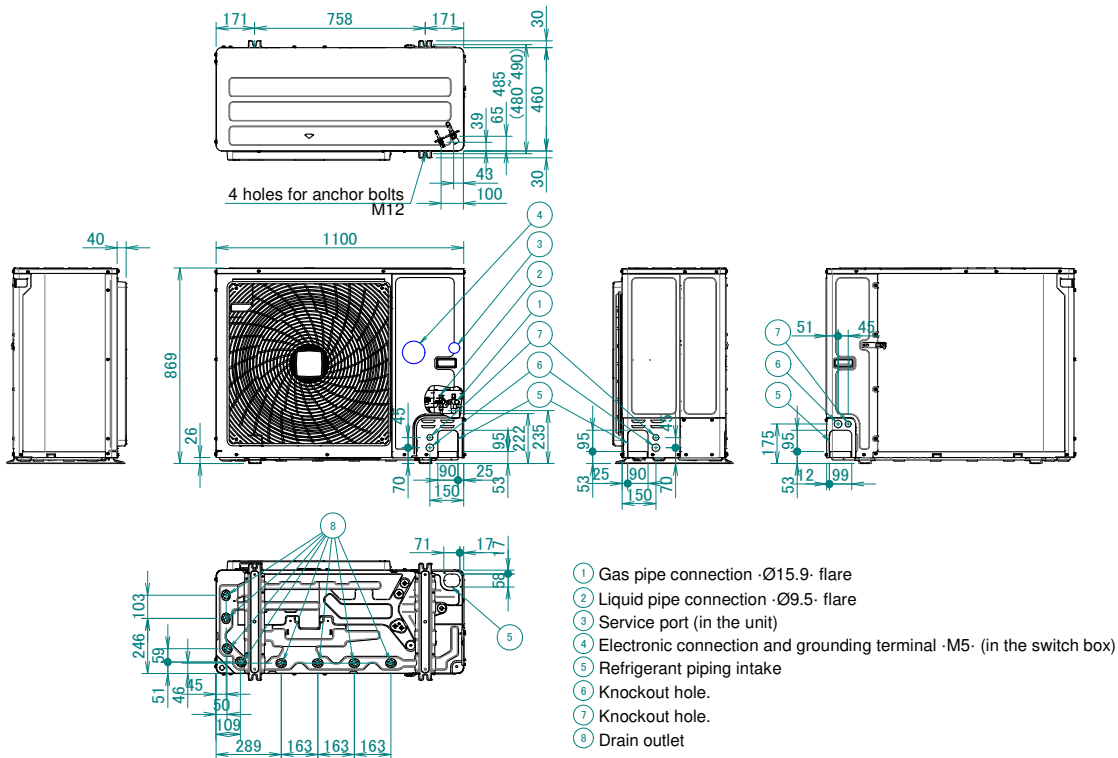


3D120936

8 Centre of gravity

8 - 1 Centre of Gravity

RZAG-NV1

RZAG-NY1

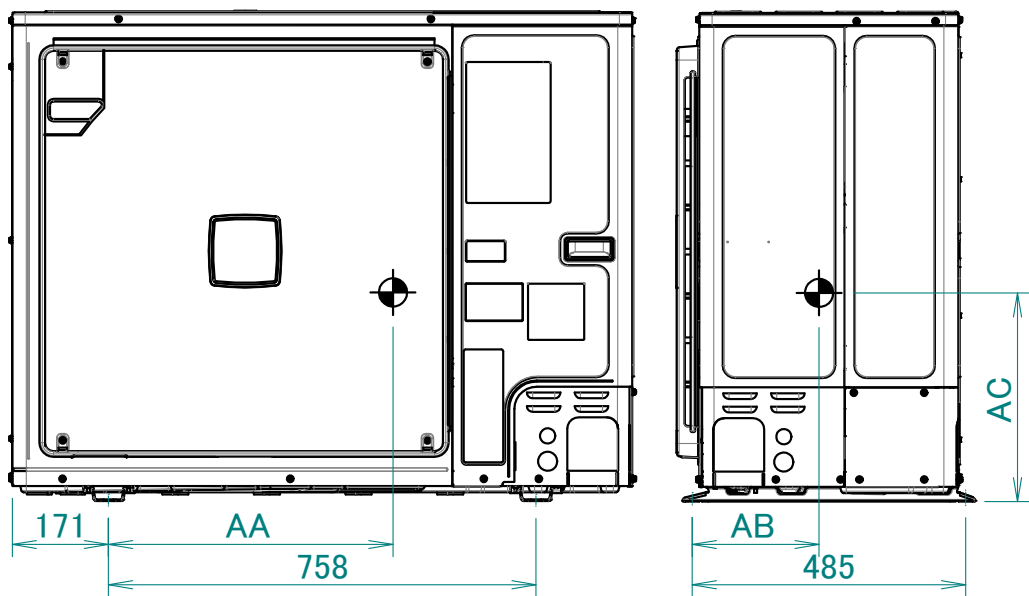

| Model | AA | AB | AC |
|------------------|-------|-------|-------|
| RZAG71N7V1B | 691.3 | 238.7 | 357.8 |
| RZAG71N7Y1B | 696.9 | 224.7 | 359.8 |
| RZAG100N7V1B | 670.7 | 239.3 | 367.6 |
| RZAG100N7Y1B | 682.2 | 223.5 | 362.5 |
| RZAG125/140N7V1B | 657.3 | 229.2 | 371.8 |
| RZAG125/140N7Y1B | 664.4 | 215.8 | 372.2 |


4D120933A

9 Piping diagrams

9 - 2 Piping Diagram Twin Application

9

RZAG-NV1
RZAG-NY1

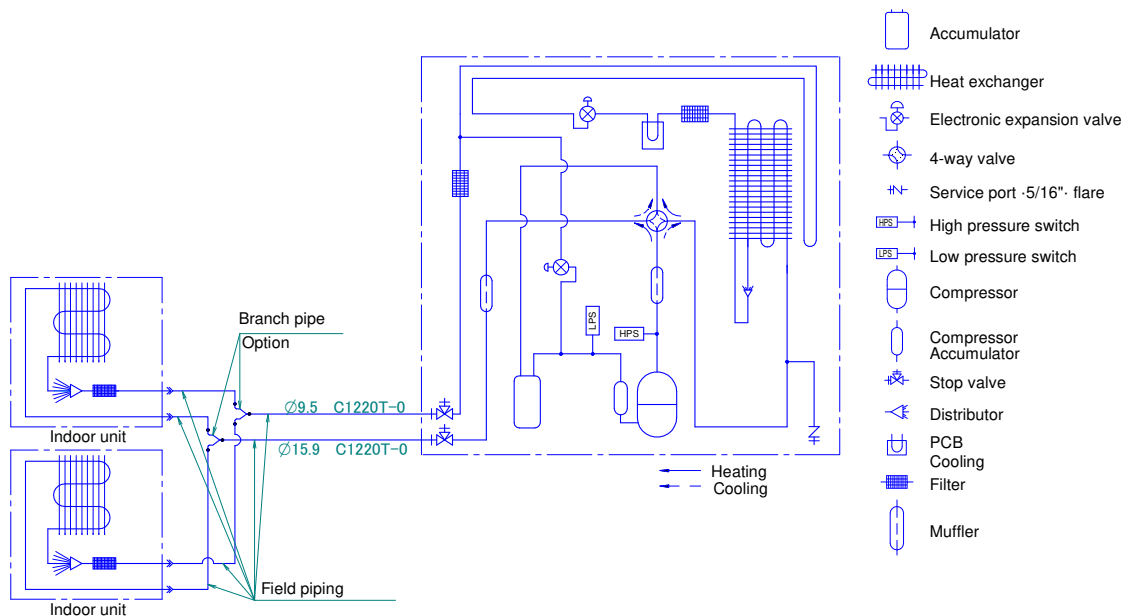

Notes


1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D120913

9 Piping diagrams

9 - 3 Piping Diagram Triple Application

RZAG100-140NV1
RZAG100-140NY1

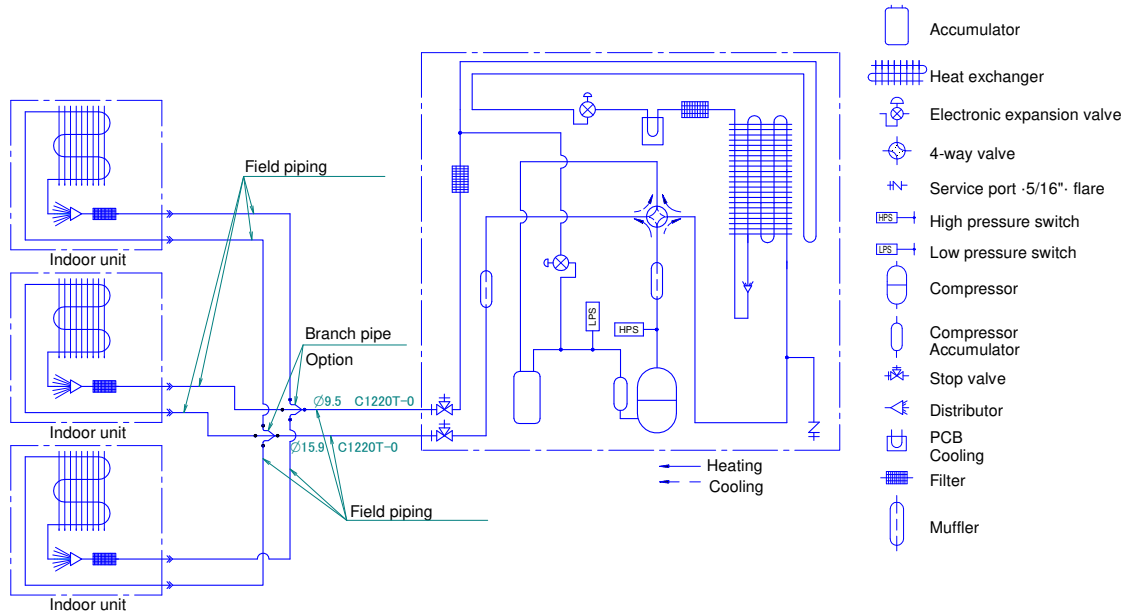

Notes


1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D120914

9 Piping diagrams

9 - 4 Piping Diagram Double Twin Application

9

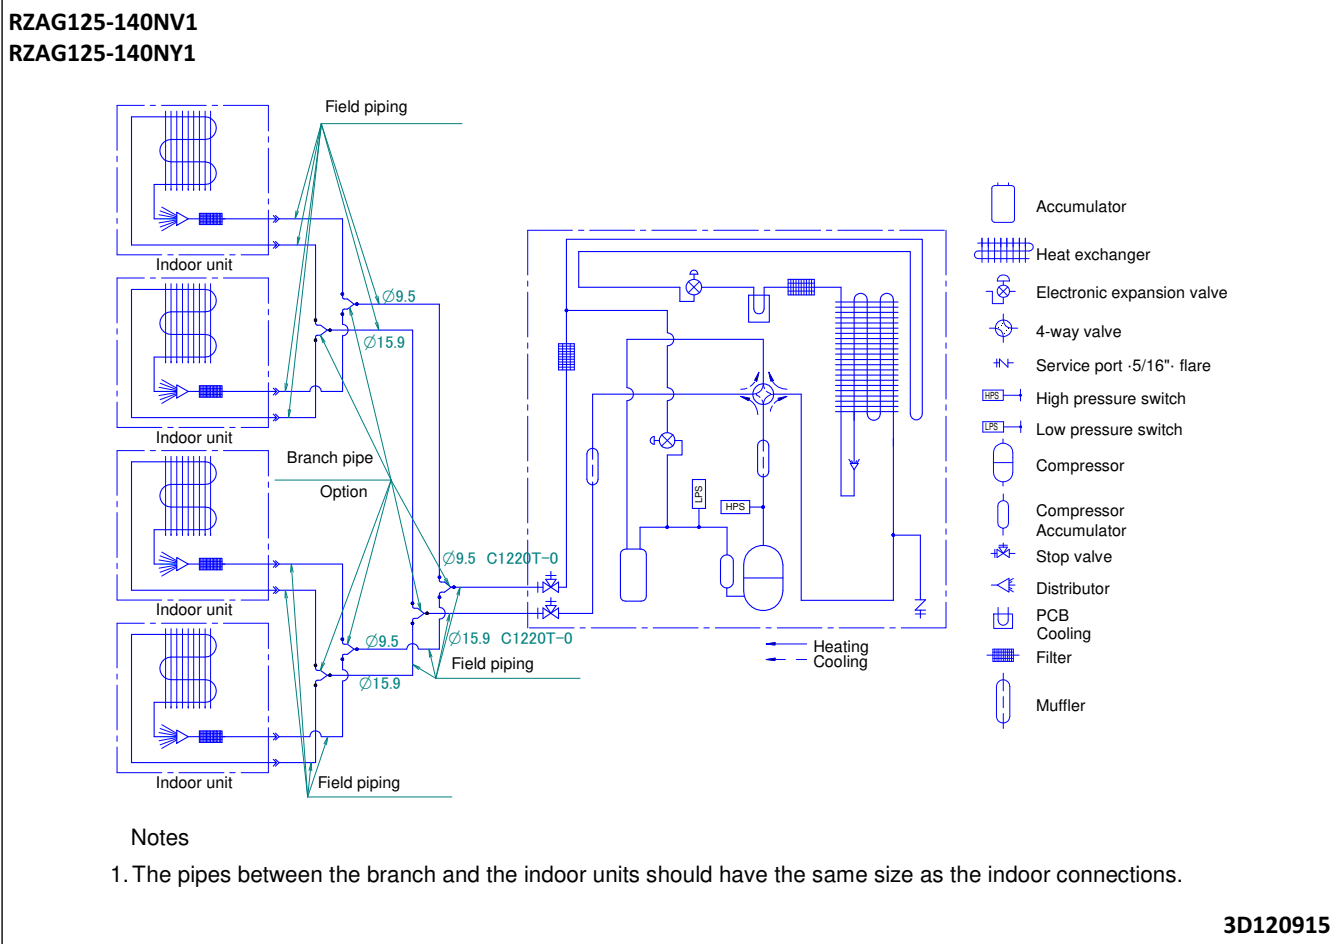


10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase

RZAG71-100NV1

(1) Connection diagram

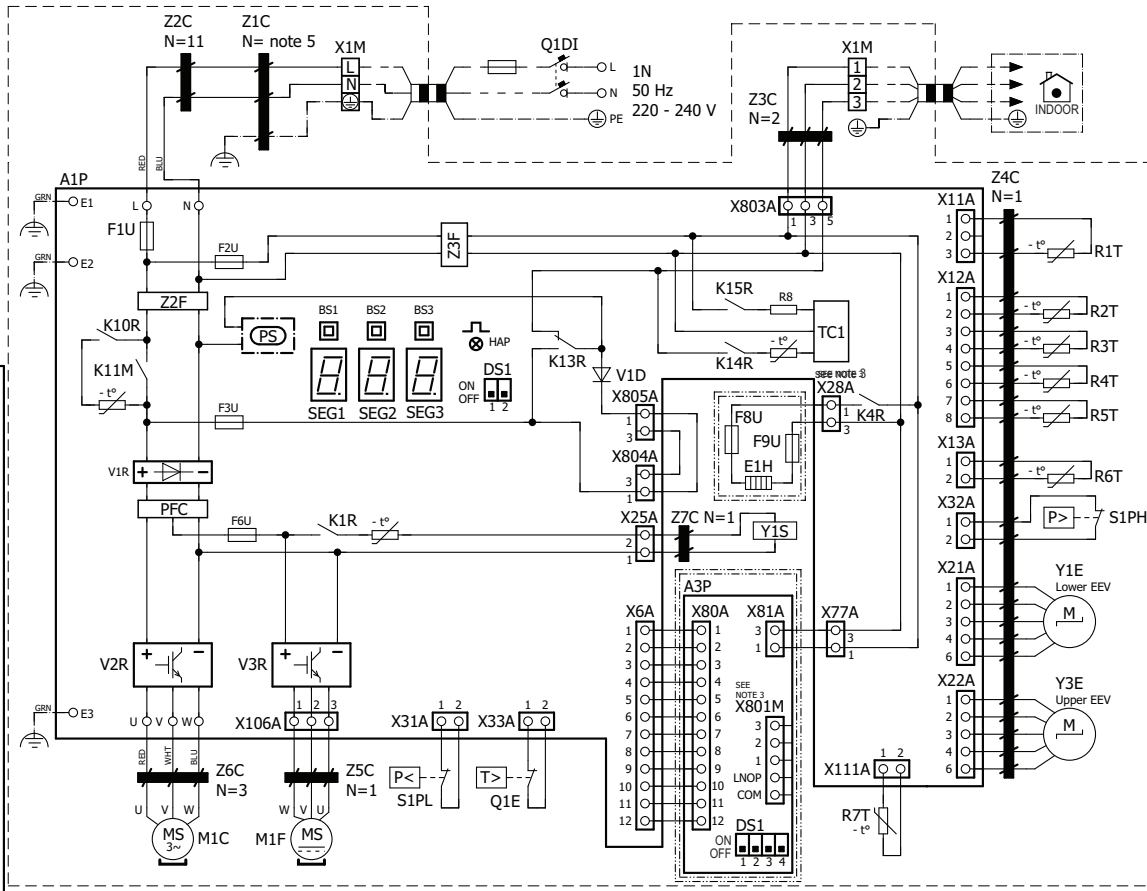

(2) Layout



(3) NOTES

- : Connection
- : Earth wiring
- : Field supply
- : Option
- : switch box
- : PCB
- : Wiring depending on model
- : Protective earth
- : Field wire

(4) LEGEND

| Part n° | Description |
|---------------------|---|
| A1P | Printed circuit board (main) |
| A3P | * Printed circuit board (demand) |
| BS1-3 (A1P) | Push-button switch |
| DS1 (A1-2P) | Dipswitch |
| E1-3 (A1P) | Connector |
| E1H | * Bottom plate heater |
| F1U (A1P) | Fuse T 31,5 A 250 V |
| F2U (A1P) | Fuse T 6,3 A 250 V |
| F3U (A1P) | Fuse T 6,3 A 250 V |
| F6U (A1P) | Fuse T 5 A 250V |
| F8-9U | * Fuse F 1 A 250 V |
| HAP (A1P) | Light-emitting diode (service monitor is green) |
| K1R (A1P) | Magnetic relay (Y1S) |
| K4R (A1P) | Magnetic relay (E1H) |
| K13-15R, K10R (A1P) | Magnetic relay |
| K11M (A1P) | Magnetic contactor |
| L (A1P) | Connector |
| M1C | Compressor motor |
| M1F | Fan motor |
| N (A1P) | Connector |
| PFC (A1P) | Power factor correction |
| PS (A1P) | Switching power supply |

| Part n° | Description |
|---------------|--------------------------------------|
| Q1DI | Earth leakage circuit breaker (30mA) |
| Q1E | Overload protection |
| R1T | Thermistor (air) |
| R2T | Thermistor (discharge) |
| R3T | Thermistor (suction) |
| R4T | Thermistor (heat exchanger) |
| R5T | Thermistor (heat exchanger middle) |
| R6T | Thermistor (liquid) |
| R7T | Thermistor (fin) |
| R8 (A1P) | Resistor |
| S1PH | High pressure switch |
| S1PL | Low pressure switch |
| SEG1-3 (A1P) | 7-segment display |
| TC1 (A1P) | Signal transceiver circuit |
| U, V, W (A1P) | Connector |
| V1D (A1P) | Diode |
| V*R (A1P) | Diode module |
| X*A (A1P) | Connector |
| X1M | Terminal strip |
| Y1E, Y3E | Electronic expansion valve |
| Y1S | Solenoid valve (4-way valve) |
| Z*C | Noise filter (ferrite core) |
| Z*F (A1P) | Noise filter |

* : optional
: field supply

NOTES

- Refer to the wiring diagram sticker (on the back of the front plate) for how to use the BS1-BS3 and DS1 switches.
- When operating, do not short-circuit protection device(s) S1PH, S1PL and Q1E.
- Refer to the combination table and the option manual for how to connect the wiring to X28A and X801M.
- Colours: BLK:black; RED:red; BLU:blue; WHT:white; GRN:green
- Windings: L-N: 2 - Earth: 1

4D120909


10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase


10

RZAG125-140NV1

(1) Connection diagram

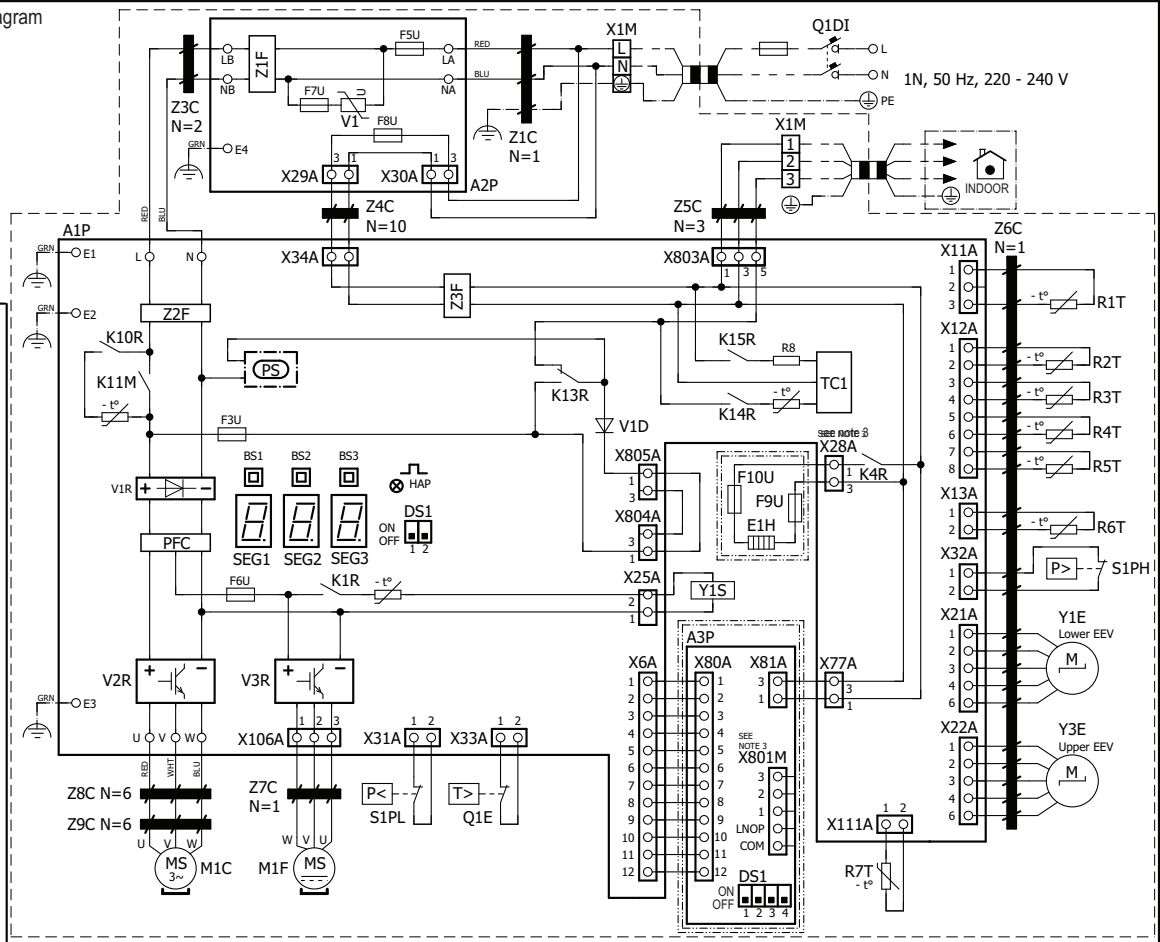

(2) Layout

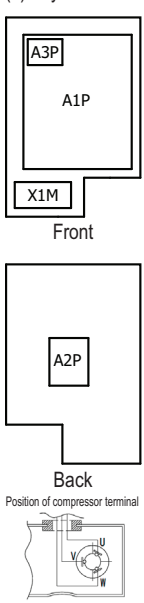

(3) NOTES

- ◆ : Connection
- X1M : Main terminal
- : Earth wiring
- : Field supply
- : Option
- : switch box
- : PCB
- : Wiring depending on model
- ⊕ : Protective earth
- : Field wire

(4) LEGEND

| Part n° | Description |
|---------------------|---|
| A1P | Printed circuit board (main) |
| A2P | Printed circuit board (noise filter) |
| A3P | * Printed circuit board (demand) |
| BS1-3 (A1P) | Push-button switch |
| DS1(A1P,A3P) | Dipswitch |
| E1-3 (A1-2P) | Connector |
| E1H | * Bottom plate heater |
| F3U (A1P) | Fuse T 6,3 A 250 V |
| F5U (A2P) | Fuse T 56 A 250V |
| F6U (A1P) | Fuse T 5 A 250V |
| F7U (A2P) | Fuse T 6,3 A 250 V |
| F8U (A2P) | Fuse T 6,3 A 250 V |
| F9-10U | Fuse F 1 A 250 V |
| HAP (A1P) | Light-emitting diode (service monitor is green) |
| K1R (A1P) | Magnetic relay (Y1S) |
| K4R (A1P) | Magnetic relay (E1H) |
| K13-15R, K10R (A1P) | Magnetic relay |
| K11M (A1P) | Magnetic contactor |
| L* (A1-2P) | Connector |
| M1C | Compressor motor |
| M1F | Fan motor |
| PFC (A1P) | Power factor correction |

| Part n° | Description |
|---------------|--------------------------------------|
| PS (A1P) | Switching power supply |
| Q1DI | Earth leakage circuit breaker (30mA) |
| Q1E | Overload protection |
| R1T | Thermistor (air) |
| R2T | Thermistor (discharge) |
| R3T | Thermistor (suction) |
| R4T | Thermistor (heat exchanger) |
| R5T | Thermistor (heat exchanger middle) |
| R6T | Thermistor (liquid) |
| R7T | Thermistor (fin) |
| R8 (A1P) | Resistor |
| S1PH | High pressure switch |
| S1PL | Low pressure switch |
| SEG1-3 (A1P) | 7-segment display |
| TC1 (A1P) | Signal transceiver circuit |
| U, V, W (A1P) | Connector |
| V1 (A2P) | Varistor |
| V1D (A1P) | Diode |
| V*R (A1P) | Diode module |
| X*A (A1-2P) | Connector |
| X1M | Terminal strip |
| Y1E, Y3E | Electronic expansion valve |
| Y1S | Solenoid valve (4-way valve) |
| Z*C | Noise filter (ferrite core) |
| Z*F (A1-2P) | Noise filter |

* : optional
: field supply

NOTES


1. Refer to the wiring diagram sticker (on the back of the front plate) for how to use the BS1-BS3 and DS1 switches.
2. When operating, do not short-circuit protection device(s) S1PH, S1PL and Q1E.
3. Refer to the combination table and the option manual for how to connect the wiring to X28A and X801M.
4. Colours: BLK:black; RED:red; BLU:blue; WHT:white; GRN:green

4D120910

11 Sound data

11 - 1 Sound Power Spectrum

RZAG71NV1
RZAG71NY1

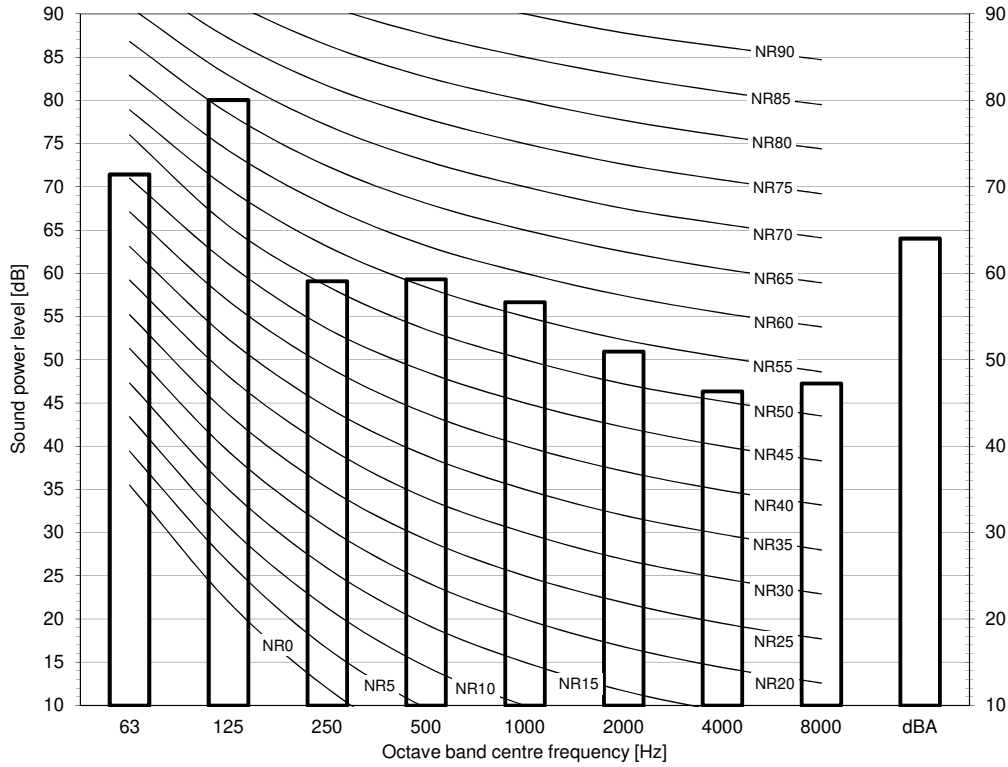


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $10^{-6} \mu\text{W}/\text{m}^2$.
- Measured according to ISO 3744

3D125149

RZAG100NV1
RZAG100NY1

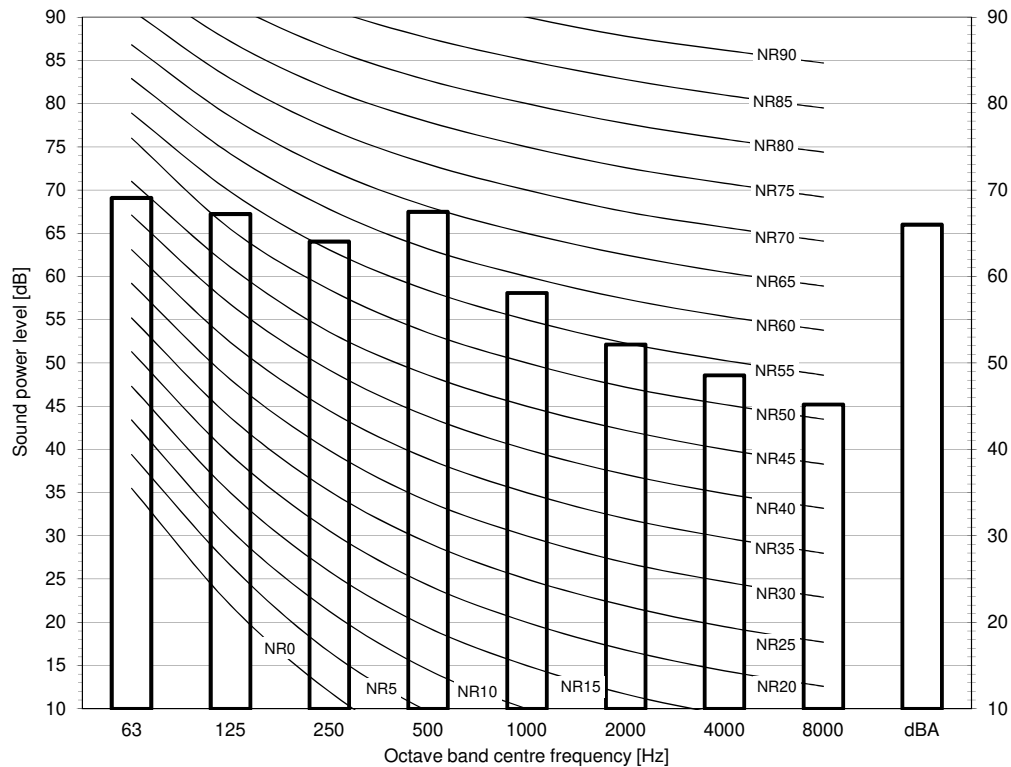

Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $10^{-6} \mu\text{W}/\text{m}^2$.
- Measured according to ISO 3744


3D125155

11 Sound data

11 - 1 Sound Power Spectrum

11

RZAG125NV1
RZAG125NY1

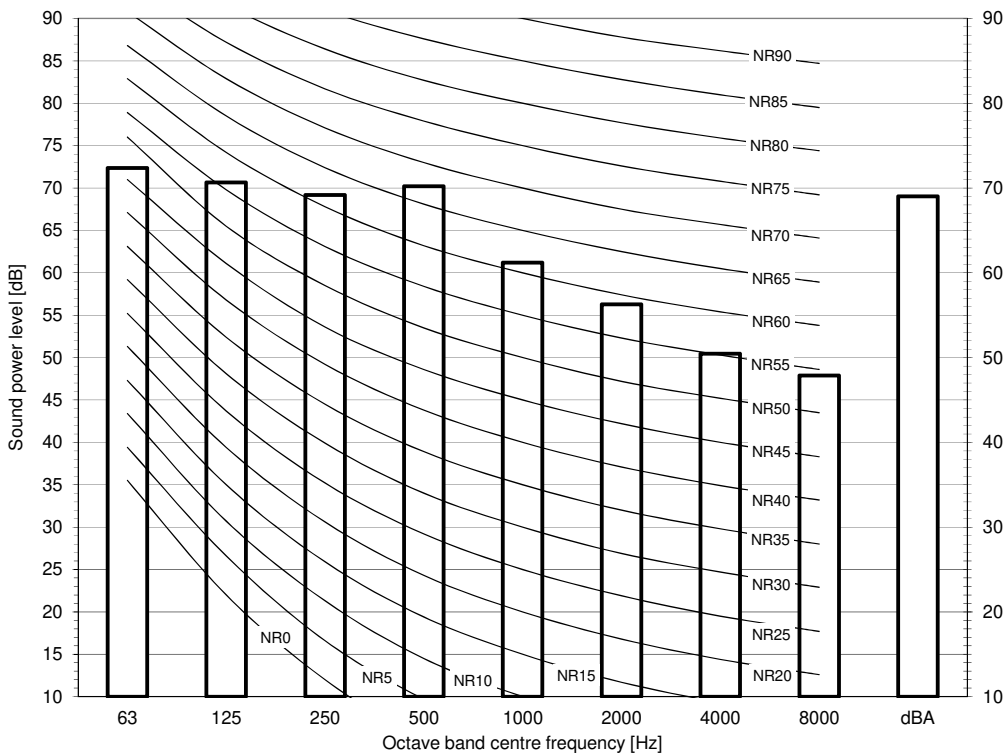


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $10E-6\mu W/m^2$.
- Measured according to ISO 3744

3D125161

RZAG140NV1
RZAG140NY1

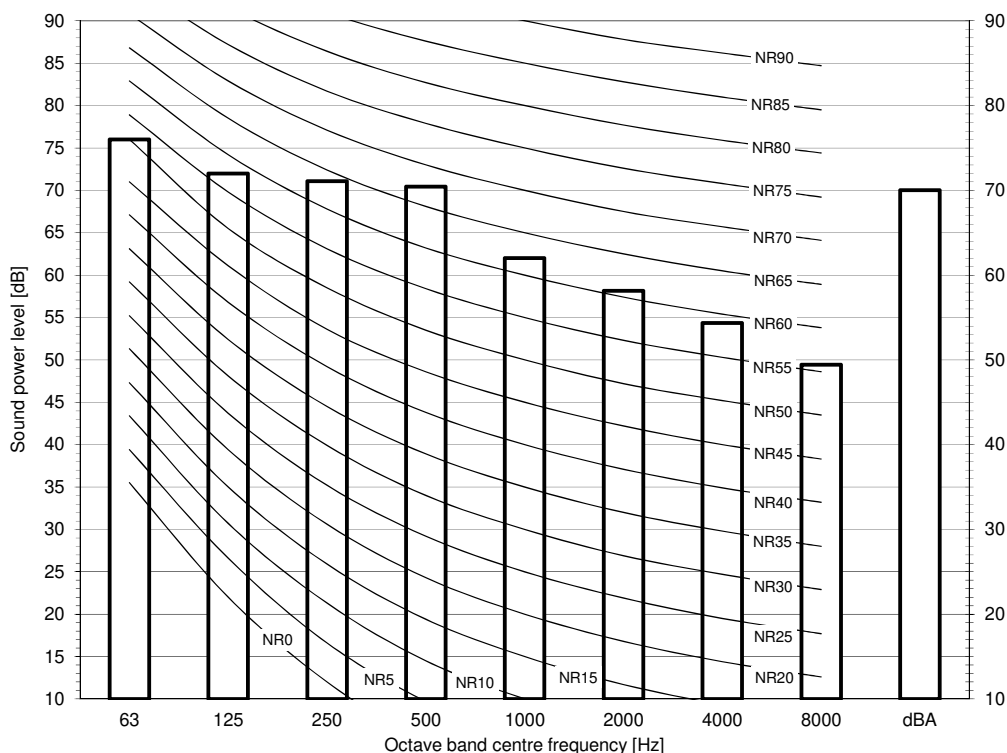

Notes


- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $10E-6\mu W/m^2$.
- Measured according to ISO 3744

3D125167

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

RZAG71NV1
RZAG71NY1

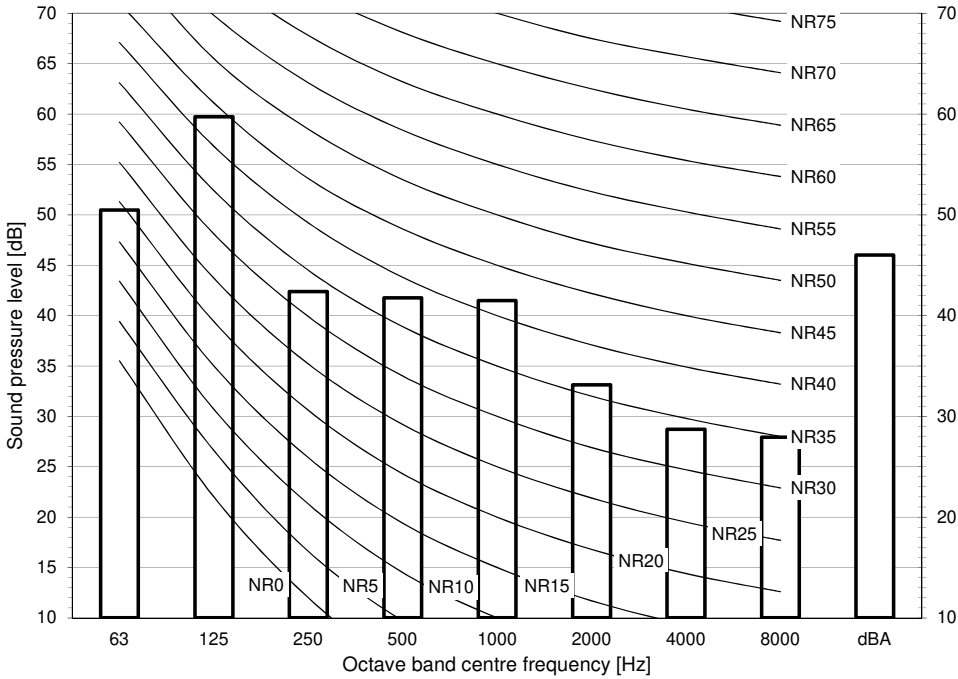


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125147

RZAG100NV1
RZAG100NY1

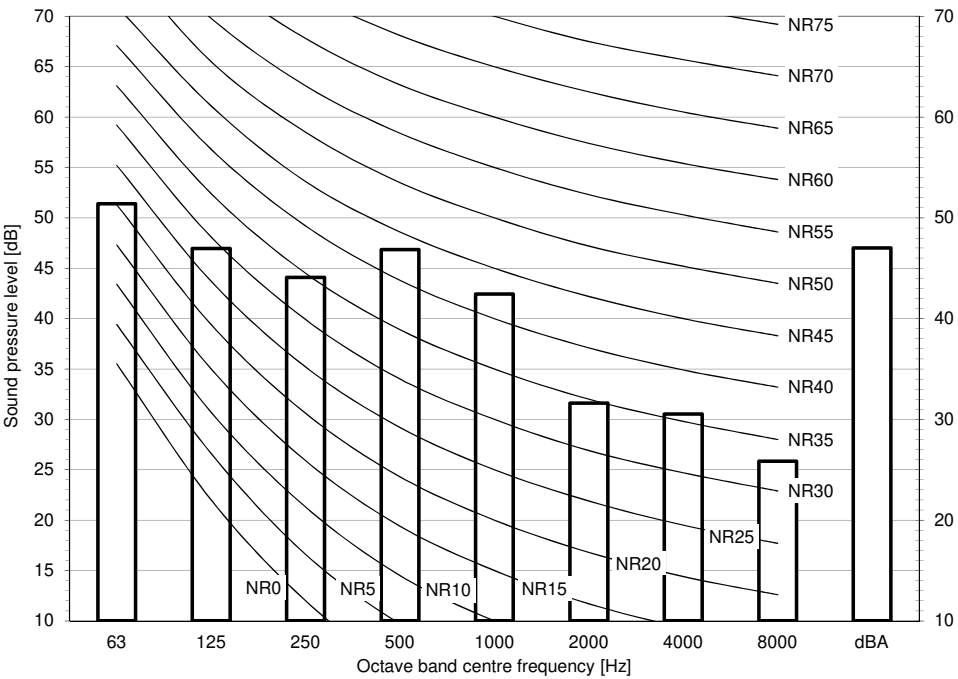

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa


3D125153

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

11

RZAG125NV1
RZAG125NY1

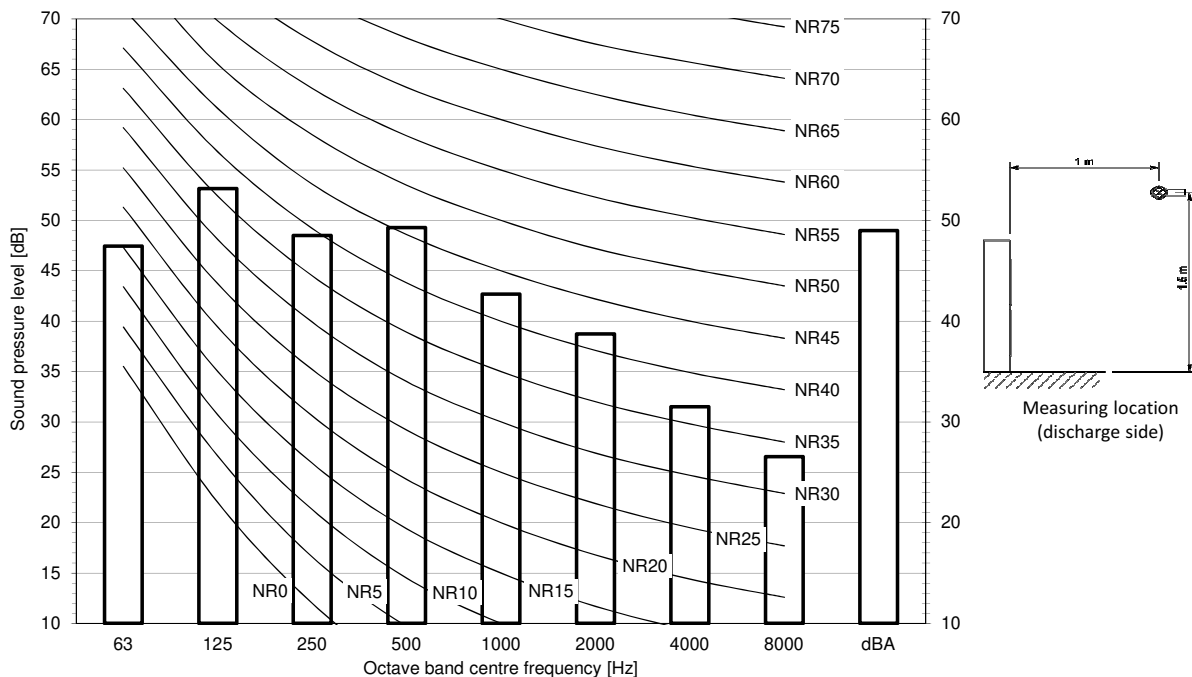


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125159

RZAG140NV1
RZAG140NY1

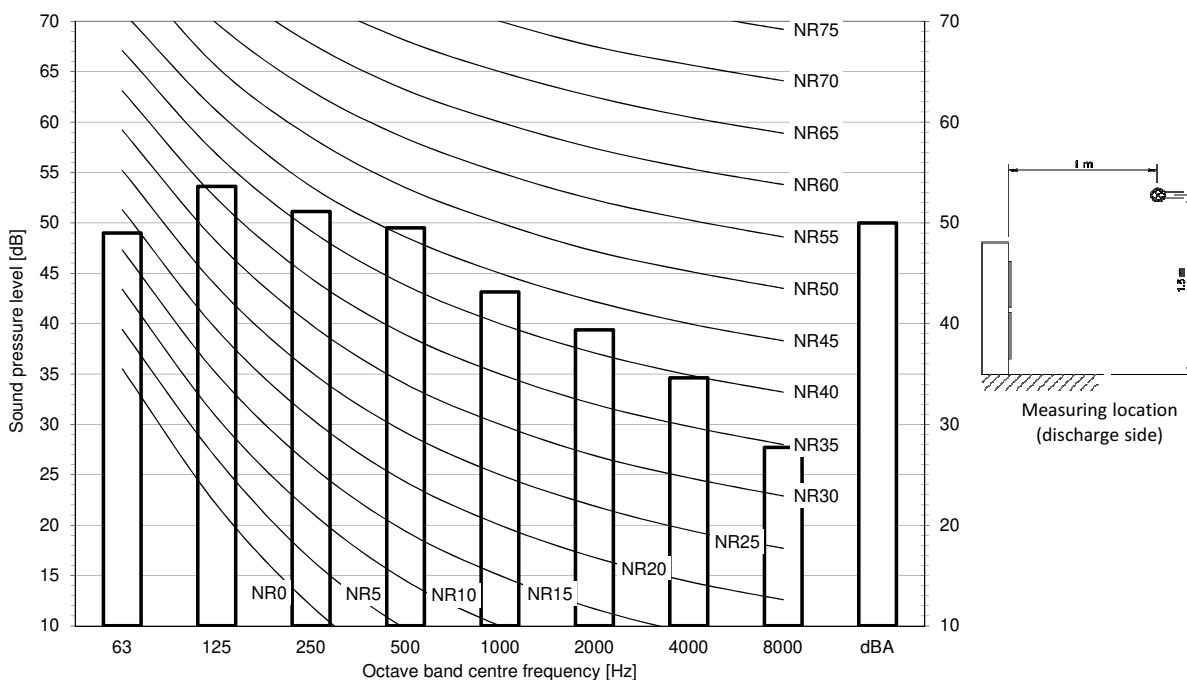

Notes



- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125165

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

RZAG71NV1
RZAG71NY1

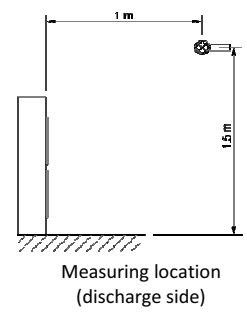
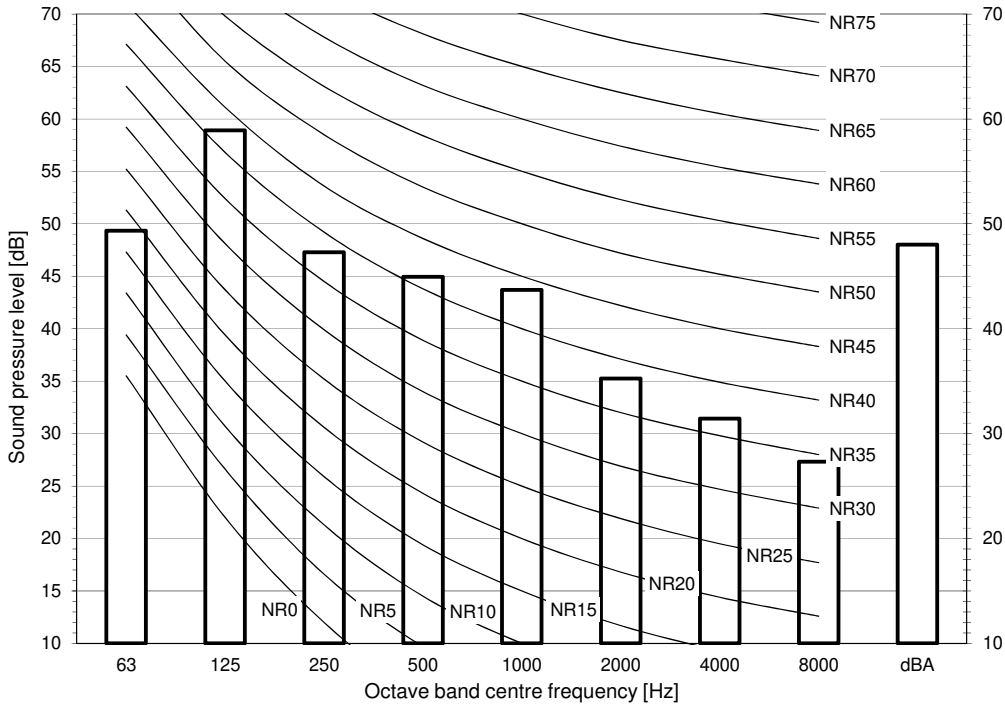


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125148

RZAG100NV1
RZAG100NY1

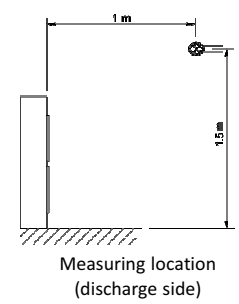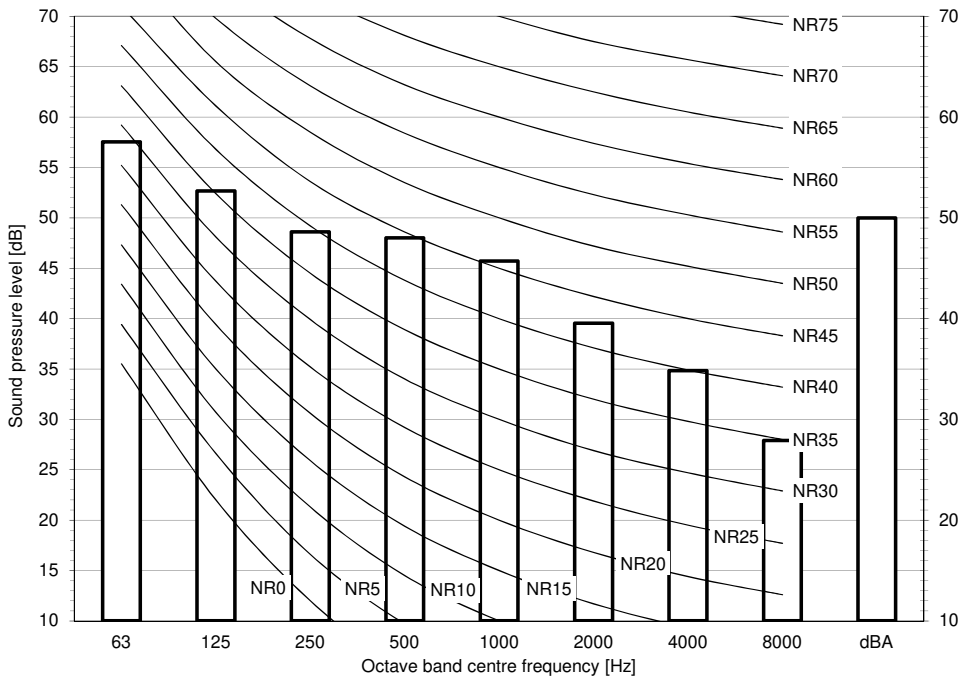

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa


3D125154

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

11

RZAG125NV1
RZAG125NY1

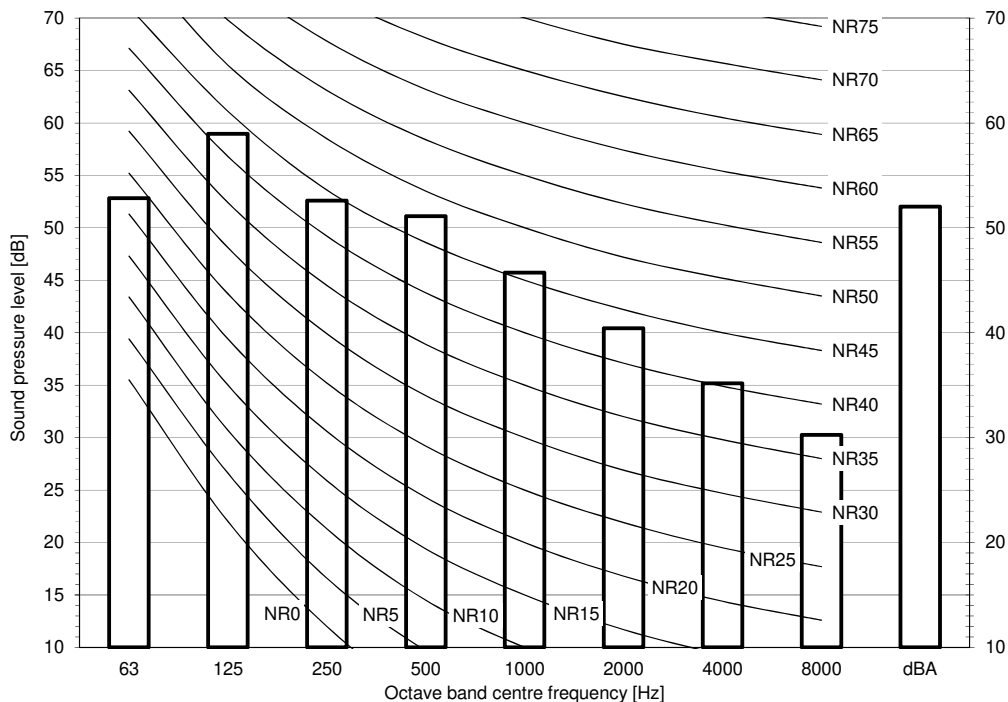


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125160

RZAG140NV1
RZAG140NY1

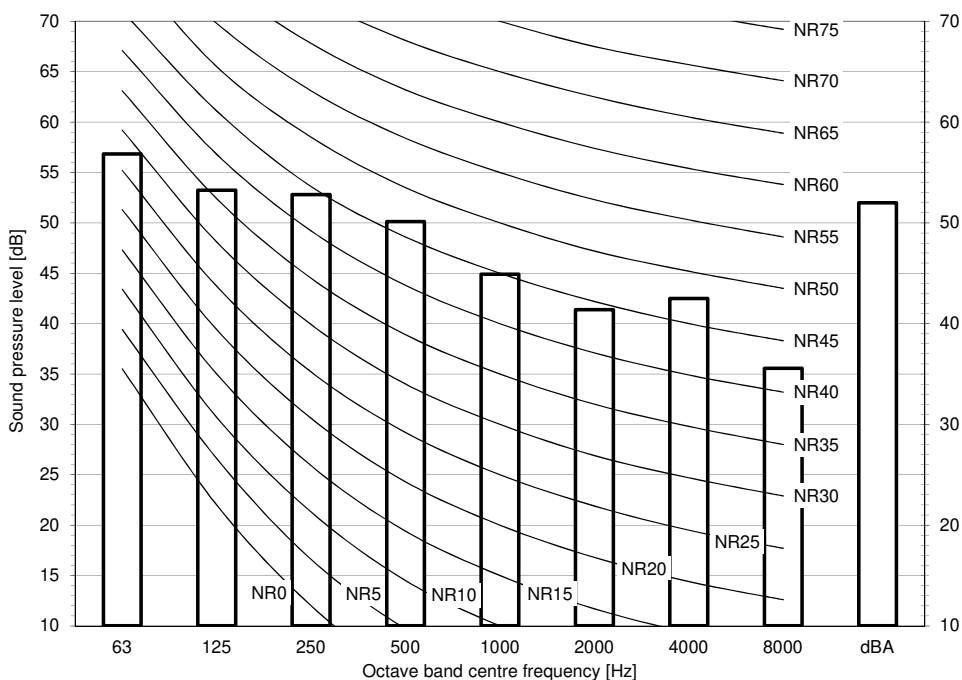

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa



3D125166

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

RZAG71NV1
RZAG71NY1

LEVEL 1

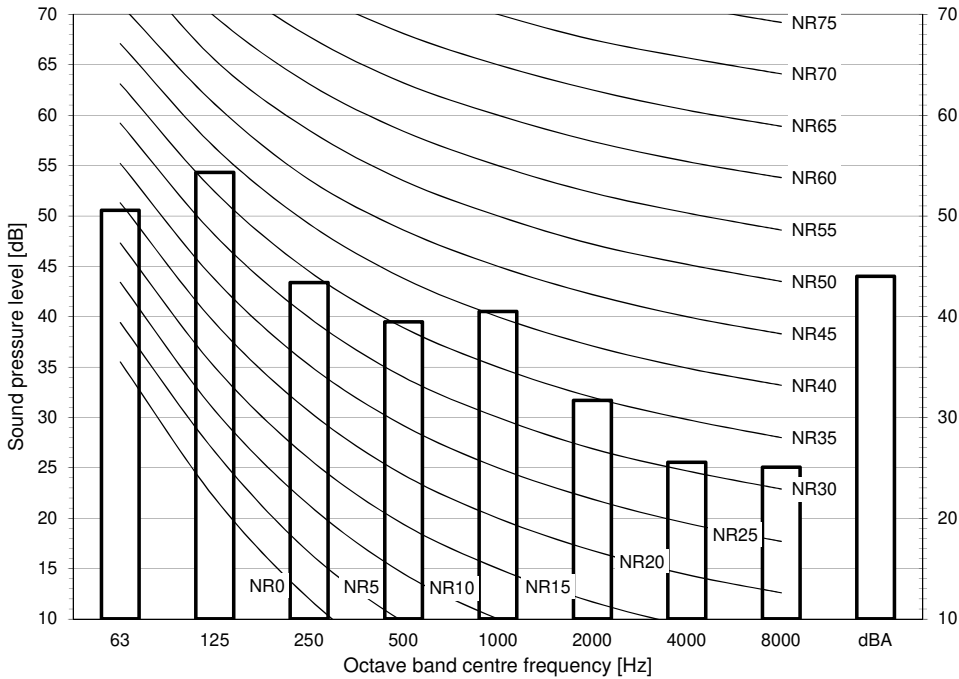



Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125144

RZAG100NV1
RZAG100NY1

LEVEL 1

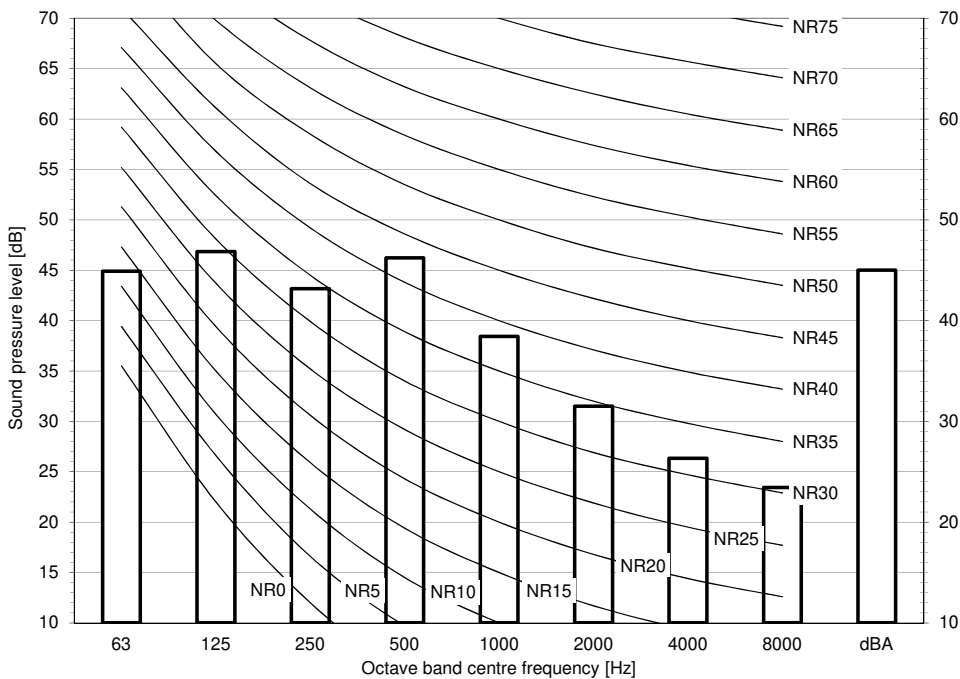

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125150



11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

11

RZAG125NV1
RZAG125NY1

LEVEL 1

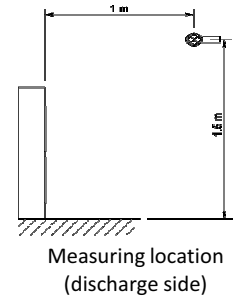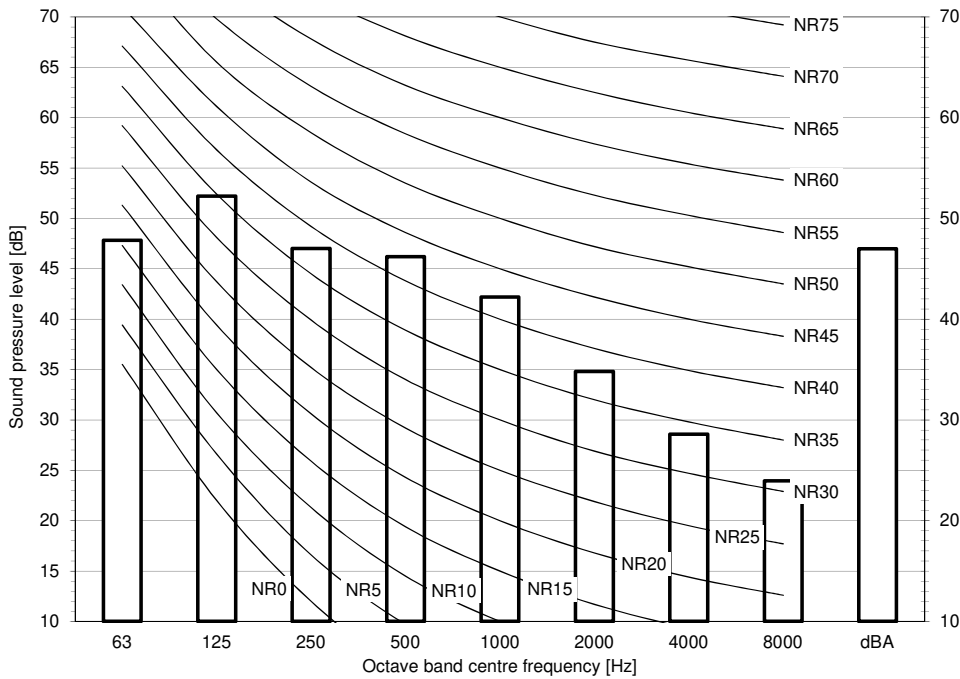



Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125156

RZAG140NV1
RZAG140NY1

LEVEL 1

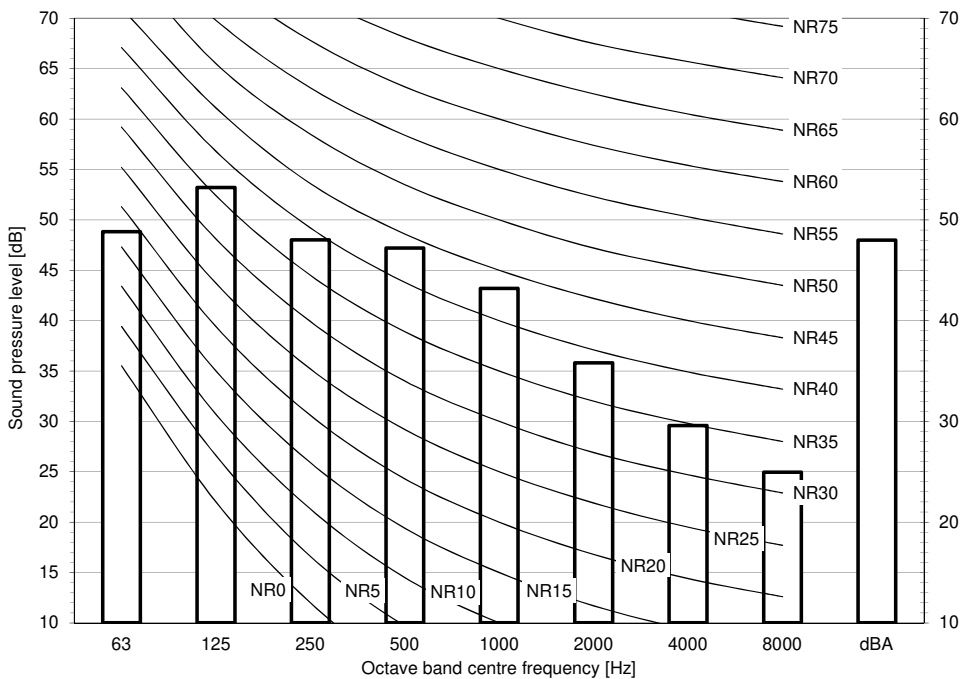

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa



3D125162

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

RZAG71NV1
RZAG71NY1

LEVEL 2

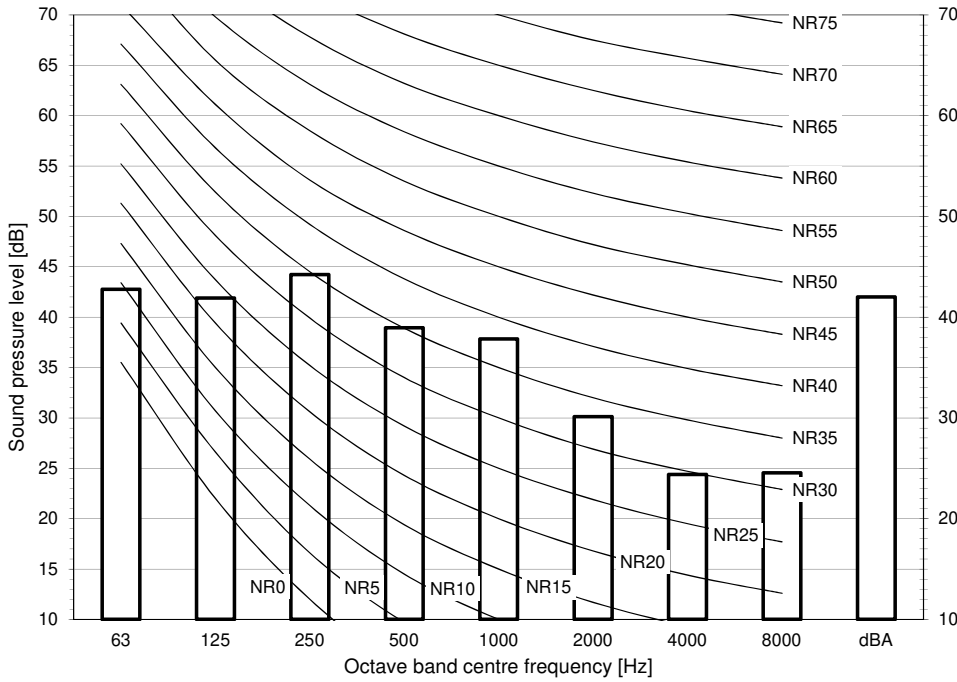



Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125145

RZAG100NV1
RZAG100NY1

LEVEL 2

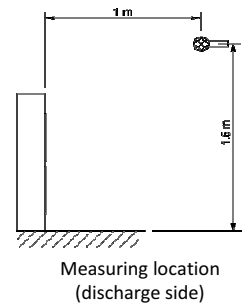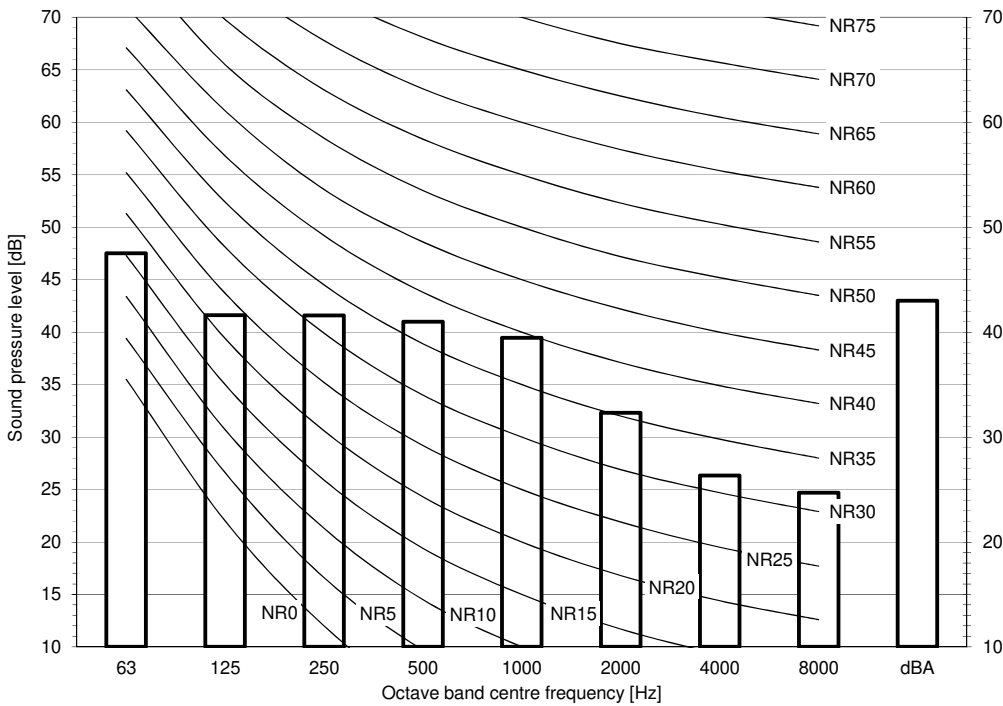

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125151


11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

11

RZAG125NV1
RZAG125NY1

LEVEL 2

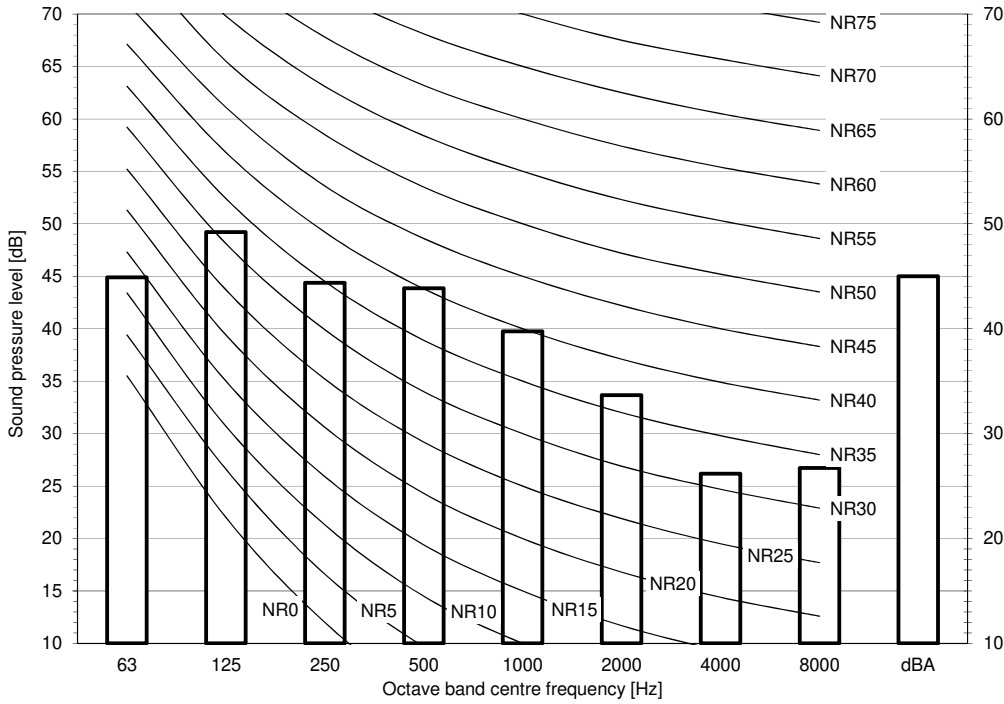


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125157

RZAG140NV1
RZAG140NY1

LEVEL 2

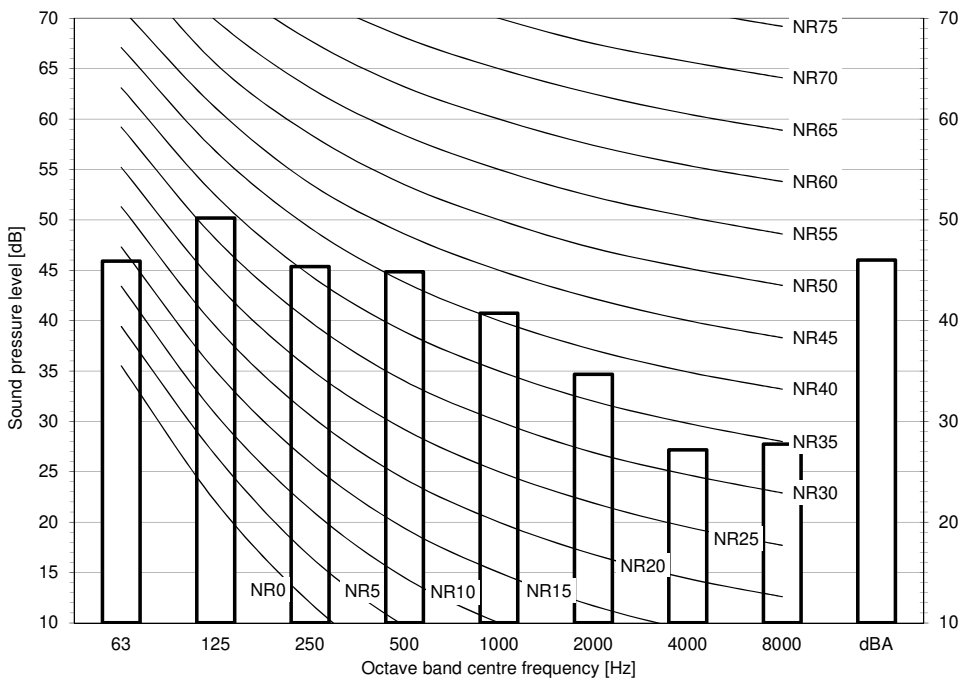

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa



3D125163

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

RZAG71NV1
RZAG71NY1

LEVEL 3

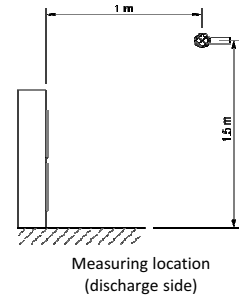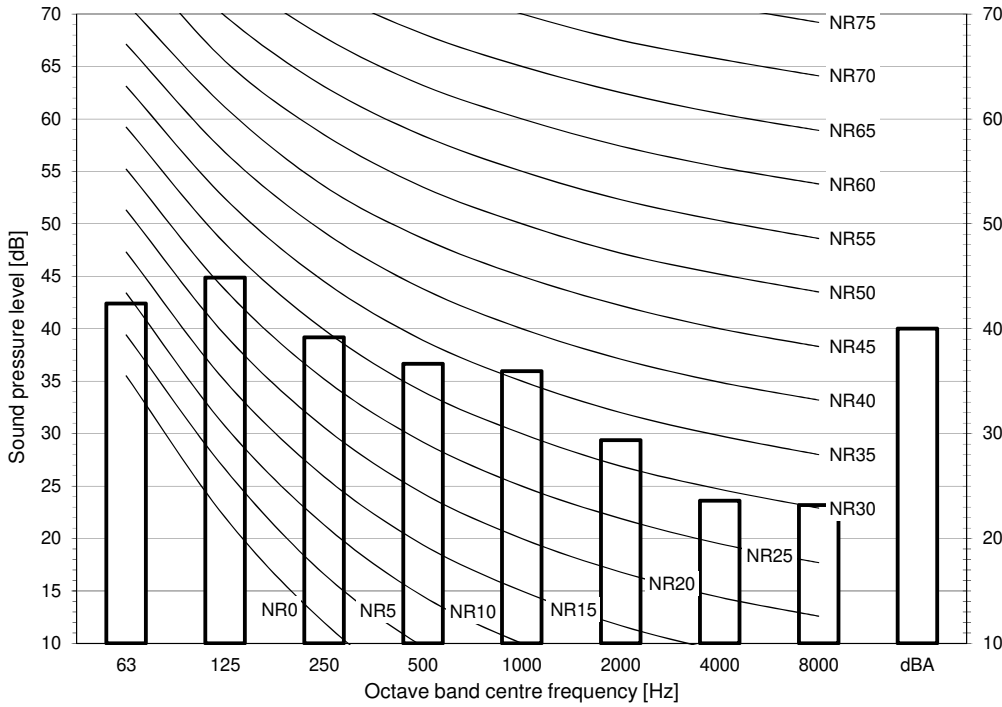



Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125146

RZAG100NV1
RZAG100NY1

LEVEL 3

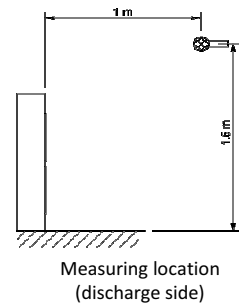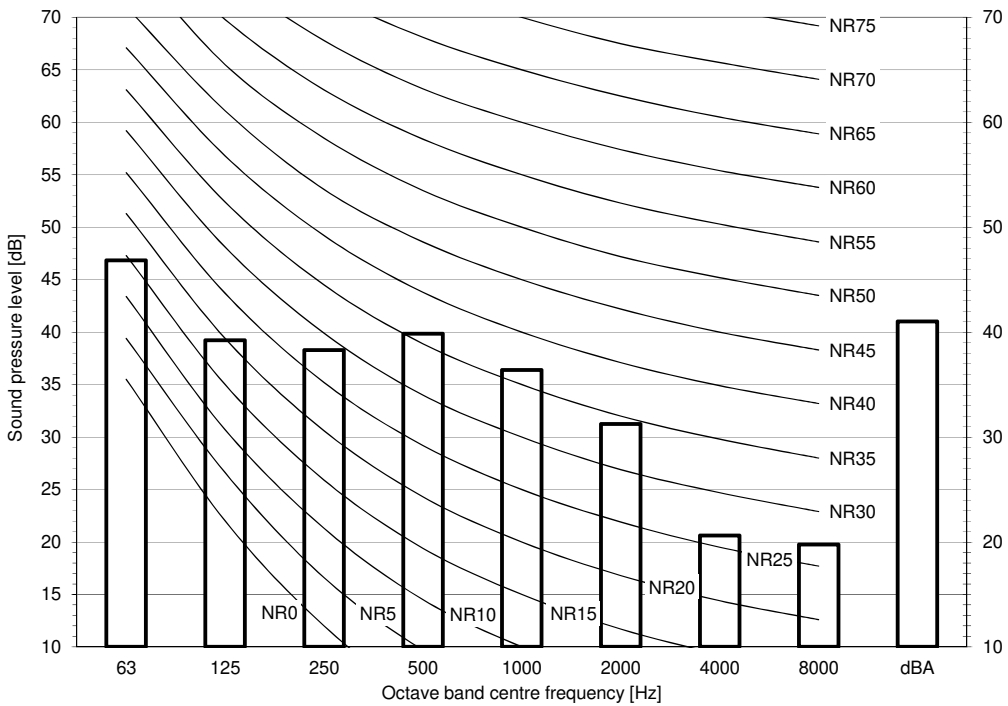



Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D125152

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

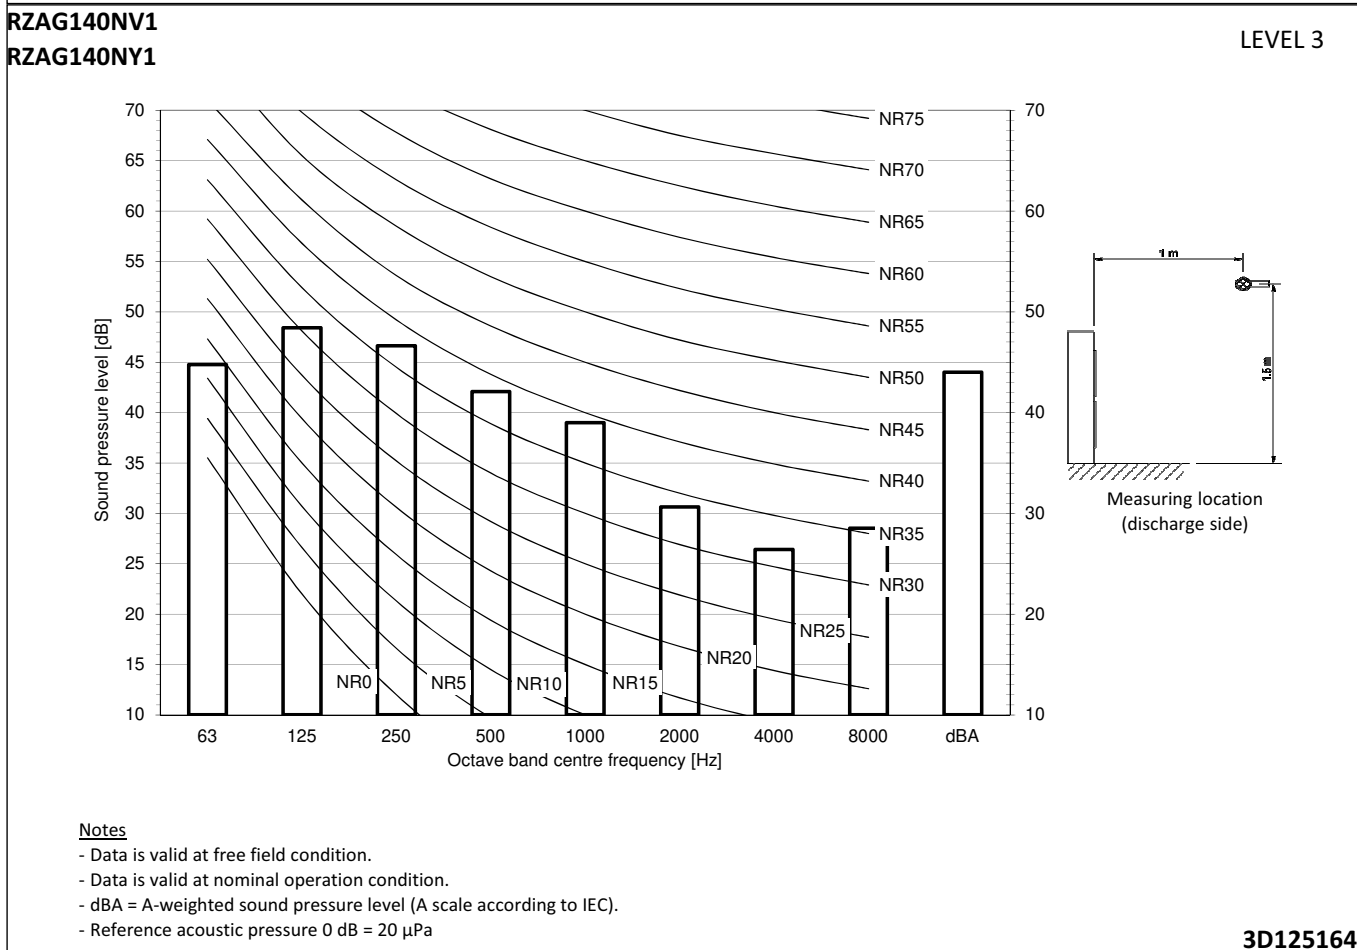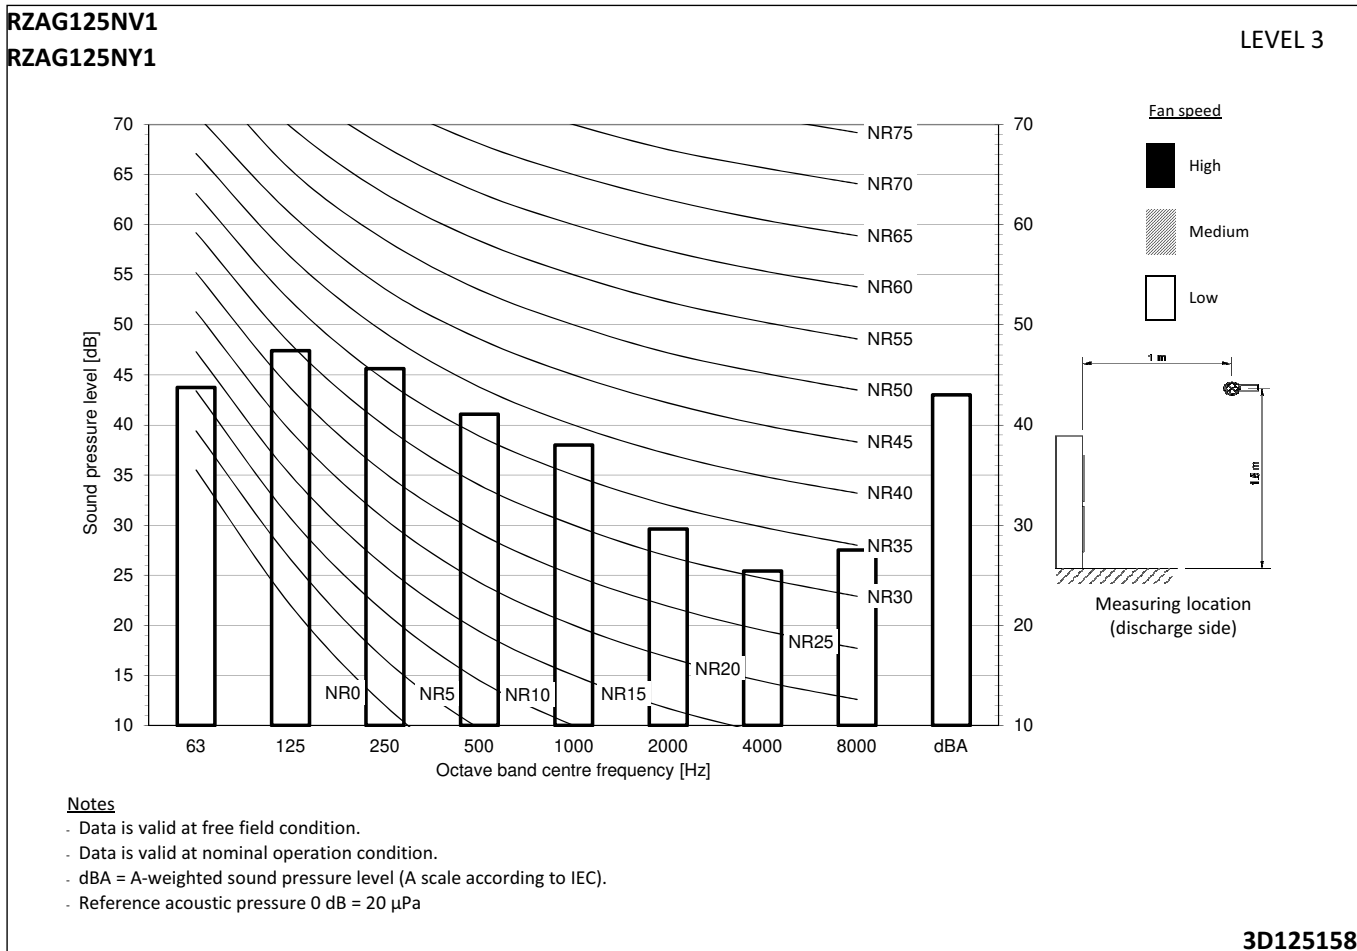

12 Installation

12 - 1 Installation Method

RZAG-NV1 RZAG-NY1


Installation service space

The measure of these values is "mm".


(A) When there are obstacles on suction sides.

• **No obstacle above**


- ① Stand-alone installation
 - Obstacle on the suction side only



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

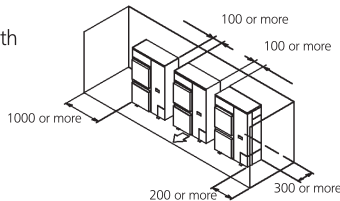


• **Obstacle above, too.**


- ① Stand-alone installation
 - Obstacle on the suction side, too



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

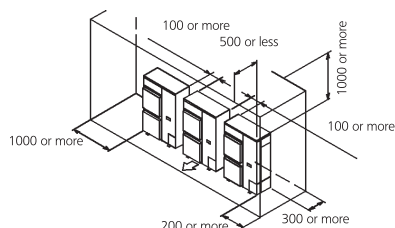


(B) When there are obstacles on discharge sides.

• **No obstacle above**

- ① Stand-alone installation
 - Obstacle on the discharge side only




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side only

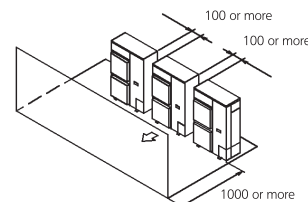


• **Obstacle above, too**

- ① Stand-alone installation
 - Obstacle on the discharge side only, too



- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side

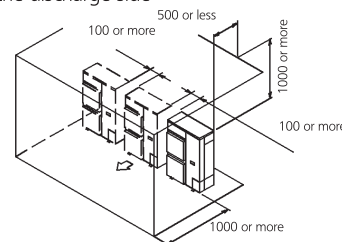


(C) When there are obstacles on both suction and discharge sides.:

Pattern 1


When the obstacles on the discharge side is higher than the unit. (L>H)
(There is no limit for the height of obstructions on the suction side.)

• **No obstacle above**

- ① Stand-alone installation
 - No obstacle above



- ② Series installation (2 or more) (Note 1)
 - No obstacle above

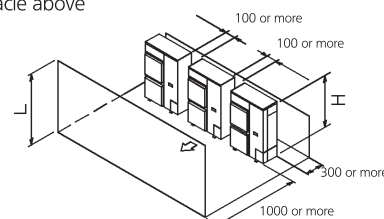

3D069554

12 Installation

12 - 1 Installation Method


RZAG-NV1 RZAG-NY1

● **Obstacle above, too**

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

| | L | A |
|------------|--|-----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 750 or more 1000 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on suction, discharge and top sides.


The relations between H, A and L are as follows.

| | L | A |
|------------|--|------------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 1000 or more 1250 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |

Limit of series installation is 2 units.


Pattern 2

When the obstacle on the discharge side is lower than the unit ($L \leq H$) (There is no limit for the height of obstructions on the suction side.)



● **No obstacle above**


- ① Stand-alone installation
 - No obstacle above



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on both suction and discharge sides.

The relations between H, A and L are as follows.

| | L | A |
|------------|--------------------------------------|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 250 or more 300 or more |

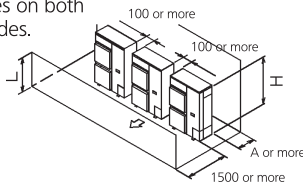


● **obstacle above**

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

| | L | A |
|------------|--|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 100 or more 200 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |




- ② Series installation (2 or more) (Note 1, 2)

- When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.



| | L | A |
|------------|--|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 250 or more 300 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |

Limit of series installation is 2 units.




(D) Double-decker installation

- ① Obstacle on the discharge side. (1)
 - Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.
- ② Obstacle on the suction side. (1)
 - Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.



(E) Multiple rows of series installation (on the rooftop, etc.)


- ① One row of stand-alone installation

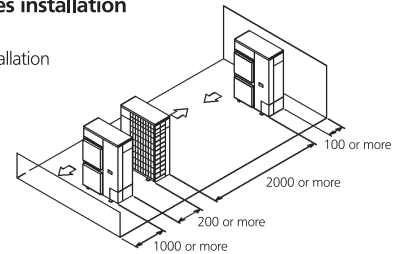

- ② Rows of series installation (2 or more)

The relations between H, A and L are as follows.

| | L | A |
|------------|--------------------------------------|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 250 or more 300 or more |
| $L > H$ | Can not be installed | |

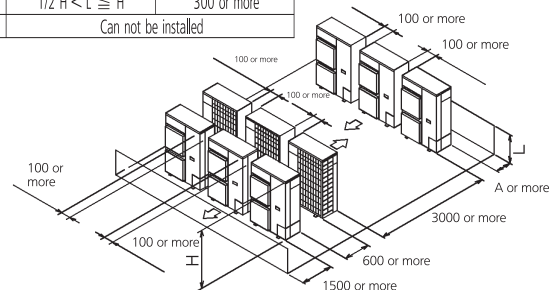


NOTES

- In case of the sideways's piping, make a 100mm gap between the unit above.
- Close the bottom of the installation frame to prevent the discharged air from being bypassed.
- It is not necessary to install a roof cover if there is no danger of drainage dripping and freezing. In this case, the space between the upper and lower outdoor units should be at least 100mm. Close off the gap between the upper and lower units so there is no reintake of discharged air.

12 Installation

12 - 1 Installation Method

RZAG-NV1
RZAG-NY1

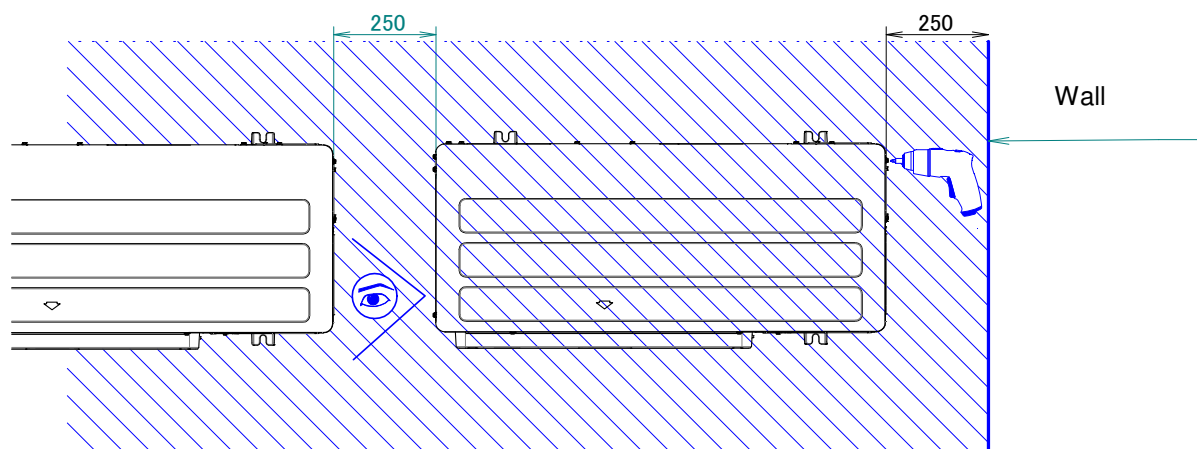

* For optimal serviceability, provide ≥ 250 mm of free space.
For more installation and service space guidelines, see drawing 3D069554.

3D120935


13 Operation range

13 - 1 Operation Range

13


RZAG-NV1 RZAG-NY1

Cooling

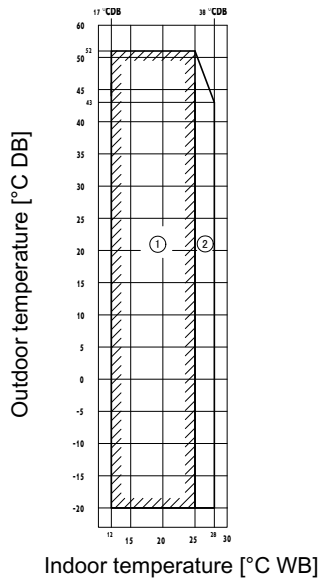

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

Heating

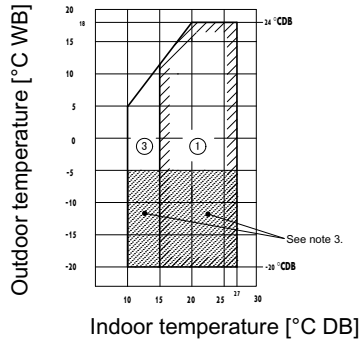

Notes


1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature < -5°C for 5 days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110020A


13 Operation range

13 - 2 Technical cooling application

RZAG-NV1
RZAG-NY1

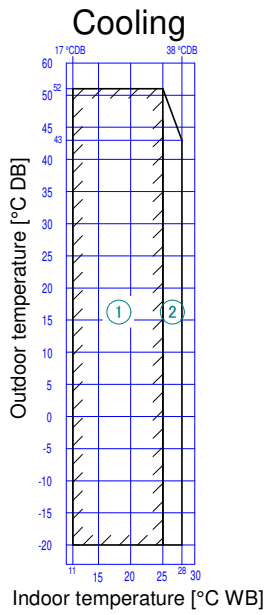

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

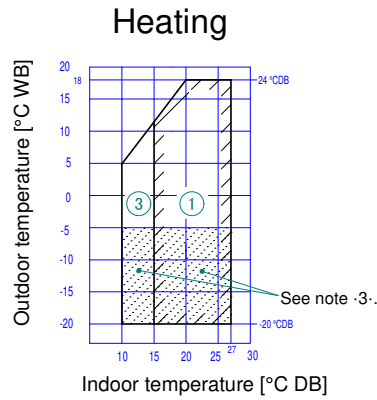

Notes

1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature -5°C for 5 days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110022

14 Appropriate Indoors

14 - 1 Appropriate Indoors

14

RZAG-NV1 RZAG-NY1

ENER Lot 21
Appropriate indoor units

Connectable to RZAG125N7V1B / RZAG125N7Y1B and covered by ENER Lot 21

| | | | | | | | | | | | |
|---------|---------|-------|--------|-------|--------|---|--------|--------|--------|--------|---|
| FCAG125 | FCAG35 | FFA35 | FBA35 | FNA35 | FUA125 | - | FDA125 | FVA125 | FDXM35 | FHA35 | - |
| - | FCAG50 | FFA50 | FBA50 | FNA50 | - | - | - | - | FDXM50 | FHA50 | - |
| - | FCAG60 | FFA60 | FBA60 | FNA60 | - | - | - | - | FDXM60 | FHA60 | - |
| - | FCAG125 | - | FBA125 | - | - | - | - | - | - | FHA125 | - |

Connectable to RZAG140N7V1B / RZAG140N7Y1B and covered by ENER Lot 21

| | | | | | | | | | | | |
|----------|---------|-------|--------|-------|-------|-------|---|--------|--------|--------|---|
| FCAHG71 | FCAG35 | FFA35 | FBA35 | FNA35 | FUA71 | FAA71 | - | FVA71 | FDXM35 | FHA35 | - |
| FCAHG140 | FCAG50 | FFA50 | FBA50 | FNA50 | - | - | - | FVA140 | FDXM50 | FHA50 | - |
| - | FCAG71 | - | FBA71 | - | - | - | - | - | - | FHA71 | - |
| - | FCAG140 | - | FBA140 | - | - | - | - | - | - | FHA140 | - |

ENER Lot 10
Appropriate indoor units

Connectable to RZAG71N7V1B / RZAG71N7Y1B and covered by ENER Lot 10

| | | | | | | | | | | | |
|---------|--------|-------|-------|-------|-------|-------|---|-------|--------|-------|---|
| FCAHG71 | FCAG35 | FFA35 | FBA35 | FNA35 | FUA71 | FAA71 | - | FVA71 | FDXM35 | FHA35 | - |
| - | FCAG71 | - | FBA71 | - | - | - | - | - | - | FHA71 | - |

Connectable to RZAG100N7V1B / RZAG100N7Y1B and covered by ENER Lot 10

| | | | | | | | | | | | |
|----------|---------|-------|--------|-------|--------|--------|---|--------|--------|--------|---|
| FCAHG100 | FCAG35 | FFA35 | FBA35 | FNA35 | FUA100 | FAA100 | - | FVA100 | FDXM35 | FHA35 | - |
| - | FCAG50 | FFA50 | FBA50 | FNA50 | - | - | - | - | FDXM50 | FHA50 | - |
| - | FCAG100 | - | FBA100 | - | - | - | - | - | - | FHA100 | - |

3D120939

RZAG125-140NV1 RZAG125-140NY1

ENER Lot 21
Recommended combinations

| Sky Air | | High Cassette | | | | Thin cassette | | | | 2x2 cassette | | | Duct (medium ESP) | | | | Concealed floor standing type | | | Ceiling-mounted - 4-way blow | | | Wall mounted type | | Duct (high ESP) | | | | | | | |
|--------------|--------------|---------------|---------|---------|---------|---------------|--------|--------|--------|--------------|---------|---------|-------------------|-------|-------|-------|-------------------------------|-------|-------|------------------------------|--------|--------|-------------------|-------|-----------------|-------|--------|--------|-------|--------|--------|---|
| Model | | FCAG71 | FCAG100 | FCAG125 | FCAG140 | FCAG35 | FCAG50 | FCAG60 | FCAG71 | FCAG100 | FCAG125 | FCAG140 | FFA35 | FFA50 | FFA60 | FBA35 | FBA50 | FBA60 | FBA71 | FBA100 | FBA125 | FBA140 | FNA35 | FNA50 | FNA60 | FUA71 | FUA100 | FUA125 | FAA71 | FAA100 | FDA125 | |
| RZAG125N7V1B | RZAG125N7Y1B | | | P | | 4 | | | | | | | | | | 4 | | | | | | | | | | | | | | | | P |
| RZAG140N7V1B | RZAG140N7Y1B | | | | P | 4 | | | | | | | | | | 4 | | | | | | | | | | | | | | | | P |


| Sky Air | | Floor standing type | | | | Slim duct | | | Ceiling-suspended | | | | | | Floor standing type | |
|--------------|--------------|---------------------|--------|--------|--------|-----------|--------|--------|-------------------|-------|-------|-------|--------|--------|---------------------|--------|
| Model | | FVA71 | FVA100 | FVA125 | FVA140 | FDXM35 | FDXM50 | FDXM60 | FHA35 | FHA50 | FHA60 | FHA71 | FHA100 | FHA125 | FHA140 | AVA125 |
| RZAG125N7V1B | RZAG125N7Y1B | | | P | | | | | | | | | | | | P |
| RZAG140N7V1B | RZAG140N7Y1B | | | | P | | | | | | | | | | | P |

P= Pair
2= Twin
3= Triple
4= Double twin

3D120939



Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEDEN19A 11/19



Daikin Europe N.V. participates in the Eurovent Certified Performance programme for Liquid Chilling Packages and Hydronic Heat Pumps, Fan Coil Units and Variable Refrigerant Flow systems. Check ongoing validity of certificate: www.eurovent-certification.com



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.