



Sky Air Alpha-series
Air Conditioning
Technical Data
RZAG-NY1



Table of contents

RZAG-NY1

1	Features	4
	RZAG-NY1	4
2	Specifications	5
3	Electrical data	16
	Electrical Data	16
4	Options	19
	Options	19
5	Combination table	20
	Combination Table	20
6	Capacity tables	21
	Cooling/Heating Capacity Tables	21
	Capacity Correction Factor	25
7	Dimensional drawings	26
	Dimensional Drawings	26
8	Centre of gravity	27
	Centre of Gravity	27
9	Piping diagrams	28
	Piping Diagrams	28
	Piping Diagram Twin Application	29
	Piping Diagram Triple Application	30
	Piping Diagram Double Twin Application	31
10	Wiring diagrams	32
	Wiring Diagrams - Single Phase	32
11	Sound data	33
	Sound Power Spectrum	33
	Sound Pressure Spectrum - Cooling	35
	Sound Pressure Spectrum - Heating	37
	Sound Pressure Spectrum Quiet Mode Level 1	39
	Sound Pressure Spectrum Quiet Mode Level 2	41
	Sound Pressure Spectrum Quiet Mode Level 3	43
12	Installation	45
	Installation Method	45
13	Operation Range	48
	Operation Range	48
14	Appropriate Indoors	49
	Appropriate Indoors	49

1 Features

1 - 1 RZAG-NY1

- › Unique, low-height single fan range
- › Compact dimensions allow almost unnoticeable installation
- › Market-leading serviceability and handling, thanks to wide access area, 7-segment display and additional handle
- › Top efficiency: - Energy labels up to A++ in both cooling and heating - compressor offers substantial efficiency improvements
- › Choosing for an R-32 product, reduces the environmental impact with 68% compared to R-410A, leads directly to lower energy consumption thanks to its high energy efficiency and has a lower refrigerant charge
- › The perfect balance in efficiency and comfort thanks to Variable Refrigerant Temperature: top seasonal efficiency throughout most of the year and quick reaction speed on the hottest days.
- › Suits high sensible, infrastructure cooling applications
- › Replace existing systems with R-32 technology without needing to replace the piping
- › Guarantees operation in both heating and cooling mode down to -20°C
- › Refrigerant cooled PCB guarantees reliable cooling, as it is not influenced by ambient temperature.
- › Maximum piping length up to 85m
- › Outdoor units for pair, twin, triple, double twin application



Infrastructure cooling



Inverter



Auto cooling-heating changeover

2 Specifications

1 - 1 RZAG-NY1

Technical Specifications					RZAG71NY1	RZAG100NY1	RZAG125NY1	RZAG140NY1
Casing	Colour	Ivory white						
	Material	Painted galvanized steel plate						
Dimensions	Unit	Height	mm	870				
		Width	mm	1,100				
		Depth	mm	460				
	Packed unit	Height	mm	1,043				
		Width	mm	1,205				
		Depth	mm	509				
Weight	Unit	kg	81	85	94			
	Packed unit	kg	92	96	105			
Packing	Weight	kg	10					
Heat exchanger	Fin	WF fin						
	Type Treatment	Anti-corrosion treatment (PE)						
Fan	Type	Propeller						
	Discharge direction	Horizontal						
	Quantity	1						
	Air flow rate	Cooling	Nom.	m ³ /min	68	67	80	87
Heating			Nom.	m ³ /min	75	82	80	87
Partial		m ³ /min	-	-	45 (1)			
Fan motor	Quantity	1						
	Model	Brushless DC motor						
	Output	W	234					
	Drive	Direct drive						
Compressor	Quantity	1						
	Type	Hermetically sealed swing compressor						
Operation range	Cooling	Ambient	Min.	°CDB	-20			
			Max.	°CDB	52			
	Heating	Ambient	Min.	°CWB	-20			
			Max.	°CWB	18			
Sound power level	Cooling		dB	64	66	69	70	
	Heating		dB	-	-	68 (1)	71 (1)	
Sound pressure level	Cooling	Nom.	dB	46	47	49	50	
	Heating	Nom.	dB	48	50	52		
Refrigerant	Type	R-32						
	Charge	kg	3.20		3.70			
	Charge	TCO ₂ Eq	2.16		2.50			
	Control	Expansion valve (electronic type)						
	GWP	675						
	Circuits	Quantity	1					
Refrigerant oil	Type	FW68DA						
	Charged volume	l	0.9		1.4			
Piping connections	Liquid	Quantity	1					
		Type	Flare connection					
	OD	mm	9,52					
Piping connections	Gas	Quantity	1					
		Type	Flare connection					
	OD	mm	15.9					
Drain	Quantity	8						
	Type	Hole						
	OD	mm	26					
	Piping length	OU - IU	Min.	m	3			
Max.			m	55	85			
System		Equivalent	m	75	100			
		Chargeless	m	40				
Additional refrigerant charge	kg/m	See installation manual						
Level difference	IU - OU	Max.	m	30				
Level difference	IU - IU		m	0.5				
Heat insulation	Both liquid and gas pipes							
Defrost method	Reversed cycle							
Defrost control	Sensor for outdoor heat exchanger temperature							
Capacity control	Method	Inverter controlled						
PED	Category	Category II						
	Most critical part	Name	Accumulator					
	Ps*V	Bar*l	136.5	143.0				
Safety devices	Item	01	High pressure switch					
		02	Low pressure switch					
	03	Fan driver overload protector						
	04	Fuse						
	05	Compressor motor thermal protector						

Standard accessories: Tie-wraps; Quantity: 2;

Standard accessories: Installation manual; Quantity: 1;

2 Specifications

1 - 1 RZAG-NY1

Standard accessories: General safety precautions; Quantity: 1;

Standard accessories: Peel off F-gas label; Quantity: 1;

Standard accessories: Refrigerant label for F-gas regulation; Quantity: 1;

2

Electrical Specifications			RZAG71NY1	RZAG100NY1	RZAG125NY1	RZAG140NY1
Power supply	Name		Y1			
	Phase		3~			
	Frequency	Hz	50			
	Voltage	V	380-415			
	Voltage range	V	342 457			
Current	Zmax	List	Complies to EN61000-3-11			
Wiring connections	For power supply	Remark	See installation manual outdoor unit			
	For connection with indoor	Remark	See installation manual outdoor unit			
Power supply intake			See installation manual outdoor unit			
Current - 50Hz	Maximum fuse amps (MFA)	A	16			

(1)According to ENER Lot 21

Capacity and power input			FCAHG71H + RZAG71NY1	FCAHG100H + RZAG71NY1	FCAHG100H + RZAG100NY1	FCAHG140H + RZAG100NY1	FCAHG125H + RZAG125NY1	FCAHG140H + RZAG140NY1
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)
Space cooling	Energy efficiency class		A++				-	
	Capacity Pdesign	kW	6.80		9.50		12.1	13.4
	SEER		7.90	7.05	7.70	7.49	8.02	7.93
	ηs,c	%	-				318	314
	Annual energy consumption	kWh/a	301	338	432	444	905	1,014
Space heating (Average climate)	Energy efficiency class		A+		A++		-	
	Capacity Pdesign	kW	4.70		9.52	7.80	9.52	
	SCOP/A		4.56	4.20	4.75	4.70	4.53	4.44
	SCOPnet/A		4.56	4.20	4.75	4.70	4.53	4.44
	ηs,h	%	-				178	175
	Annual energy consumption	kWh/a	1,443	1,567	2,805	2,324	2,943	3,002
	Required back up heating cap at design conditions	kW	0.00					
Space cooling	A	Pdc	6.80		9.50		12.10	13.40
	Condition (35°C - 27/19)	EERd	4.13	4.14	4.23	4.04	3.84	3.68
		Power input	1.65	1.64	2.25	2.35	3.15	3.64
	B	Pdc	5.01		7.00		8.92	9.88
	Condition (30°C - 27/19)	EERd	5.96	6.00	6.14	5.96	5.81	5.77
		Power input	0.84		1.14	1.18	1.54	1.71
	C	Pdc	3.22		4.50		5.74	6.35
	Condition (25°C - 27/19)	EERd	10.19	8.66	9.32	9.12	9.63	9.37
		Power input	0.32	0.37	0.48	0.49	0.60	0.68
	D	Pdc	2.64		3.71		3.61	
	Condition (20°C - 27/19)	EERd	14.60	10.83	12.87	12.38	13.99	14.07
		Power input	0.18	0.25	0.29		0.26	

2 Specifications

1 - 1 RZAG-NY1

Capacity and power input				FCAHG71H + RZAG71NY1	FCAHG100H + RZAG71NY1	FCAHG100H + RZAG100NY1	FCAHG140H + RZAG100NY1	FCAHG125H + RZAG125NY1	FCAHG140H + RZAG140NY1	
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-10						
		Pd _h (declared heating cap) kW		4.70		9.52	7.80	9.52		
		COP _d (declared COP)		2.91	2.94	2.79	2.95	2.22	2.23	
	Power input kW		1.62	1.60	3.42	2.64	4.29	4.27		
	TBivalent	T _{biv} (bivalent temperature) °C		-10						
		Pd _h (declared heating cap) kW		4.70		9.52	7.80	9.52		
		COP _d (declared COP)		2.91	2.94	2.79	2.95	2.22	2.23	
	A	Pd _h (declared heating cap) kW		4.16		4.14	8.42	6.86	8.42	
		COP _d (declared COP)		3.28	3.30	3.14	3.26	2.84	2.80	
		Power input kW		1.27	1.25	2.69	2.10	2.97	3.01	
	Condition (-7°C)	Pd _h (declared heating cap) kW		2.53		2.54	5.13	4.21	5.13	
		COP _d (declared COP)		4.53	4.30	4.79	4.75	4.58	4.42	
		Power input kW		0.56	0.59	1.07	0.89	1.12	1.16	
	B	Pd _h (declared heating cap) kW		1.79		1.89	3.30	2.73	3.30	
		COP _d (declared COP)		5.43	4.73	5.81	5.59	5.79	5.78	
		Power input kW		0.33	0.40	0.57	0.49	0.57		
	Condition (7°C)	Pd _h (declared heating cap) kW		2.01		2.11	2.58	2.60		
		COP _d (declared COP)		6.79	5.75	6.86	6.64	6.62	6.60	
Power input kW		0.30		0.37	0.38	0.39				
Space heating (Average climate)	D Condition (12°C)	Power input kW		0.30		0.37	0.38			
		Power consumption in other than active mode	Cooling PCK	kW		0.000				
			Heating PCK	kW		0.000				
Off mode	Cooling	POFF kW		0.009						
	Heating	POFF kW		0.009						
Standby mode	Cooling	PSB kW		0.009						
	Heating	PSB kW		0.009						
Thermostat-off mode	Cooling	PTO kW		0.005						
	Heating	PTO kW		0.013						
Indication if the heater is equipped with a supplementary heater (pair application)				No						
Supplementary heater (pair application)	Back-up capacity	Heating	elbu kW		0.0					
	Cooling	C _{dc} (Degradation cooling)			0.25					
Heating	C _{dh} (Degradation heating)			0.25						
Cooling function included				Yes						
Heating function included				Yes						
Average climate included				Yes						
Cold season included				No						
Warm season included				No						

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |
 (2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Capacity and power input				FCAAG71B + RZAG71NY1	FCAAG100B + RZAG71NY1	FCAAG100B + RZAG100NY1	FCAAG140B + RZAG100NY1	FCAAG125B + RZAG125NY1	FCAAG140B + RZAG140NY1
Cooling capacity	Nom.	kW		6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)
Heating capacity	Nom.	kW		7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)
Space cooling	Energy efficiency class			A++					
	Capacity	P _{design} kW		6.80		9.50		12.1	13.4
	SEER			6.83	7.50	7.14	7.86	7.15	6.80
	η _{s,c}	%		-		-		283	269
	Annual energy consumption	kWh/a		348	317	466	423	1,016	1,182
Space heating (Average climate)	Energy efficiency class			A+		A++		-	
	Capacity	P _{design} kW		4.70		7.80		9.52	
	SCOP/A			4.22	4.45	4.53	4.66	4.34	
	SCOP _{net} /A			4.22	4.45	4.53	4.66	4.34	
	η _{s,h}	%		-		-		171	
	Annual energy consumption	kWh/a		1,560	1,479	2,413	2,343	3,071	
	Required back up heating cap at design conditions	kW		0.00					

2 Specifications

1 - 1 RZAG-NY1

2

Capacity and power input				FCAG71B + RZAG71NY1	FCAG100B + RZAG71NY1	FCAG100B + RZAG100NY1	FCAG140B + RZAG100NY1	FCAG125B + RZAG125NY1	FCAG140B + RZAG140NY1
Space cooling	A	Pdc	kW	6.80		9.50		12.10	13.40
		Condition EERd		3.54	4.14	3.59	4.13	3.32	3.12
		(35°C - 27/19) Power input	kW	1.92	1.64	2.65	2.30	3.65	4.29
	B	Pdc	kW	5.03		7.03		8.92	9.88
		Condition EERd		5.43	5.65	5.83	5.76	5.65	4.47
		(30°C - 27/19) Power input	kW	0.93	0.89	1.21	1.22	1.58	2.21
	C	Pdc	kW	3.20		4.46		5.74	6.35
		Condition EERd		8.32	9.57	8.18	9.72	7.87	8.17
		(25°C - 27/19) Power input	kW	0.38	0.33	0.55	0.46	0.73	0.78
	D	Pdc	kW	2.40	2.65	3.31	3.61	3.25	3.32
Condition EERd			12.31	13.42	13.03	14.70	12.77	13.55	
(20°C - 27/19) Power input		kW	0.20		0.25				
Space heating (Average climate)	TOL	Tol (temperature operating °C limit)		-10					
		Pdh (declared heating cap) kW		4.70		7.80		9.52	
		COPd (declared COP)		2.54	2.88	2.51	2.73	1.91	1.93
		Power input kW		1.85	1.63	3.11	2.85	4.98	4.93
	TBivalent	Tbiv (bivalent temperature) °C		-10					
		Pdh (declared heating cap) kW		4.70		7.80		9.52	
		COPd (declared COP)		2.54	2.88	2.51	2.73	1.91	1.93
		Power input kW		1.85	1.63	3.11	2.85	4.98	4.93
	A	Pdh (declared heating cap) kW		4.13	4.14	6.86		8.43	8.42
		Condition COPd (declared COP)		2.96	3.25	2.87	3.04	2.59	2.52
		(-7°C) Power input kW		1.40	1.27	2.39	2.26	3.25	3.34
	B	Pdh (declared heating cap) kW		2.54		4.21		5.12	
		Condition COPd (declared COP)		4.23	4.46	4.37	4.65	4.29	4.33
		(2°C) Power input kW		0.60	0.57	0.96	0.91	1.20	1.18
	C	Pdh (declared heating cap) kW		1.77	1.80	2.73		3.29	
		Condition COPd (declared COP)		5.11	5.30	6.01	5.82	5.92	5.92
		(7°C) Power input kW		0.35	0.34	0.45	0.47	0.56	
	D	Pdh (declared heating cap) kW		1.96	2.02	2.47	2.51	2.52	
		Condition COPd (declared COP)		6.01	6.60	7.75	7.16	6.94	
		(12°C) Power input kW		0.33	0.31	0.32	0.35	0.36	
Space heating (Average climate)	D Condition (12°C)	Power input kW		0.33	0.31	0.32	0.35	0.36	
		Power consumption in other than active mode							
	Crankcase heater	Cooling PCK kW				0.000			
		Heating PCK kW				0.000			
	Off mode	Cooling POFF kW				0.009			
		Heating POFF kW				0.009			
	Standby mode	Cooling PSB kW				0.009			
		Heating PSB kW				0.009			
Thermostat-off mode	Cooling PTO kW				0.005				
	Heating PTO kW				0.013				
Indication if the heater is equipped with a supplementary heater (pair application)				No					
Supplementary heater (pair application)	Back-up capacity	Heating elbu kW		0.0					
		Cooling Cdc (Degradation cooling)		0.25					
Heating Cdh (Degradation heating)			0.25						
Cooling function included				Yes					
Heating function included				Yes					
Average climate included				Yes					
Cold season included				No					
Warm season included				No					

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Capacity and power input				FBA71A9 + RZAG71NY1	FBA100A + RZAG71NY1	FBA100A + RZAG100NY1	FBA140A + RZAG100NY1	FBA125A + RZAG125NY1	FBA140A + RZAG140NY1	
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)		
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)		
Space cooling	Energy efficiency class			A++	A+	A++		-		
	Capacity	Pdesign	kW	6.80		9.50		12.1	13.4	
	SEER			6.50	5.81	6.47	6.39	6.56	6.42	
	ηs,c		%	-		-		259	254	
	Annual energy consumption			kWh/a	366	410	514	520	1,107	1,252

2 Specifications

1 - 1 RZAG-NY1

Capacity and power input					FBA71A9 + RZAG71NY1	FBA100A + RZAG71NY1	FBA100A + RZAG100NY1	FBA140A + RZAG100NY1	FBA125A + RZAG125NY1	FBA140A + RZAG140NY1	
Space heating (Average climate)	Energy efficiency class		A+								
	Capacity	Pdesign	kW		4.70		7.80		9.52		
	SCOP/A		4.20	4.06	4.36	4.20	4.37	4.34			
	SCOPnet/A		4.20	4.06	4.36	4.20	4.37	4.34			
	ηs,h		%		-		172		171		
	Annual energy consumption		kWh/a		1,566	1,621	2,505	2,600	3,050	3,070	
	Required back up heating cap at design conditions		kW		0.00						
Space cooling	A	Pdc	kW		6.80		9.50		12.10	13.40	
	Condition	EERd	3.40	4.15	3.69	4.18	3.27	2.86			
	(35°C - 27/19)	Power input	kW		2.00	1.64	2.58	2.27	3.70	4.69	
	B	Pdc	kW		5.03		7.03		8.92	9.88	
	Condition	EERd	5.07	4.39	4.92	4.69	4.95	4.64			
	(30°C - 27/19)	Power input	kW		0.99	1.15	1.43	1.50	1.80	2.13	
	C	Pdc	kW		3.20		4.46	4.47	5.74	6.35	
	Condition	EERd	7.94	7.06	7.80	7.62	7.45	7.47			
	(25°C - 27/19)	Power input	kW		0.40	0.45	0.57	0.59	0.77	0.85	
	D	Pdc	kW		2.44	2.68	3.33	3.66	3.34	3.50	
	Condition	EERd	12.41	9.51	11.22	11.10	11.49	12.13			
	(20°C - 27/19)	Power input	kW		0.20	0.28	0.30	0.33	0.29		
	Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C		-10					
		Pdh (declared heating cap)		kW		4.70		7.80		9.52	
COPd (declared COP)			2.50	2.69	2.46	2.52	1.97	2.01			
Power input			kW		1.88	1.75	3.17	3.09	4.83	4.74	
TBivalent		Tbiv (bivalent temperature)	°C		-10						
Pdh (declared heating cap)			kW		4.70		7.80		9.52		
COPd (declared COP)			2.50	2.69	2.46	2.52	1.97	2.01			
Power input			kW		1.88	1.75	3.17	3.09	4.83	4.74	
A		Pdh (declared heating cap)	kW		4.14		6.87	6.86	8.42	8.43	
Condition		COPd (declared COP)	2.92	3.04	2.82	2.80	2.67	2.58			
(-7°C)		Power input	kW		1.42	1.36	2.43	2.45	3.15	3.26	
B		Pdh (declared heating cap)	kW		2.54		4.21		5.12		
Condition		COPd (declared COP)	4.21	4.10	4.33	4.20	4.37	4.32			
(2°C)		Power input	kW		0.60	0.62	0.97	1.00	1.17	1.18	
C		Pdh (declared heating cap)	kW		1.76	1.83	2.73		3.29		
Condition		COPd (declared COP)	5.12	4.74	5.47	5.16	5.76	5.83			
(7°C)		Power input	kW		0.34	0.39	0.50	0.53	0.57		
D		Pdh (declared heating cap)	kW		1.96	2.05	2.51	2.55		2.56	
Condition		COPd (declared COP)	6.12	5.85	6.91	6.28	6.73	6.86			
(12°C)											
Space heating (Average climate)		D Condition	Power input	kW		0.32	0.35	0.36	0.41	0.38	0.37
		Power consumption in other than active mode	Crankcase heater	Cooling	PCK	kW	0.000				
			Heating	PCK	kW	0.000					
	Off mode		Cooling	POFF	kW	0.011					
			Heating	POFF	kW	0.011					
	Standby mode		Cooling	PSB	kW	0.011					
			Heating	PSB	kW	0.011					
Thermostat-off mode	Cooling		PTO	kW	0.005						
	Heating	PTO	kW	0.015							
Indication if the heater is equipped with a supplementary heater (pair application)					No						
Supplementary heater (pair application)	Back-up capacity	Heating	elbu	kW	0.0						
	Cooling	Cdc (Degradation cooling)			0.25						
Heating	Cdh (Degradation heating)				0.25						
Cooling function included					Yes						
Heating function included					Yes						
Average climate included					Yes						
Cold season included					No						
Warm season included					No						

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Capacity and power input					FDA125A + RZAG125NY1
Cooling capacity	Nom.	kW		12.1 (1)	

2 Specifications

1 - 1 RZAG-NY1

Capacity and power input				FDA125A + RZAG125NY1		
Heating capacity	Nom.		kW	13.5 (2)		
Space cooling	Capacity Pdesign		kW	12.1		
	SEER			6.59		
	$\eta_{s,c}$		%	261		
	Annual energy consumption		kWh/a	1,102		
Space heating (Average climate)	Capacity Pdesign		kW	9.52		
	SCOP/A			4.35		
	SCOPnet/A			4.35		
	$\eta_{s,h}$		%	171		
	Annual energy consumption		kWh/a	3,064		
	Required back up heating cap at design conditions		kW	0.00		
Space cooling	A	Pdc	kW	12.10		
	Condition	EERd		3.25		
	(35°C - 27/19)	Power input	kW	3.73		
	B	Pdc	kW	8.92		
	Condition	EERd		4.99		
	(30°C - 27/19)	Power input	kW	1.79		
	C	Pdc	kW	5.73		
	Condition	EERd		7.67		
	(25°C - 27/19)	Power input	kW	0.75		
	D	Pdc	kW	3.34		
	Condition	EERd		11.04		
	(20°C - 27/19)	Power input	kW	0.30		
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C	-10		
		Pdh (declared heating cap)	kW	9.52		
		COPd (declared COP)		1.99		
		Power input	kW	4.78		
	TBivalent	Tbiv (bivalent temperature)	°C	-10		
		Pdh (declared heating cap)	kW	9.52		
		COPd (declared COP)		1.99		
		Power input	kW	4.78		
	A	Pdh (declared heating cap)	kW	8.42		
		Condition	COPd (declared COP)		2.69	
		(-7°C)	Power input	kW	3.13	
	B	Pdh (declared heating cap)	kW	5.12		
		Condition	COPd (declared COP)		4.33	
	(2°C)	Power input	kW	1.18		
		C	Pdh (declared heating cap)	kW	3.29	
	Condition		COPd (declared COP)		5.73	
	(7°C)	Power input	kW	0.58		
		D	Pdh (declared heating cap)	kW	2.58	
	Condition		COPd (declared COP)		6.68	
	(12°C)	Power input	kW	0.39		
		Power consumption in other than active mode	Crankcase heater mode	Cooling PCK	kW	0.000
	Power consumption in other than active mode	Crankcase heater mode	Heating	PCK	kW	0.000
			Cooling	POFF	kW	0.012
		Off mode	Heating	POFF	kW	0.012
Cooling			PSB	kW	0.012	
Standby mode		Heating	PSB	kW	0.012	
		Cooling	PTO	kW	0.005	
Thermostat-off mode		Heating	PTO	kW	0.016	
		Indication if the heater is equipped with a supplementary heater (pair application)			No	
Supplementary heater (pair application)	Back-up capacity	Heating elbu	kW	0.0		
Cooling	Cdc (Degradation cooling)			0.25		
Heating	Cdh (Degradation heating)			0.25		
Cooling function included				Yes		
Heating function included				Yes		
Average climate included				Yes		
Cold season included				No		
Warm season included				No		

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

1 - 1 RZAG-NY1

Capacity and power input					FAA71A + RZAG71NY1	FAA100A + RZAG71NY1	FAA100A + RZAG100NY1
Cooling capacity	Nom.		kW		6.80 (1)		9.50 (1)
Heating capacity	Nom.		kW		7.50 (2)		10.8 (2)
Space cooling	Energy efficiency class				A++		
	Capacity	Pdesign	kW		6.80		9.50
	SEER			6.58		6.43	6.42
	Annual energy consumption		kWh/a	362		370	518
Space heating (Average climate)	Energy efficiency class				A+		
	Capacity	Pdesign	kW		4.70		7.80
	SCOP/A			4.20		4.10	4.01
	SCOPnet/A			4.20		4.10	4.01
	Annual energy consumption		kWh/a	1,567		1,605	2,723
	Required back up heating cap at design conditions		kW		0.00		
Space cooling	A	Pdc	kW		6.80		9.50
	Condition	EERd		3.27		3.77	3.74
	(35°C - 27/19)	Power input	kW	2.08		1.80	2.54
	B	Pdc	kW		5.03		7.03
	Condition	EERd		4.54		4.85	4.76
	(30°C - 27/19)	Power input	kW	1.11		1.04	1.48
	C	Pdc	kW		3.22		4.46
	Condition	EERd		9.30		8.05	7.70
	(25°C - 27/19)	Power input	kW	0.35		0.40	0.58
	D	Pdc	kW		2.40		3.43
	Condition	EERd		11.11		10.79	11.08
	(20°C - 27/19)	Power input	kW	0.22		0.23	0.31
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C		-10		
		Pdh (declared heating cap)	kW		4.70		7.80
		COPd (declared COP)		2.51		2.74	2.19
		Power input	kW	1.88		1.71	3.57
	TBivalent	Tbiv (bivalent temperature)	°C		-10		
		Pdh (declared heating cap)	kW		4.70		7.80
		COPd (declared COP)		2.51		2.74	2.19
		Power input	kW	1.88		1.71	3.57
	A	Pdh (declared heating cap)	kW		4.14		6.86
	Condition	COPd (declared COP)		2.91		3.07	2.53
	(-7°C)	Power input	kW	1.42		1.35	2.71
	B	Pdh (declared heating cap)	kW		2.54		4.21
	Condition	COPd (declared COP)		4.20		4.11	3.94
	(2°C)	Power input	kW	0.60		0.62	1.07
	C	Pdh (declared heating cap)	kW		1.76		2.73
	Condition	COPd (declared COP)		5.14		4.81	5.19
	(7°C)	Power input	kW	0.34		0.37	0.53
	D	Pdh (declared heating cap)	kW		1.96		2.47
	Condition	COPd (declared COP)		6.09		5.94	6.61
	(12°C)	Power input	kW	0.32		0.34	0.37
Power consumption in other than active mode	Crankcase heater mode	Cooling	PCK	kW	0.000		
Power consumption in other than active mode	Crankcase heater mode	Heating	PCK	kW	0.000		
	Off mode	Cooling	POFF	kW	0.009		
		Heating	POFF	kW	0.009		
	Standby mode	Cooling	PSB	kW	0.009		
		Heating	PSB	kW	0.009		
	Thermostat-off mode	Cooling	PTO	kW	0.005		
		Heating	PTO	kW	0.013		
Indication if the heater is equipped with a supplementary heater (pair application)					No		
Supplementary heater (pair application)	Back-up capacity	Heating	elbu	kW	0.0		
Cooling	Cdc (Degradation cooling)				0.25		
Heating	Cdh (Degradation heating)				0.25		
Cooling function included					Yes		
Heating function included					Yes		
Average climate included					Yes		
Cold season included					No		
Warm season included					No		

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

1 - 1 RZAG-NY1

Capacity and power input				FHA71A9 + RZAG71NY1	FHA100A + RZAG71NY1	FHA100A + RZAG100NY1	FHA140A + RZAG100NY1	FHA125A + RZAG125NY1	FHA140A + RZAG140NY1
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)		13.4 (1)
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)		15.5 (2)
Space cooling	Energy efficiency class		A++						
	Capacity Pdesign	kW	6.80		9.50		12.1		13.4
	SEER		7.11	6.69	6.42	7.35	7.14	6.42	
	ηs,c	%	-						
	Annual energy consumption	kWh/a	335	356	518	453	1,017	1,253	
Space heating (Average climate)	Energy efficiency class		A+						
	Capacity Pdesign	kW	4.70		7.80		9.52		
	SCOP/A		4.32	4.26	4.61	4.50	4.20	4.30	
	SCOPnet/A		4.32	4.26	4.61	4.50	4.20	4.30	
	ηs,h	%	-						
	Annual energy consumption	kWh/a	1,523	1,545	2,369	2,429	3,174	3,100	
	Required back up heating cap at design conditions	kW	0.00						
Space cooling	A Pdc	kW	6.80		9.50		12.10		13.40
	Condition EERd		3.75	4.02	4.10	4.05	3.40	3.11	
	(35°C - 27/19) Power input	kW	1.81	1.69	2.31	2.34	3.56		4.31
	B Pdc	kW	5.03		7.03		8.92		9.87
	Condition EERd		5.46	5.34	4.92	6.03	5.55	4.94	
	(30°C - 27/19) Power input	kW	0.92	0.94	1.43	1.17	1.61		2.00
	C Pdc	kW	3.20		4.47		5.73		6.35
	Condition EERd		8.99	8.27	7.62	8.88	8.20	7.48	
	(25°C - 27/19) Power input	kW	0.36	0.39	0.59	0.50	0.70		0.85
	D Pdc	kW	2.48	2.62	3.54	3.61	3.36	3.35	
	Condition EERd		12.58	10.71	10.27	11.63	12.00	10.13	
	(20°C - 27/19) Power input	kW	0.20	0.24	0.34	0.31	0.28		0.33
Space heating (Average climate)	TOL Tol (temperature operating limit)	°C	-10						
	Pdh (declared heating cap)	kW	4.70		7.80		9.52		
	COPd (declared COP)		2.43	2.90	2.65	2.85	1.87	2.13	
	Power input	kW	1.93	1.62	2.94	2.73	5.10	4.47	
	TBivalent Tbhv (bivalent temperature)	°C	-10						
	Pdh (declared heating cap)	kW	4.70		7.80		9.52		
	COPd (declared COP)		2.43	2.90	2.65	2.85	1.87	2.13	
	Power input	kW	1.93	1.62	2.94	2.73	5.10	4.47	
	A Pdh (declared heating cap)	kW	4.14		6.86		8.42		
	Condition COPd (declared COP)		2.95	3.26	3.03	3.15	2.55	2.70	
	(-7°C) Power input	kW	1.40	1.27	2.27	2.18	3.30	3.11	
	B Pdh (declared heating cap)	kW	2.54		4.21		5.12		
	Condition COPd (declared COP)		4.44	4.32	4.61	4.57	4.26	4.33	
	(2°C) Power input	kW	0.57	0.59	0.91	0.92	1.20	1.18	
	C Pdh (declared heating cap)	kW	1.79	1.84	2.73		3.29		
	Condition COPd (declared COP)		5.15	4.90	5.70	5.30	5.49	5.54	
	(7°C) Power input	kW	0.35	0.38	0.48	0.52	0.60	0.59	
	D Pdh (declared heating cap)	kW	1.97	2.07	2.54	2.60	2.55	2.64	
	Condition COPd (declared COP)		5.99	6.00	7.06	6.21	6.13	6.25	
	(12°C) Power input	kW	0.33	0.34	0.36	0.42			
Space heating (Average climate)	D Condition (12°C) Power input	kW	0.33	0.34	0.36	0.42			
Power consumption in other than active mode	Crankcase heater	Cooling PCK kW	0.000						
		Heating PCK kW	0.000						
	Off mode	Cooling POFF kW	0.009						
		Heating POFF kW	0.009						
	Standby mode	Cooling PSB kW	0.009						
		Heating PSB kW	0.009						
	Thermostat-off mode	Cooling PTO kW	0.005						
		Heating PTO kW	0.013						
Indication if the heater is equipped with a supplementary heater (pair application)			No						
Supplementary heater (pair application)	Back-up capacity	Heating elbu kW	0.0						
Cooling	Cdc (Degradation cooling)		0.25						
Heating	Cdh (Degradation heating)		0.25						
Cooling function included			Yes						
Heating function included			Yes						
Average climate included			Yes						

2 Specifications

1 - 1 RZAG-NY1

Capacity and power input	FHA71A9 + RZAG71NY1	FHA100A + RZAG71NY1	FHA100A + RZAG100NY1	FHA140A + RZAG100NY1	FHA125A + RZAG125NY1	FHA140A + RZAG140NY1
Cold season included	No					
Warm season included	No					

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Capacity and power input	FUA71A + RZAG71NY1	FUA100A + RZAG71NY1	FUA100A + RZAG100NY1	FUA125A + RZAG125NY1
Cooling capacity Nom. kW	6.80 (1)		9.50 (1)	12.1 (1)
Heating capacity Nom. kW	7.50 (2)		10.8 (2)	13.5 (2)
Space cooling Energy efficiency class	A++			-
Capacity Pdesign kW	6.80		9.50	12.1
SEER	7.02	6.89	6.42	6.39
ηs,c %	-			253
Annual energy consumption kWh/a	339	345	518	1,136
Space heating (Average climate) Energy efficiency class	A+			-
Capacity Pdesign kW	4.70		7.80	9.52
SCOP/A	4.20	4.28	4.50	4.26
SCOPnet/A	4.20	4.28	4.50	4.26
ηs,h %	-			167
Annual energy consumption kWh/a	1,567	1,538	2,427	3,129
Required back up heating cap at design conditions kW	0.00			
Space cooling A Pdc kW	6.80		9.50	12.10
Condition EERd	3.83	4.02	3.57	3.02
(35°C - 27/19) Power input kW	1.77	1.69	2.66	4.00
B Pdc kW	5.03		7.03	8.91
Condition EERd	5.34	5.65	4.93	5.08
(30°C - 27/19) Power input kW	0.94	0.89	1.43	1.76
C Pdc kW	3.20	3.19	4.46	5.74
Condition EERd	8.83	8.54	7.75	7.22
(25°C - 27/19) Power input kW	0.36	0.37	0.58	0.79
D Pdc kW	2.59	2.64	3.36	3.23
Condition EERd	12.48	10.88	10.65	10.56
(20°C - 27/19) Power input kW	0.21	0.24	0.32	0.31
Space heating (Average climate) TOL Tol (temperature operating °C limit)	-10			
Pdh (declared heating cap) kW	4.70		7.80	9.52
COPd (declared COP)	2.58	2.95	2.62	1.97
Power input kW	1.82	1.59	2.97	4.83
TBivalent Tbiv (bivalent temperature) °C	-10			
Pdh (declared heating cap) kW	4.70		7.80	9.52
COPd (declared COP)	2.58	2.95	2.62	1.97
Power input kW	1.82	1.59	2.97	4.83
A Pdh (declared heating cap) kW	4.14		6.86	8.43
Condition COPd (declared COP)	2.99	3.31	3.00	2.66
(-7°C) Power input kW	1.38	1.25	2.29	3.17
B Pdh (declared heating cap) kW	2.54		4.21	5.12
Condition COPd (declared COP)	4.27	4.36	4.53	4.31
(2°C) Power input kW	0.60	0.58	0.93	1.19
C Pdh (declared heating cap) kW	1.80	1.86	2.73	3.29
Condition COPd (declared COP)	5.03	4.87	5.47	
(7°C) Power input kW	0.36	0.38	0.50	0.60
D Pdh (declared heating cap) kW	2.00	2.09	2.55	2.58
Condition COPd (declared COP)	6.00	5.94	6.76	6.18
Space heating (Average climate) D Condition (12°C) Power input kW	0.33	0.35	0.38	0.42
Power consumption in other than active mode Crankcase heater Cooling PCK kW	0.000			
heater Heating PCK kW	0.000			
Off mode Cooling POFF kW	0.009			
heater Heating POFF kW	0.009			
Standby mode Cooling PSB kW	0.009			
heater Heating PSB kW	0.009			
Thermostat-off mode Cooling PTO kW	0.005			
heater Heating PTO kW	0.013			
Indication if the heater is equipped with a supplementary heater (pair application)	No			

2 Specifications

1 - 1 RZAG-NY1

2

Capacity and power input		FUA71A + RZAG71NY1	FUA100A + RZAG71NY1	FUA100A + RZAG100NY1	FUA125A + RZAG125NY1
Supplementary heater (pair application)	Back-up Heating elbu capacity	kW			0.0
Cooling	Cdc (Degradation cooling)				0.25
Heating	Cdh (Degradation heating)				0.25
Cooling function included					Yes
Heating function included					Yes
Average climate included					Yes
Cold season included					No
Warm season included					No

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Capacity and power input		FVA71A + RZAG71NY1	FVA100A + RZAG71NY1	FVA100A + RZAG100NY1	FVA140A + RZAG100NY1	FVA125A + RZAG125NY1	FVA140A + RZAG140NY1	
Cooling capacity	Nom.	kW		6.80 (1)		9.50 (1)		
Heating capacity	Nom.	kW		7.50 (2)		10.8 (2)		
Space cooling	Energy efficiency class			A++				
	Capacity Pdesign	kW		6.80		9.50		
	SEER			6.34	6.41	6.40	6.43	
	ηs,c	%		-		-		
	Annual energy consumption	kWh/a		376	371	520	517	
Space heating (Average climate)	Energy efficiency class			A+				
	Capacity Pdesign	kW		4.70		7.80		
	SCOP/A			4.05	4.03	4.20	4.05	
	SCOPnet/A			4.05	4.03	4.20	4.05	
	ηs,h	%		-		-		
	Annual energy consumption	kWh/a		1,625	1,634	2,600	2,697	
	Required back up heating cap at design conditions	kW				0.00		
Space cooling	A	Pdc	kW		6.80		9.50	
	Condition (35°C - 27/19)	EERd			3.27	3.95	3.57	3.93
		Power input	kW		2.08	1.72	2.66	2.42
	B	Pdc	kW		5.03		7.03	
	Condition (30°C - 27/19)	EERd			5.15	5.40	5.21	5.13
		Power input	kW		0.98	0.93	1.35	1.37
	C	Pdc	kW		3.20		4.46	
	Condition (25°C - 27/19)	EERd			7.53	7.81	7.67	7.63
		Power input	kW		0.42	0.41	0.58	0.59
	D	Pdc	kW		2.33		3.20	
	Condition (20°C - 27/19)	EERd			11.27	9.56	9.85	10.01
		Power input	kW		0.21	0.27	0.33	0.35
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C				-10	
	TBivalent	Pdh (declared heating cap)	kW		4.70		7.80	
		COPd (declared COP)			2.42	2.85	2.45	2.57
		Power input	kW		1.94	1.65	3.19	3.04
	A	Tbiv (bivalent temperature)	°C				-10	
		Pdh (declared heating cap)	kW		4.70		7.80	
		COPd (declared COP)			2.42	2.85	2.45	2.57
	B	Power input	kW		1.94	1.65	3.19	3.04
		Pdh (declared heating cap)	kW		4.14		6.86	
		Condition (-7°C)	COPd (declared COP)			2.83	3.18	2.82
	C	Power input	kW		1.46	1.30	2.43	2.42
		Pdh (declared heating cap)	kW		2.54		4.21	
		Condition (2°C)	COPd (declared COP)			4.07	4.11	4.21
	D	Power input	kW		0.62		1.00	1.02
		Pdh (declared heating cap)	kW		1.76	1.88	2.73	
Condition (7°C)		COPd (declared COP)			4.92	4.54	5.13	4.77
E	Power input	kW		0.36	0.41	0.53	0.57	
	Pdh (declared heating cap)	kW		1.96		2.56		
	Condition (12°C)	COPd (declared COP)			5.77	5.48	6.22	5.58
F	Power input	kW		0.34		0.41		
	Pdh (declared heating cap)	kW		0.38		0.47		
	Condition (12°C)	COPd (declared COP)			0.34	0.38	0.41	0.47

2 Specifications

1 - 1 RZAG-NY1

Capacity and power input					FVA71A + RZAG71NY1	FVA100A + RZAG71NY1	FVA100A + RZAG100NY1	FVA140A + RZAG100NY1	FVA125A + RZAG125NY1	FVA140A + RZAG140NY1	
Power consumption in other than active mode	Crankcase heater	Cooling	PCK	kW						0.000	
		Heating	PCK	kW						0.000	
	Off mode	Cooling	POFF	kW							0.009
		Heating	POFF	kW							0.009
	Standby mode	Cooling	PSB	kW							0.009
		Heating	PSB	kW							0.009
	Thermostat-off mode	Cooling	PTO	kW							0.005
		Heating	PTO	kW							0.013
	Indication if the heater is equipped with a supplementary heater (pair application)										No
	Supplementary heater (pair application)	Back-up capacity	Heating	elbu	kW						0.0
Cooling	Cdc (Degradation cooling)									0.25	
Heating	Cdh (Degradation heating)									0.25	
Cooling function included										Yes	
Heating function included										Yes	
Average climate included										Yes	
Cold season included										No	
Warm season included										No	

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

3 Electrical data

3 - 1 Electrical Data

3

RZAG-NV1

RZAG-NY1

Symbols

- MCA: Minimum Circuit Ampere [A]
- TOCA: Total overcurrent amps [A]
- MFA: Maximum Fuse Ampere [A]
- MSC: Maximum current of the starting compressor [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full Load Ampere [A]
- KW: Fan motor rated output [kW]

Notes

1. The -RLA- is based on the following conditions.
 - Cooling
 - Indoor temperature :27.0°C DB / -19.0°C WB
 - Outdoor temperature :35.0°C DB
 - Heating
 - Indoor temperature :20.0°C DB
 - Outdoor temperature :7.0°C DB / -6.0°C WB
2. -TOCA- is the total value of each overcurrent set.
3. Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
4. The maximum allowable voltage that is unbalanced between phases is -2-%.
5. -MCA- is the maximum input current.
 - The capacity of the -MFA- must be greater than that of the -MCA-.
 - Select the -MFA- according to the table.
6. Select the wire size according to the MCA.
7. -MFA- is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D120943

RZAG-NY1

Indoor	Outdoor	Power supply	Voltage range	Compressor			OFM		IFM					
				MCA	TOCA	MFA	MSC	RLA	KW	FLA	KW	FLA		
FCAHG71HVEB	x2 RZAG125N7Y1B	3N~ 50Hz 380-415V	Minimum: -342 V- Maximum: -457 V-	15,0	—	16	—	11,8	0,234	1,2	0,091 x2	0,7 x2		
FCAHG140HVEB	RZAG125N7Y1B			15,0	—	16	—	11,8	0,234	1,2	0,244	1,4		
FCAG35BVEB	x4 RZAG125N7Y1B			12,2	—	16	—	9,3	0,234	1,2	0,044 x4	0,3 x4		
FCAG50BVEB	x3 RZAG125N7Y1B			12,9	—	16	—	10,3	0,234	1,2	0,039 x3	0,3 x3		
FCAG71BVEB	x2 RZAG125N7Y1B			14,4	—	16	—	11,8	0,234	1,2	0,054 x2	0,4 x2		
FCAG140BVEB	RZAG125N7Y1B			14,9	—	16	—	11,8	0,234	1,2	0,168	1,3		
FFA35A2VEB	x4 RZAG125N7Y1B			11,8	—	16	—	9,3	0,234	1,2	0,050 x4	0,2 x4		
FFA50A2VEB	x3 RZAG125N7Y1B			13,2	—	16	—	10,3	0,234	1,2	0,050 x3	0,4 x3		
FBA35A2VEB	x4 RZAG125N7Y1B			(10,9)*	—	16	—	9,3	0,234	1,2	0,089 x4	1,4 x4		
FBA50A2VEB	x3 RZAG125N7Y1B			(12,0)*	—	16	—	10,3	0,234	1,2	0,089 x3	1,4 x3		
FBA71A2VEB	x2 RZAG125N7Y1B			(13,5)*	—	16	—	11,8	0,234	1,2	0,070 x2	1,3 x2		
FBA140A2VEB	RZAG125N7Y1B			(13,5)*	—	16	—	11,8	0,234	1,2	0,187	3,9		
FUA71A1VEB	x2 RZAG125N7Y1B			15,4	—	16	—	11,8	0,234	1,2	0,046 x2	0,9 x2		
FAA71A1UVEB	x2 RZAG125N7Y1B			14,6	—	16	—	11,8	0,234	1,2	0,048 x2	0,5 x2		
FVA140AMVEB	RZAG125N7Y1B			15,4	—	16	—	11,8	0,234	1,2	0,276	1,8		
FDXM35F3V1B	x4 RZAG125N7Y1B			12,2	—	16	—	9,3	0,234	1,2	0,034 x4	0,3 x4		
FDXM50F3V1B	x3 RZAG125N7Y1B			14,8	—	16	—	10,3	0,234	1,2	0,060 x3	0,9 x3		
FHA35AVEB	x4 RZAG125N7Y1B			13,4	—	16	—	9,3	0,234	1,2	0,060 x4	0,6 x4		
FHA50AVEB	x3 RZAG125N7Y1B			13,8	—	16	—	10,3	0,234	1,2	0,060 x3	0,6 x3		
FHA71AVEB	x2 RZAG125N7Y1B			15,2	—	16	—	11,8	0,234	1,2	0,091 x2	0,8 x2		
FHA140AVEB	RZAG125N7Y1B			15,4	—	16	—	11,8	0,234	1,2	0,150	1,8		
FCAHG71HVEB	x2 RZAG140N7Y1B			3N~ 50Hz 380-415V	Minimum: -342 V- Maximum: -457 V-	15,0	—	16	—	11,6	0,234	1,4	0,091 x2	0,7 x2
FCAHG140HVEB	RZAG140N7Y1B					15,0	—	16	—	11,6	0,234	1,4	0,244	1,4
FCAG35BVEB	x4 RZAG140N7Y1B					12,2	—	16	—	9,1	0,234	1,4	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG140N7Y1B					12,9	—	16	—	10,1	0,234	1,4	0,039 x3	0,3 x3
FCAG71BVEB	x2 RZAG140N7Y1B					14,4	—	16	—	11,6	0,234	1,4	0,054 x2	0,4 x2
FCAG140BVEB	RZAG140N7Y1B					14,9	—	16	—	11,6	0,234	1,4	0,168	1,3
FFA35A2VEB	x4 RZAG140N7Y1B					11,8	—	16	—	9,1	0,234	1,4	0,050 x4	0,2 x4
FFA50A2VEB	x3 RZAG140N7Y1B	13,2	—			16	—	10,1	0,234	1,4	0,050 x3	0,4 x3		
FBA35A2VEB	x4 RZAG140N7Y1B	(10,9)*	—			16	—	9,1	0,234	1,4	0,089 x4	1,4 x4		
FBA50A2VEB	x3 RZAG140N7Y1B	(12,0)*	—			16	—	10,1	0,234	1,4	0,089 x3	1,4 x3		
FBA71A2VEB	x2 RZAG140N7Y1B	(13,5)*	—			16	—	11,6	0,234	1,4	0,070 x2	1,3 x2		
FBA140A2VEB	RZAG140N7Y1B	(13,5)*	—			16	—	11,6	0,234	1,4	0,187	3,9		
FUA71A1VEB	x2 RZAG140N7Y1B	15,4	—			16	—	11,6	0,234	1,4	0,046 x2	0,9 x2		
FAA71A1UVEB	x2 RZAG140N7Y1B	14,6	—			16	—	11,6	0,234	1,4	0,048 x2	0,5 x2		
FVA140AMVEB	RZAG140N7Y1B	15,4	—			16	—	11,6	0,234	1,4	0,276	1,8		
FDXM35F3V1B	x4 RZAG140N7Y1B	12,2	—			16	—	9,1	0,234	1,4	0,034 x4	0,3 x4		
FDXM50F3V1B	x3 RZAG140N7Y1B	14,8	—			16	—	10,1	0,234	1,4	0,060 x3	0,9 x3		
FHA35AVEB	x4 RZAG140N7Y1B	13,4	—			16	—	9,1	0,234	1,4	0,060 x4	0,6 x4		
FHA50AVEB	x3 RZAG140N7Y1B	13,8	—			16	—	10,1	0,234	1,4	0,060 x3	0,6 x3		
FHA71AVEB	x2 RZAG140N7Y1B	15,2	—			16	—	11,6	0,234	1,4	0,091 x2	0,8 x2		
FHA140AVEB	RZAG140N7Y1B	15,4	—			16	—	11,6	0,234	1,4	0,150	1,8		

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the outdoor unit. For the MCA of the indoor unit, see the installation manual of the indoor unit.

3D120944A

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1

RZAG-NY1

Symbols

- MCA: Minimum Circuit Ampere [A]
- TOCA: Total overcurrent amps [A]
- MFA: Maximum Fuse Ampere [A]
- MSC: Maximum current of the starting compressor [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full Load Ampere [A]
- KW: Fan motor rated output [kW]

Notes

1. The ·RLA· is based on the following conditions.
 - Cooling
 - Indoor temperature ·27.0·°C DB / ·19.0·°C WB
 - Outdoor temperature ·35.0·°C DB
 - Heating
 - Indoor temperature ·20.0·°C DB
 - Outdoor temperature ·7.0·°C DB / ·6.0·°C WB
2. ·TOCA· is the total value of each overcurrent set.
3. Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
4. The maximum allowable voltage that is unbalanced between phases is ·2·%.
5. ·MCA· is the maximum input current.
 - The capacity of the ·MFA· must be greater than that of the ·MCA·.
 - Select the ·MFA· according to the table.
6. Select the wire size according to the MCA.
7. ·MFA· is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D120944A

RZAG-NY1

Indoor	Outdoor	Power supply	Voltage range	Compressor					OFM		IFM	
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA
FCAG12SHVEB	RZAG12SN7Y1B	3N~ 50Hz 380-415V	Minimum: ·342· V Maximum: ·457· V	15.0	—	16	—	11.8	0.234	1.2	0.244	1.4
FCAG35BVEB	x4 RZAG12SN7Y1B			12.2	—	16	—	9.3	0.234	1.2	0.044 x4	0.3 x4
FCAG50BVEB	x3 RZAG12SN7Y1B			12.9	—	16	—	10.3	0.234	1.2	0.039 x3	0.3 x3
FCAG60BVEB	x2 RZAG12SN7Y1B			14.1	—	16	—	11.8	0.234	1.2	0.044 x2	0.3 x2
FCAG125BVEB	RZAG12SN7Y1B			14.6	—	16	—	11.8	0.234	1.2	0.168	1.0
FFA35A2VEB	x4 RZAG12SN7Y1B			11.8	—	16	—	9.3	0.234	1.2	0.050 x4	0.2 x4
FFA50A2VEB	x3 RZAG12SN7Y1B			13.2	—	16	—	10.3	0.234	1.2	0.050 x3	0.4 x3
FFA60A2VEB	x2 RZAG12SN7Y1B			14.8	—	16	—	11.8	0.234	1.2	0.050 x2	0.6 x2
FBA35A2VEB	x4 RZAG12SN7Y1B			(10.9)*	—	16	—	9.3	0.234	1.2	0.089 x4	1.4 x4
FBA50A2VEB	x3 RZAG12SN7Y1B			(12.0)*	—	16	—	10.3	0.234	1.2	0.089 x3	1.4 x3
FBA60A2VEB	x2 RZAG12SN7Y1B			(13.5)*	—	16	—	11.8	0.234	1.2	0.070 x2	1.3 x2
FBA125A2VEB	RZAG12SN7Y1B			(13.5)*	—	16	—	11.8	0.234	1.2	0.187	3.9
FMA35A2VEB	x4 RZAG12SN7Y1B			13.0	—	16	—	9.3	0.234	1.2	0.034 x4	0.5 x4
FMA50A2VEB	x3 RZAG12SN7Y1B			13.5	—	16	—	10.3	0.234	1.2	0.060 x3	0.5 x3
FMA60A2VEB	x2 RZAG12SN7Y1B			14.8	—	16	—	11.8	0.234	1.2	0.060 x2	0.6 x2
FUA125AVEB	RZAG12SN7Y1B			15.0	—	16	—	11.8	0.234	1.2	0.106	1.4
FDA125AVEB	RZAG12SN7Y1B			15.7	—	16	—	11.8	0.234	1.2	0.350	2.1
FVA125AMVEB	RZAG12SN7Y1B			15.1	—	16	—	11.8	0.234	1.2	0.238	1.5
FDXM35F3V1B	x4 RZAG12SN7Y1B			12.2	—	16	—	9.3	0.234	1.2	0.034 x4	0.3 x4
FDXMS0F3V1B	x3 RZAG12SN7Y1B			14.8	—	16	—	10.3	0.234	1.2	0.060 x3	0.9 x3
FDXMS60F3V1B	x2 RZAG12SN7Y1B			15.4	—	16	—	11.8	0.234	1.2	0.060 x2	0.9 x2
FHA35AVEB	x4 RZAG12SN7Y1B			13.4	—	16	—	9.3	0.234	1.2	0.060 x4	0.6 x4
FHA50AVEB	x3 RZAG12SN7Y1B			13.8	—	16	—	10.3	0.234	1.2	0.060 x3	0.6 x3
FHA60AVEB	x2 RZAG12SN7Y1B			14.8	—	16	—	11.8	0.234	1.2	0.091 x2	0.6 x2
FHA125AVEB	RZAG12SN7Y1B			15.1	—	16	—	11.8	0.234	1.2	0.150	1.5
FCAG71HVEB	RZAG140N7Y1B			15.0	—	16	—	11.6	0.234	1.4	0.091 x2	0.7 x2
FCAG140HVEB	RZAG140N7Y1B			15.0	—	16	—	11.6	0.234	1.4	0.244	1.4
FCAG35BVEB	x4 RZAG140N7Y1B			12.2	—	16	—	9.1	0.234	1.4	0.044 x4	0.3 x4
FCAG50BVEB	x3 RZAG140N7Y1B	12.9	—	16	—	10.1	0.234	1.4	0.039 x3	0.3 x3		
FCAG71BVEB	x2 RZAG140N7Y1B	14.4	—	16	—	11.6	0.234	1.4	0.054 x2	0.4 x2		
FCAG140BVEB	RZAG140N7Y1B	14.9	—	16	—	11.6	0.234	1.4	0.168	1.3		
FFA35A2VEB	x4 RZAG140N7Y1B	11.8	—	16	—	9.1	0.234	1.4	0.050 x4	0.2 x4		
FFA50A2VEB	x3 RZAG140N7Y1B	12.2	—	16	—	10.1	0.234	1.4	0.060 x3	0.5 x3		
FFA60A2VEB	x2 RZAG140N7Y1B	(10.9)*	—	16	—	9.1	0.234	1.4	0.089 x4	1.4 x4		
FBA35A2VEB	x4 RZAG140N7Y1B	(10.9)*	—	16	—	10.1	0.234	1.4	0.089 x3	1.4 x3		
FBA50A2VEB	x3 RZAG140N7Y1B	(12.0)*	—	16	—	11.6	0.234	1.4	0.070 x2	1.3 x2		
FBA71A2VEB	x2 RZAG140N7Y1B	(13.5)*	—	16	—	11.6	0.234	1.4	0.187	3.9		
FBA140A2VEB	RZAG140N7Y1B	(13.5)*	—	16	—	9.1	0.234	1.4	0.034 x4	0.5 x4		
FMA35A2VEB	x4 RZAG140N7Y1B	13.0	—	16	—	9.1	0.234	1.4	0.060 x3	0.5 x3		
FMA50A2VEB	x3 RZAG140N7Y1B	13.5	—	16	—	10.1	0.234	1.4	0.046 x2	0.9 x2		
FUA71AVEB	x2 RZAG140N7Y1B	14.6	—	16	—	11.6	0.234	1.4	0.048 x2	0.5 x2		
FVA71AMVEB	x2 RZAG140N7Y1B	15.2	—	16	—	11.6	0.234	1.4	0.117 x2	0.8 x2		
FVA140AMVEB	RZAG140N7Y1B	15.4	—	16	—	11.6	0.234	1.4	0.276	1.8		
FDXMS35F3V1B	x4 RZAG140N7Y1B	12.2	—	16	—	9.1	0.234	1.4	0.034 x4	0.3 x4		
FDXMS0F3V1B	x3 RZAG140N7Y1B	14.8	—	16	—	10.1	0.234	1.4	0.060 x3	0.9 x3		
FHA35AVEB	x4 RZAG140N7Y1B	13.4	—	16	—	9.1	0.234	1.4	0.060 x4	0.6 x4		
FHA50AVEB	x3 RZAG140N7Y1B	13.8	—	16	—	10.1	0.234	1.4	0.060 x3	0.6 x3		
FHA71AVEB	x2 RZAG140N7Y1B	15.2	—	16	—	11.6	0.234	1.4	0.091 x2	0.8 x2		
FHA140AVEB	RZAG140N7Y1B	15.4	—	16	—	11.6	0.234	1.4	0.150	1.8		

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the outdoor unit. For the MCA of the indoor unit, see the installation manual of the indoor unit.

3D120943

3 Electrical data

3 - 1 Electrical Data

3

RZAG-NY1

Indoor	Outdoor	Power supply	Voltage range	MCA	TOCA	MFA	Compressor		OFM		IFM			
							MSC	RLA	kW	FLA	kW	FLA		
FCAHG100HVEB	RZAG71N7Y1B	3N~ 50Hz 380-415V	Minimum: -342 V. Maximum -457 V.	11,8	—	16	—	9,2	0,234	0,8	0,221	1,3		
FCAG35BVEB	x3 RZAG71N7Y1B			11,3	—	16	—	9,2	0,234	0,8	0,044 x3	0,3 x3		
FCAG50BVEB	x2 RZAG71N7Y1B			11,0	—	16	—	9,2	0,234	0,8	0,039 x2	0,3 x2		
FCAG100BVEB	RZAG71N7Y1B			11,1	—	16	—	9,2	0,234	0,8	0,117	0,7		
FFA35A2VEB	x3 RZAG71N7Y1B			11,0	—	16	—	9,2	0,234	0,8	0,050 x3	0,2 x3		
FFA50A2VEB	x2 RZAG71N7Y1B			11,2	—	16	—	9,2	0,234	0,8	0,050 x2	0,4 x2		
FBA35A2VEB	x3 RZAG71N7Y1B			(10,4)*	—	16	—	9,2	0,234	0,8	0,089 x3	1,4 x3		
FBA50A2VEB	x2 RZAG71N7Y1B			(10,4)*	—	16	—	9,2	0,234	0,8	0,089 x2	1,4 x2		
FBA100A2VEB	RZAG71N7Y1B			(10,4)*	—	16	—	9,2	0,234	0,8	0,127	3,5		
FUA100AVEB	RZAG71N7Y1B			11,8	—	16	—	9,2	0,234	0,8	0,106	1,3		
FAA100AUVEB	RZAG71N7Y1B			10,9	—	16	—	9,2	0,234	0,8	0,064	0,5		
FVA100AMVEB	RZAG71N7Y1B			12,0	—	16	—	9,2	0,234	0,8	0,238	1,5		
FDXM35F3V1B	x3 RZAG71N7Y1B			11,3	—	16	—	9,2	0,234	0,8	0,034 x3	0,3 x3		
FDXM50F3V1B	x2 RZAG71N7Y1B			12,3	—	16	—	9,2	0,234	0,8	0,060 x2	0,9 x2		
FHA35AVEB	x3 RZAG71N7Y1B			12,3	—	16	—	9,2	0,234	0,8	0,060 x3	0,6 x3		
FHA50AVEB	x2 RZAG71N7Y1B			11,6	—	16	—	9,2	0,234	0,8	0,060 x2	0,6 x2		
FHA100AVEB	RZAG71N7Y1B			11,8	—	16	—	9,2	0,234	0,8	0,150	1,3		
FCAHG71HVEB	RZAG100N7Y1B			3N~ 50Hz 380-415V	Minimum: -342 V. Maximum -457 V.	13,5	—	16	—	10,4	0,234	1,2	0,091 x2	0,7 x2
FCAG140HVEB	RZAG100N7Y1B					15,0	—	16	—	11,8	0,234	1,2	0,244	1,4
FCAG35BVEB	x4 RZAG100N7Y1B					13,3	—	16	—	10,4	0,234	1,2	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG100N7Y1B	13,0	—			16	—	10,4	0,234	1,2	0,039 x3	0,3 x3		
FCAG71BVEB	x2 RZAG100N7Y1B	12,9	—			16	—	10,4	0,234	1,2	0,054 x2	0,4 x2		
FCAG140BVEB	RZAG100N7Y1B	14,9	—			16	—	11,8	0,234	1,2	0,168	1,3		
FFA35A2VEB	x4 RZAG100N7Y1B	12,9	—			16	—	10,4	0,234	1,2	0,050 x4	0,8		
FFA50A2VEB	x3 RZAG100N7Y1B	13,3	—			16	—	10,4	0,234	1,2	0,050 x3	0,4 x3		
FBA35A2VEB	x4 RZAG100N7Y1B	(12,1)*	—			16	—	10,4	0,234	1,2	0,089 x4	1,4 x4		
FBA50A2VEB	x3 RZAG100N7Y1B	(12,1)*	—			16	—	10,4	0,234	1,2	0,089 x3	1,4 x3		
FBA71A2VEB	x2 RZAG100N7Y1B	(12,1)*	—			16	—	10,4	0,234	1,2	0,070 x2	1,3 x2		
FBA140A2VEB	RZAG100N7Y1B	(13,5)*	—			16	—	11,8	0,234	1,2	0,187	3,9		
FUA71AVEB	x2 RZAG100N7Y1B	13,9	—			16	—	10,4	0,234	1,2	0,046 x2	0,9 x2		
FAA71AUVEB	x2 RZAG100N7Y1B	13,1	—			16	—	10,4	0,234	1,2	0,048 x2	0,5 x2		
FVA140AMVEB	RZAG100N7Y1B	15,4	—			16	—	11,8	0,234	1,2	0,276	1,8		
FDXM35F3V1B	x4 RZAG100N7Y1B	13,3	—			16	—	10,4	0,234	1,2	0,034 x4	0,3 x4		
FDXM50F3V1B	x3 RZAG100N7Y1B	14,9	—			16	—	10,4	0,234	1,2	0,060 x3	0,9 x3		
FHA35AVEB	x4 RZAG100N7Y1B	14,6	—			16	—	10,4	0,234	1,2	0,060 x4	0,6 x4		
FHA50AVEB	x3 RZAG100N7Y1B	13,9	—			16	—	10,4	0,234	1,2	0,060 x3	0,6 x3		
FHA71AVEB	x2 RZAG100N7Y1B	13,7	—			16	—	10,4	0,234	1,2	0,091 x2	0,8 x2		
FHA140AVEB	RZAG100N7Y1B	15,4	—	16	—	11,8	0,234	1,2	0,150	1,8				

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the outdoor unit. For the MCA of the indoor unit, see the installation manual of the indoor unit.

3D120944A

RZAG-NY1

Indoor	Outdoor	Power supply	Voltage range	MCA	TOCA	MFA	Compressor		OFM		IFM			
							MSC	RLA	kW	FLA	kW	FLA		
FCAHG71HVEB	RZAG71N7Y1B	3N~ 50Hz 380-415V	Minimum: -342 V. Maximum -457 V.	11,1	—	16	—	9,2	0,234	0,8	0,091	0,7		
FCAG35BVEB	x2 RZAG71N7Y1B			11,0	—	16	—	9,2	0,234	0,8	0,044 x2	0,3 x2		
FCAG71BVEB	RZAG71N7Y1B			10,8	—	16	—	9,2	0,234	0,8	0,054	0,4		
FFA35A2VEB	x2 RZAG71N7Y1B			10,8	—	16	—	9,2	0,234	0,8	0,050 x2	0,2 x2		
FBA35A2VEB	x2 RZAG71N7Y1B			(10,4)*	—	16	—	9,2	0,234	0,8	0,089 x2	1,4 x2		
FBA71A2VEB	RZAG71N7Y1B			(10,4)*	—	16	—	9,2	0,234	0,8	0,070 x2	1,3 x2		
FNA35A2VEB	x2 RZAG71N7Y1B			11,4	—	16	—	9,2	0,234	0,8	0,034 x2	0,5 x2		
FUA71AVEB	RZAG71N7Y1B			11,3	—	16	—	9,2	0,234	0,8	0,046	0,9		
FAA71AUVEB	RZAG71N7Y1B			10,9	—	16	—	9,2	0,234	0,8	0,048	0,5		
FVA71AMVEB	RZAG71N7Y1B			11,2	—	16	—	9,2	0,234	0,8	0,117	0,8		
FDXM35F3V1B	x2 RZAG71N7Y1B			11,0	—	16	—	9,2	0,234	0,8	0,034 x2	0,3 x2		
FHA35AVEB	x2 RZAG71N7Y1B			11,6	—	16	—	9,2	0,234	0,8	0,060 x2	0,6 x2		
FHA71AVEB	RZAG71N7Y1B			11,2	—	16	—	9,2	0,234	0,8	0,091	0,8		
FCAHG100HVEB	RZAG100N7Y1B			3N~ 50Hz 380-415V	Minimum: -342 V. Maximum -457 V.	14,9	—	16	—	11,8	0,234	1,2	0,221	1,3
FCAG35BVEB	x3 RZAG100N7Y1B					13,0	—	16	—	10,4	0,234	1,2	0,044 x3	0,3 x3
FCAG50BVEB	x2 RZAG100N7Y1B					12,7	—	16	—	10,4	0,234	1,2	0,039 x2	0,3 x2
FCAG100BVEB	RZAG100N7Y1B					14,2	—	16	—	11,8	0,234	1,2	0,117	0,7
FFA35A2VEB	x3 RZAG100N7Y1B					12,7	—	16	—	10,4	0,234	1,2	0,050 x3	0,2 x3
FFA50A2VEB	x2 RZAG100N7Y1B					12,9	—	16	—	10,4	0,234	1,2	0,050 x2	0,4 x2
FBA35A2VEB	x3 RZAG100N7Y1B					(12,1)*	—	16	—	10,4	0,234	1,2	0,089 x3	1,4 x3
FBA50A2VEB	x2 RZAG100N7Y1B	(12,1)*	—			16	—	10,4	0,234	1,2	0,089 x2	1,4 x2		
FBA100A2VEB	RZAG100N7Y1B	(13,5)*	—			16	—	11,8	0,234	1,2	0,127	3,5		
FNA35A2VEB	x3 RZAG100N7Y1B	13,6	—			16	—	10,4	0,234	1,2	0,034 x3	0,5 x3		
FNA50A2VEB	x2 RZAG100N7Y1B	13,1	—			16	—	10,4	0,234	1,2	0,060 x2	0,5 x2		
FUA100AVEB	RZAG100N7Y1B	14,9	—			16	—	11,8	0,234	1,2	0,106	1,3		
FAA100AUVEB	RZAG100N7Y1B	14,0	—			16	—	11,8	0,234	1,2	0,064	0,5		
FVA100AMVEB	RZAG100N7Y1B	15,1	—			16	—	11,8	0,234	1,2	0,238	1,5		
FDXM35F3V1B	x3 RZAG100N7Y1B	13,0	—			16	—	10,4	0,234	1,2	0,034 x3	0,3 x3		
FDXM50F3V1B	x2 RZAG100N7Y1B	13,9	—			16	—	10,4	0,234	1,2	0,060 x2	0,9 x2		
FHA35AVEB	x3 RZAG100N7Y1B	13,9	—			16	—	10,4	0,234	1,2	0,060 x3	0,6 x3		
FHA50AVEB	x2 RZAG100N7Y1B	13,3	—			16	—	10,4	0,234	1,2	0,060 x2	0,6 x2		
FHA100AVEB	RZAG100N7Y1B	14,9	—			16	—	11,8	0,234	1,2	0,150	1,3		

* Use a separate power supply for the indoor unit. The value between brackets is the MCA of the outdoor unit. For the MCA of the indoor unit, see the installation manual of the indoor unit.

3D120943

4 Options

4 - 1 Options

RZAG-NV1

RZAG-NY1

		EKBP140N	EKMKA2	KHRQ58H	KHRQ58T	KHRQ58H	KHRQ58T	KRP58M51	SB.KRP58M52
RZAG71N7V1B	RZAG71N7Y1B	V	V(1)	V	V(2)	V	V(2)	V(1)	V(1)
RZAG100N7V1B	RZAG100N7Y1B	V	V(1)	V(3)	V(2)	V(3)	V(2)	V(1)	V(1)
RZAG125N7V1B	RZAG125N7Y1B	V	V(1)	V(3)	V(2)	V(3)	V(2)	V(1)	V(1)
RZAG140N7V1B	RZAG140N7Y1B	V	V(1)	V(3)	V(2)	V(3)	V(2)	V(1)	V(1)

NOTES

1. To mount KRP58M51, an additional mounting kit (EKMKA2) needs to be used (obligatory). This will be offered as sales bom
SB.KRP58M52 = KRP58M51 + EKMKA2
2. For twin combinations use 1 KHRQ(M)58T, for double twin use 3.
3. For triple combinations use 1 KHRQ(M)58H.

3D120932

5 Combination table

5 - 1 Combination Table

5

RZAG-NV1 RZAG-NY1

Comfort cooling combination table

	High COP round flow cassette				Round flow cassette						Fully flat cassette			Slim concealed ceiling unit			Concealed ceiling unit with medium ESP							
	FCAHG71HVEB	FCAHG100HVEB	FCAHG125HVEB	FCAHG140HVEB	FCAG35BVEB	FCAG50BVEB	FCAG60BVEB	FCAG71BVEB	FCAG100BVEB	FCAG125BVEB	FCAG140BVEB	FFA35A2VEB9	FFA50A2VEB9	FFA60A2VEB9	FDXM35F3V1B9	FDXM50F3V1B9	FDXM60F3V1B9	FBA35A2VEB9	FBA50A2VEB9	FBA60A2VEB9	FBA71A2VEB9	FBA100A2VEB	FBA125A2VEB	FBA140A2VEB
RZAG71N7V1B RZAG71N7Y1B	P				2			P				2			2			2			P			
RZAG100N7V1B RZAG100N7Y1B		P			3	2			P			3	2		3	2		3	2				P	
RZAG125N7V1B RZAG125N7Y1B			P		4	3	2			P		4	3	2	4	3	2	4	3	2				P
RZAG140N7V1B RZAG140N7Y1B	2			P	4	3		2			P	4	3		4	3		4	3		2			P

	Concealed ceiling unit with high ESP	Wall mounted unit		Ceiling suspended unit						4-way blow ceiling suspended unit			Floor standing unit				Concealed floor standing unit						
	FDA125A5VEB	FAA71AUVEB	FAA100AUVEB	FHA35AVEB9	FHA50AVEB9	FHA60AVEB9	FHA71AVEB9	FHA100AVEB	FHA125AVEB	FHA140AVEB	FUA71AVEB	FUA100AVEB	FUA125AVEB	FVA71AMVEB	FVA100AMVEB	FVA125AMVEB	FVA140AMVEB	FNA35A2VEB9	FNA50A2VEB9	FNA60A2VEB9			
RZAG71N7V1B RZAG71N7Y1B			P		2						P			P						2			
RZAG100N7V1B RZAG100N7Y1B				P	3	2							P		P					3	2		
RZAG125N7V1B RZAG125N7Y1B	P				4	3	2						P			P				4	3	2	
RZAG140N7V1B RZAG140N7Y1B		2			4	3		2			P	2		2			P			4	3		

COMBINATIONS

P = Pair 3 = Triple
2 = Twin 4 = Double Twin

3D120926

RZAG-NV1 RZAG-NY1

Infrastructure cooling combination table

	High COP round flow cassette				Round flow cassette				Fully flat cassette		Slim concealed ceiling unit		Concealed ceiling unit with medium ESP					
	FCAG140BVEB	FCAHG71HVEB	FCAHG100HVEB	FCAHG140HVEB	FCAG35BVEB	FCAG50BVEB	FCAG71BVEB	FCAG100BVEB	FFA35A2VEB9	FFA50A2VEB9	FDXM35F3V1B9	FDXM50F3V1B9	FBA35A2VEB9	FBA50A2VEB9	FBA71A2VEB9	FBA100A2VEB	FBA140A2VEB	
RZAG71N7V1B RZAG71N7Y1B			P		3	2		P	3	2	3	2	3	2		P		
RZAG100N7V1B RZAG100N7Y1B	P	2		P	4	3	2		4	3	4	3	4	3	2		P	
RZAG125N7V1B RZAG125N7Y1B	P	2		P	4	3	2		4	3	4	3	4	3	2		P	
RZAG140N7V1B RZAG140N7Y1B	P	2		P	4	3	2		4	3	4	3	4	3	2		P	

	Wall mounted unit		Ceiling suspended unit				4-way blow ceiling suspended unit		Floor standing unit		
	FAA71AUVEB	FAA100AUVEB	FHA35AVEB9	FHA50AVEB9	FHA71AVEB9	FHA100AVEB	FHA140AVEB	FUA71AVEB	FUA100AVEB	FVA100AMVEB	FVA140AMVEB
RZAG71N7V1B RZAG71N7Y1B		P	3	2					P	P	
RZAG100N7V1B RZAG100N7Y1B	2		4	3	2			2			P
RZAG125N7V1B RZAG125N7Y1B	2		4	3	2			2			P
RZAG140N7V1B RZAG140N7Y1B	2		4	3	2			2			P

COMBINATIONS



P = Pair 2 = Twin 3 = Triple 4 = Double Twin

3D120929

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

RZAG100NV1 RZAG100NY1

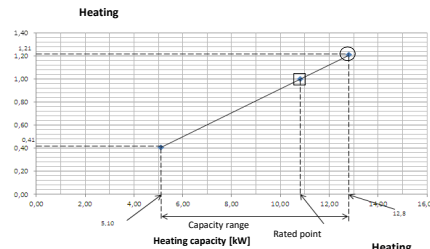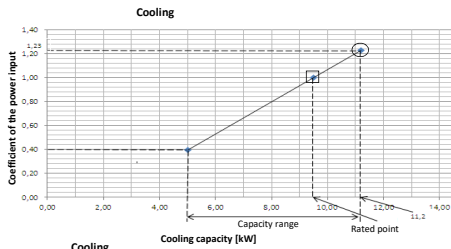

Symbols
 AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI		
16.0	22	11.20	7.61	1.01	0.85	7.44	1.11	0.80	7.29	1.22	10.11	7.09	1.32
18.0	25	11.80	7.59	1.01	11.47	7.46	1.12	11.00	7.37	1.23	10.55	7.09	1.31
19.0	27	12.00	7.57	1.02	11.62	7.44	1.12	11.20	7.37	1.23	10.80	7.04	1.33
19.5	27	12.15	7.59	1.02	11.74	7.37	1.13	11.43	7.34	1.23	10.91	7.04	1.34
20.0	28	12.30	7.62	1.02	11.87	7.36	1.13	11.60	7.36	1.23	11.02	7.09	1.35
24.0	32	13.50	7.42	1.03	12.88	7.23	1.14	12.40	7.05	1.25	11.97	6.91	1.36

Indoor	Outdoor temperature [°C WB]											
	-15.0			-10.0			-5.0			0.0		
TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	
1.6	0.95	0.92	0.95	0.98	1.01	1.02	1.04	1.05	1.05	1.05	1.11	1.18
1.8	0.97	0.97	0.94	1.02	1.03	1.03	1.03	1.09	1.09	1.16	1.16	1.23
2.0	0.99	1.00	0.94	1.06	1.03	1.11	1.03	1.12	1.12	1.21	1.21	1.27
2.1	0.99	1.00	0.94	1.06	1.03	1.11	1.03	1.12	1.12	1.21	1.21	1.27
2.2	0.99	1.00	0.94	1.06	1.03	1.11	1.03	1.12	1.12	1.21	1.21	1.27
2.4	0.99	1.00	0.94	1.06	1.03	1.11	1.03	1.12	1.12	1.21	1.21	1.27

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
□ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units - EWB & EDB.
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 × AFR (m³/min) × (1 - BF) × (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0 m

- CPI is a percentage value compared to the rated value which is -1.00.
- The error rate for this value is less than -5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.
- The rated power input for each model is mentioned in the table below.

Pair

Pair	FCAG100H	FCAG100B	FAA100A	FVA100A	FHA100A	FUA100A	FBA100A
(BF)	(0.17)	(0.17)	(0.10)	(0.20)	(0.09)	(0.20)	(0.03)

Twin

Pair	FCAG50B X 2	FHA50A X 2	FFA50A X 2	FDXMS0F X 2	FBA50A X 2	FNA50A X 2
AFR	12.6 x 2	15.0 x 2	12.0 x 2	15.8 x 2	15.0 x 2	18.0 x 2
(BF)	(0.22 x 2)	(0.18 x 2)	(0.16 x 2)	(0.11 x 2)	(0.13 x 2)	(0.11 x 2)

Triple

Pair	FCAG35B X 3	FHA35A X 3	FFA35A X 3	FDXMS3F X 3	FBA35A X 3	FNA35A X 3
AFR	12.5 x 3	14.0 x 3	10.0 x 3	8.7 x 3	15.0 x 3	8.7 x 3
(BF)	(0.40 x 3)	(0.17 x 3)	(0.25 x 3)	(0.17 x 3)	(0.08 x 3)	(0.17 x 3)

Pair

Pair	FCAG100H	FCAG100B	FAA100A	FVA100A	FHA100A	FUA100A	FBA100A
Cooling	2.25	2.65	2.54	2.66	2.31	2.66	2.58
Heating	2.16	3.01	3.41	2.73	2.72	2.68	2.79

Twin



Pair	FCAG50B X 2	FHA50A X 2	FFA50A X 2	FDXMS0F X 2	FBA50A X 2	FNA50A X 2
Cooling	2.16	2.35	2.51	2.60	2.59	2.10
Heating	2.37	2.65	2.75	2.57	2.79	2.57

Triple

Pair	FCAG35B X 3	FHA35A X 3	FFA35A X 3	FDXMS3F X 3	FBA35A X 3	FNA35A X 3
Cooling	2.05	2.03	2.23	2.11	2.20	2.17
Heating	2.16	2.15	2.76	2.91	2.32	2.91

3D125181

RZAG125NV1 RZAG125NY1

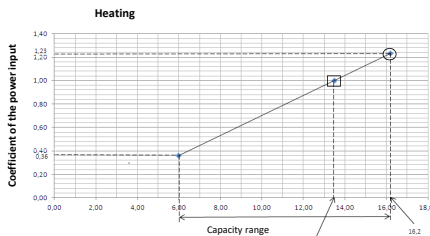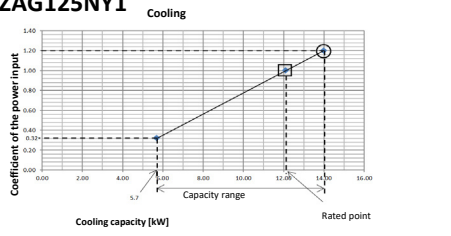

Symbols
 AFR: Air flow rate (m³/min)
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI		
16.0	22	14.50	9.54	0.99	13.60	9.30	1.09	13.10	9.12	1.19	12.60	8.78	1.29
18.0	25	14.70	9.50	0.99	14.00	9.32	1.09	13.70	9.09	1.20	13.20	8.81	1.30
19.0	27	15.00	9.52	1.00	14.50	9.34	1.10	14.00	9.06	1.20	13.50	8.87	1.31
19.5	27	15.20	9.52	1.00	14.68	9.26	1.11	14.15	9.08	1.20	13.64	8.81	1.31
22.0	30	16.00	9.39	1.00	15.47	9.14	1.13	14.90	8.95	1.21	14.38	8.74	1.32
24.0	32	16.70	9.31	1.01	16.10	9.09	1.11	15.50	8.83	1.23	14.97	8.63	1.33

Indoor	Outdoor temperature [°C WB]											
	-15.0			-10.0			-5.0			0.0		
TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	
1.6	1.10	1.04	1.21	1.00	1.03	1.03	1.03	1.06	1.06	1.13	1.20	
1.8	1.10	1.06	1.21	1.03	1.03	1.03	1.03	1.11	1.11	1.16	1.26	
2.0	1.10	1.08	1.20	1.03	1.03	1.13	1.03	1.15	1.15	1.22	1.30	
2.1	1.10	1.04	1.20	1.10	1.03	1.14	1.03	1.17	1.17	1.25	1.32	
2.2	1.10	1.06	1.20	1.12	1.03	1.16	1.03	1.20	1.20	1.28	1.34	
2.4	1.10	1.10	1.20	1.16	1.03	1.21	1.03	1.24	1.24	1.33	1.40	

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
□ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units - EWB & EDB.
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 × AFR (m³/min) × (1 - BF) × (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0 m

- CPI is a percentage value compared to the rated value which is -1.00.
- The error rate for this value is less than -5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.
- The rated power input for each model is mentioned in the table below.

Pair

Pair	FCAG125H	FCAG125B	FDA125A	FVA125A	FHA125A	FUA125A	FBA125A
(BF)	(0.19)	(0.21)	(0.16)	(0.16)	(0.14)	(0.19)	(0.06)

Twin

Pair	FCAG60B X 2	FHA60A X 2	FFA60A X 2	FDXMS0F X 2	FBA60A X 2	FNA60A X 2
AFR	13.5 x 2	13.5 x 2	14.5 x 2	18.0 x 2	18.0 x 2	16.0 x 2
(BF)	(0.20 x 2)	(0.20 x 2)	(0.11 x 2)	(0.12 x 2)	(0.18 x 2)	(0.12 x 2)

Triple

Pair	FCAG50A X 3	FHA50A X 3	FFA50A X 3	FDXMS0F X 3	FBA50A X 3	FNA50A X 3
AFR	12.8 x 3	15.0 x 3	12.0 x 3	15.8 x 3	15.0 x 3	16.0 x 3
(BF)	(0.22 x 3)	(0.18 x 3)	(0.16 x 3)	(0.13 x 3)	(0.13 x 3)	(0.11 x 3)

Double twin

Pair	FCAG35B X 4	FHA35A X 4	FFA35A X 4	FDXMS3F X 4	FBA35A X 4	FNA35A X 4
AFR	14.0 x 4	14.0 x 4	10.0 x 4	8.7 x 4	15.0 x 4	8.7 x 4
(BF)	(0.40 x 4)	(0.17 x 4)	(0.25 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)

Pair

Pair	FCAG125H	FCAG125B	FDA125A	FVA125A	FHA125A	FUA125A	FBA125A
Cooling	3.15	3.65	3.73	3.77	3.55	3.86	3.62
Heating	3.08	3.82	3.26	3.84	3.36	3.40	3.15

Twin

Pair	FCAG60B X 2	FHA60A X 2	FFA60A X 2	FDXMS0F X 2	FBA60A X 2	FNA60A X 2
Cooling	2.76	2.83	3.35	2.60	2.78	2.65
Heating	3.49	3.27	3.58	3.03	2.82	3.04

Triple

Pair	FCAG50A X 3	FHA50A X 3	FFA50A X 3	FDXMS0F X 3	FBA50A X 3	FNA50A X 3
Cooling	2.57	2.79	2.97	2.36	2.74	2.50
Heating	2.86	2.73	3.19	2.46	2.69	2.53

Double twin

Pair	FCAG35B X 4	FHA35A X 4	FFA35A X 4	FDXMS3F X 4	FBA35A X 4	FNA35A X 4
Cooling	2.51	2.45	2.71	2.55	2.36	2.62
Heating	2.63	2.41	3.44	2.58	2.34	2.91

3D125182



6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

6

RZAG140NV1

RZAG140NY1

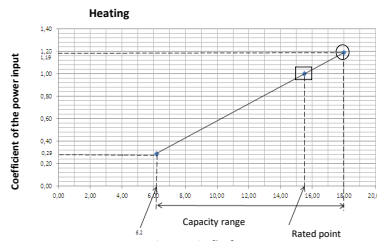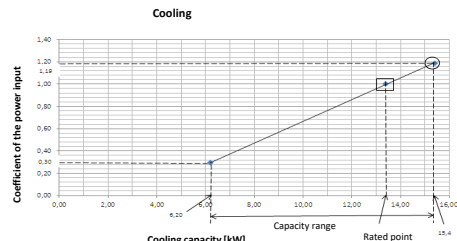

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

Cooling capacity [kW]

Indoor	Outdoor temperature [°C DB]													
	27			30			35			40				
°CWB	°CDB	kW	SHC	CPI	°CWB	°CDB	kW	SHC	CPI	°CWB	°CDB	kW	SHC	CPI
16.0	22	15.50	10.47	0.98	14.93	10.25	1.08	14.44	10.03	1.18	13.86	9.89	1.28	
18.0	25	16.17	10.55	0.98	15.62	10.21	1.09	15.11	10.01	1.19	14.52	9.71	1.30	
19.0	27	16.56	10.63	0.99	15.96	10.18	1.09	15.46	9.98	1.19	14.83	9.76	1.30	
19.5	27	16.74	10.49	0.99	16.14	10.16	1.10	15.57	10.00	1.19	14.88	9.66	1.30	
22.0	30	17.81	10.57	0.99	17.01	10.16	1.10	16.36	9.87	1.21	15.76	9.60	1.31	
24.0	33	18.38	10.62	1.00	17.72	10.00	1.11	17.04	9.87	1.22	16.43	9.47	1.32	

Heating

Indoor	Outdoor temperature [°C WB]														
	-15.0			-10.0			-5.0			0.0					
°CDB	°CWB	kW	CPI	°CDB	°CWB	kW	CPI	°CDB	°CWB	kW	CPI	°CDB	°CWB	kW	CPI
16	11.6	0.91	1.27	0.97	13.6	1.00	13.9	1.03	18.0	1.09	19.4	1.16			
18	11.6	0.95	1.27	1.00	13.6	1.04	13.9	1.07	18.0	1.14	19.4	1.21			
20	11.6	0.99	1.27	1.05	13.5	1.09	13.9	1.11	18.0	1.19	19.4	1.25			
21	11.5	1.00	1.27	1.06	13.5	1.11	13.9	1.13	18.0	1.21	19.4	1.28			
22	11.5	1.02	1.27	1.08	13.5	1.12	13.9	1.16	18.0	1.24	19.4	1.30			
24	11.5	1.07	1.26	1.12	13.5	1.17	13.9	1.20	18.0	1.29	19.4	1.35			

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units -EWB & EDB.
 -SHC for other dry-bulb temperatures = SHC + SHC*.
 SHC* = -SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is -7°C DB / 6°C WB.
 Corresponding refrigerant piping length: -5.0 m
 Level difference: -0 m
 - Pair

FCAG140H	FCAG140B	FVA140A	FHA140A	FBA140A
AFR	33.5	26.0	30.0	34.0
(BF)	(0.15)	(0.23)	(0.18)	(0.17)
 - Twin

FCAG71H X 2	FCAG71B X 2	FAA71A X 2	FVA71A X 2	FHA71A X 2	FUA71A X 2	FBA71A X 2
AFR	21.2 x 2	15.3 x 2	18.0 x 2	20.5 x 2	23.0 x 2	18.0 x 2
(BF)	(0.20 x 2)	(0.14 x 2)	(0.16 x 2)	(0.13 x 2)	(0.13 x 2)	(0.16 x 2)
 - Triple

FFAG50B X 3	FHA50A X 3	FFA50A X 3	FDXM35F X 3	FBA50A X 3	FNA50A X 3
AFR	12.5 x 3	15.0 x 3	12.0 x 3	15.0 x 3	15.0 x 3
(BF)	(0.22 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)	(0.11 x 3)
 - Double twin

FCAG35B X 4	FHA35A X 4	FFA35A X 4	FDXM35F X 4	FBA35A X 4	FNA35A X 4
AFR	12.5 x 4	14.0 x 4	10.0 x 4	8.7 x 4	15.0 x 4
(BF)	(0.40 x 4)	(0.20 x 4)	(0.25 x 4)	(0.17 x 4)	(0.17 x 4)

Pair

FCAG140H	FCAG140B	FVA140A	FHA140A	FBA140A
Cooling	3.64	4.29	4.42	4.31
Heating	3.64	4.55	4.48	4.33

Twin

FCAG71H X 2	FCAG71B X 2	FAA71A X 2	FVA71A X 2	FHA71A X 2	FUA71A X 2	FBA71A X 2
Cooling	2.89	3.15	3.27	3.01	3.02	2.97
Heating	3.03	3.69	3.67	3.50	3.28	3.55

Triple

FCAG50B X 3	FHA50A X 3	FFA50A X 3	FDXM35F X 3	FBA50A X 3	FNA50A X 3	
Cooling	2.88	3.14	3.27	2.65	3.06	2.79
Heating	3.44	3.29	3.87	2.96	3.23	3.03



Double twin

FCAG35B X 4	FHA35A X 4	FFA35A X 4	FDXM35F X 4	FBA35A X 4	FNA35A X 4	
Cooling	3.08	2.73	3.04	2.87	3.32	2.94
Heating	3.97	2.89	4.19	3.49	4.22	3.53

3D125183

RZAG71NV1

RZAG71NY1

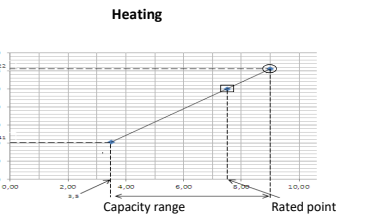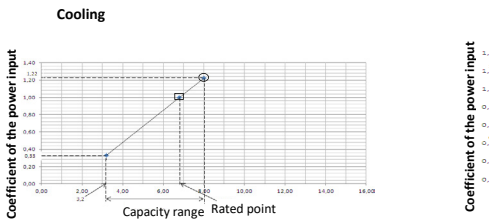

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors

Cooling capacity [kW]

Indoor	Outdoor temperature [°C DB]													
	25			30			35			40				
°CWB	°CDB	kW	SHC	CPI	°CWB	°CDB	kW	SHC	CPI	°CWB	°CDB	kW	SHC	CPI
16.0	22	8.01	5.46	1.00	7.76	5.32	1.11	7.48	5.20	1.21	7.21	5.06	1.30	
18.0	25	8.40	5.46	1.00	8.11	5.32	1.11	7.83	5.19	1.22	7.54	5.05	1.33	
19.0	27	8.69	5.44	1.00	8.30	5.32	1.12	8.06	5.18	1.23	7.70	5.05	1.33	
19.5	27	8.69	5.40	1.00	8.39	5.31	1.12	8.05	5.17	1.23	7.70	5.05	1.33	
22.0	30	9.15	5.38	1.01	8.84	5.25	1.12	8.52	5.13	1.23	8.21	4.99	1.34	
24.0	33	9.33	5.31	1.03	9.20	5.19	1.13	8.87	5.08	1.25	8.54	4.92	1.35	

Heating

Indoor	Outdoor temperature [°C WB]														
	-15.0			-10.0			-5.0			0.0					
°CDB	°CWB	kW	CPI	°CDB	°CWB	kW	CPI	°CDB	°CWB	kW	CPI	°CDB	°CWB	kW	CPI
16	6.44	0.82	1.09	0.99	7.65	1.02	7.79	1.06	9.00	1.12	9.71	1.19			
18	6.43	0.86	1.09	1.03	7.64	1.02	7.78	1.10	9.00	1.17	9.71	1.24			
20	6.42	1.01	1.07	1.07	7.63	1.12	7.77	1.14	9.00	1.22	9.71	1.28			
21	6.42	1.03	1.07	1.09	7.63	1.13	7.77	1.16	9.00	1.24	9.71	1.31			
22	6.42	1.06	1.06	1.11	7.62	1.15	7.76	1.19	9.00	1.27	9.71	1.33			
24	6.41	1.09	1.05	1.15	7.61	1.20	7.75	1.23	9.00	1.32	9.67	1.38			

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units -EWB & EDB.
 -SHC for other dry-bulb temperatures = SHC + SHC*.
 SHC* = -SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is -7°C DB / 6°C WB.
 Corresponding refrigerant piping length: -5.0 m
 Level difference: -0 m
 - Pair

FCAG71H	FCAG71B	FAA71A	FVA71A	FHA71A	FUA71A	FBA71A
AFR	21.2	15.3	18.0	20.5	23.0	18.0
(BF)	(0.20)	(0.14)	(0.16)	(0.16)	(0.24)	(0.13)
 - Twin

FCAG35B X 2	FHA35A X 2	FFA35A X 2	FDXM35F X 2	FBA35A X 2	FNA35A X 2
AFR	12.5 x 2	14.0 x 2	10.0 x 2	8.7 x 2	15.0 x 2
(BF)	(0.40 x 2)	(0.17 x 2)	(0.25 x 2)	(0.17 x 2)	(0.17 x 2)

Pair

FCAG71H	FCAG71B	FAA71A	FVA71A	FHA71A	FUA71A	FBA71A
Cooling	1.65	1.92	2.08	2.08	1.81	1.77
Heating	1.60	2.02	2.19	2.21	1.90	1.73

Twin

FCAG35B X 2	FHA35A X 2	FFA35A X 2	FDXM35F X 2	FBA35A X 2	FNA35A X 2	
Cooling	1.56	1.53	1.75	1.64	1.67	1.68
Heating	1.59	1.69	2.25	1.84	1.90	1.86

3D125180

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

RZAG140NV1
RZAG140NY1
Performance characteristics for -EDP- room

Indoor			Outdoor temperature [°C DB]																																																			
			-20				-15				-10				-5				0				5				10				15				20				25				30				35				40			
			TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW								
41.8	11	18	8.24	8.24	0.31	8.24	8.24	0.32	8.24	8.24	0.33	8.24	8.24	0.34	8.24	8.24	0.35	8.24	8.24	0.37	8.24	8.24	0.37	8.24	8.24	0.37	8.24	8.24	0.38	10.95	9.96	0.96	10.37	9.62	1.06	9.79	9.27	1.16	9.28	8.92	1.25													

Symbol:
 TC: Maximum total cooling capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 P: Power input [kW]
 compressor + indoor and outdoor fan motors
 RH: Relative humidity [%]

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - The capacities are based on the following conditions:
 Outdoor air: 85% RH
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m
 - For EDP applications, it is recommended to use outdoor unit setting 2-57-2.
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The rated power input for each model is mentioned in the table below.

Pair	FCAG140H	FCAG140B	FVA140A	FHA140A	FBA140A
Cooling	3.04	4.29	4.42	4.31	4.69

Twin	FCAG71Hx2	FCAG71Bx2	FHA71Ax2	FUA71Ax2	FAA71Ax2	FBA71Ax2
Cooling	2.89	3.15	3.01	3.02	3.27	2.97

Triple	FCAG50Bx3	FHA50Ax3	FFA50Ax3	FDXM50F3	FBA50Ax3
Cooling	2.88	3.14	3.37	2.65	3.06

Double twin	FCAG35Bx4	FHA35Ax4	FFA35Ax4	FDXM35F4	FBA35Ax4
Cooling	3.08	2.73	3.04	2.87	3.32

3D125187
RZAG125NV1
RZAG125NY1
Performance characteristics for -EDP- room

Indoor			Outdoor temperature [°C DB]																																																			
			-20				-15				-10				-5				0				5				10				15				20				25				30				35				40			
			TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW	TC	SHC	CPI	kW								
41.8	11	18	7.49	7.49	0.32	7.49	7.49	0.33	7.49	7.49	0.34	7.49	7.49	0.35	7.49	7.49	0.36	7.49	7.49	0.37	7.49	7.49	0.38	7.49	7.49	0.38	10.25	9.60	0.98	9.71	9.28	1.08	9.17	8.74	1.18	8.69	8.60	1.27																

Symbol:
 TC: Maximum total cooling capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 P: Power input [kW]
 compressor + indoor and outdoor fan motors
 RH: Relative humidity [%]

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - The capacities are based on the following conditions:
 Outdoor air: 85% RH
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m
 - For EDP applications, it is recommended to use outdoor unit setting 2-57-2.
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The rated power input for each model is mentioned in the table below.

Pair	FCAG140H	FCAG140B	FVA140A	FHA140A	FBA140A
Cooling	3.09	3.07	3.17	3.05	2.99

Twin	FCAG71Hx2	FCAG71Bx2	FHA71Ax2	FUA71Ax2	FAA71Ax2	FBA71Ax2
Cooling	2.57	2.79	2.68	2.69	2.88	2.64

Triple	FCAG50Bx3	FHA50Ax3	FFA50Ax3	FDXM50F3	FBA50Ax3
Cooling	2.57	2.79	2.97	2.36	2.74

Double twin	FCAG35Bx4	FHA35Ax4	FFA35Ax4	FDXM35F4	FBA35Ax4
Cooling	2.51	2.45	2.71	2.55	2.96

3D125186

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

6

RZAG100NV1 RZAG100NY1

Performance characteristics for ·EDP· room

Indoor			Outdoor temperature [°C DB]																																																
			-20				-15				-10				-5				0				5				10				15				20				25				30				35				40
RH [%]	°CWB	°CDB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI										
41.8	11	18	6.00	6.00	0.32	6.00	6.00	0.33	6.00	6.00	0.34	6.00	6.00	0.35	6.00	6.00	0.37	6.00	6.00	0.38	6.00	6.00	0.38	6.00	6.00	0.39	6.00	6.00	0.39	8.36	7.98	1.00	7.92	7.72	1.10	7.48	7.43	1.20	7.09	7.15	1.29										
57.0	13	18	7.48	6.37	0.42	7.48	6.37	0.42	7.48	6.37	0.44	7.48	6.37	0.45	7.48	6.37	0.46	7.48	6.37	0.46	7.48	6.37	0.46	7.48	6.37	0.46	7.48	6.37	0.46	9.71	7.67	1.00	9.30	7.42	1.11	8.90	7.16	1.21	8.45	6.88	1.30										
31.4	11	20	6.00	6.00	0.32	6.00	6.00	0.33	6.00	6.00	0.34	6.00	6.00	0.35	6.00	6.00	0.37	6.00	6.00	0.38	6.00	6.00	0.38	6.00	6.00	0.39	6.00	6.00	0.39	8.36	8.36	1.00	7.92	7.92	1.10	7.48	7.48	1.20	7.09	7.09	1.29										
44.9	13	20	7.48	7.25	0.42	7.48	7.25	0.44	7.48	7.25	0.45	7.48	7.25	0.46	7.48	7.25	0.46	7.48	7.25	0.46	7.48	7.25	0.46	7.48	7.25	0.46	7.48	7.25	0.46	9.71	8.53	1.00	9.30	8.28	1.11	8.90	8.01	1.21	8.45	8.45	1.30										
52.0	14	20	8.22	7.18	0.46	8.22	7.18	0.47	8.22	7.18	0.48	8.22	7.18	0.49	8.22	7.18	0.50	8.22	7.18	0.50	8.22	7.18	0.50	8.22	7.18	0.50	8.22	7.18	0.50	10.50	8.45	1.01	10.23	8.31	1.11	9.95	8.17	1.21	9.68	7.94	1.31										
22.9	11	22	6.00	6.00	0.32	6.00	6.00	0.33	6.00	6.00	0.34	6.00	6.00	0.35	6.00	6.00	0.37	6.00	6.00	0.38	6.00	6.00	0.38	6.00	6.00	0.39	6.00	6.00	0.39	8.36	8.36	1.00	7.92	7.92	1.10	7.48	7.48	1.20	7.09	7.09	1.29										
34.8	13	22	7.48	7.48	0.42	7.48	7.48	0.44	7.48	7.48	0.45	7.48	7.48	0.46	7.48	7.48	0.46	7.48	7.48	0.46	7.48	7.48	0.46	7.48	7.48	0.46	7.48	7.48	0.46	9.71	9.71	1.00	9.30	9.30	1.11	8.90	8.90	1.21	8.45	8.45	1.30										
47.6	15	22	8.96	7.82	0.51	8.96	7.82	0.52	8.96	7.82	0.53	8.96	7.82	0.54	8.96	7.82	0.55	8.96	7.82	0.55	8.96	7.82	0.55	8.96	7.82	0.55	8.96	7.82	0.55	11.28	9.19	1.01	10.89	8.96	1.11	10.51	8.72	1.22	10.12	8.48	1.32										
54.3	16	22	9.70	7.54	0.56	9.70	7.54	0.56	9.70	7.54	0.58	9.70	7.54	0.59	9.70	7.54	0.59	9.70	7.54	0.59	9.70	7.54	0.59	9.70	7.54	0.59	9.70	7.54	0.59	11.84	8.40	1.01	11.40	8.22	1.11	11.03	8.04	1.22	10.58	7.77	1.32										
21.2	12	24	6.74	6.74	0.37	6.74	6.74	0.38	6.74	6.74	0.39	6.74	6.74	0.40	6.74	6.74	0.41	6.74	6.74	0.42	6.74	6.74	0.42	6.74	6.74	0.42	6.74	6.74	0.42	9.04	9.04	1.00	8.61	8.61	1.10	8.19	8.19	1.21	7.77	7.77	1.30										
32.1	14	24	8.22	8.22	0.46	8.22	8.22	0.47	8.22	8.22	0.48	8.22	8.22	0.49	8.22	8.22	0.51	8.22	8.22	0.52	8.22	8.22	0.52	8.22	8.22	0.52	8.22	8.22	0.52	10.50	10.50	1.01	10.13	10.13	1.11	9.95	9.95	1.21	9.68	9.68	1.31										
43.8	16	24	9.70	8.68	0.56	9.70	8.68	0.56	9.70	8.68	0.58	9.70	8.68	0.59	9.70	8.68	0.59	9.70	8.68	0.59	9.70	8.68	0.59	9.70	8.68	0.59	9.70	8.68	0.59	11.84	9.74	1.01	11.40	9.51	1.12	11.03	9.32	1.22	10.58	9.06	1.32										
50.0	17	24	9.98	7.86	0.57	9.98	7.86	0.58	9.98	7.86	0.59	9.98	7.86	0.60	9.98	7.86	0.61	9.98	7.86	0.61	9.98	7.86	0.61	9.98	7.86	0.61	9.98	7.86	0.61	12.39	9.45	1.02	11.86	9.16	1.12	11.33	8.86	1.22	10.80	8.52	1.33										
21.5	14	27	8.22	8.22	0.46	8.22	8.22	0.47	8.22	8.22	0.48	8.22	8.22	0.49	8.22	8.22	0.51	8.22	8.22	0.52	8.22	8.22	0.52	8.22	8.22	0.52	8.22	8.22	0.52	10.50	10.50	1.01	10.13	10.13	1.11	9.95	9.95	1.21	9.68	9.68	1.31										
26.3	15	27	8.96	8.96	0.51	8.96	8.96	0.52	8.96	8.96	0.53	8.96	8.96	0.54	8.96	8.96	0.55	8.96	8.96	0.55	8.96	8.96	0.55	8.96	8.96	0.55	8.96	8.96	0.55	11.28	11.28	1.01	10.89	10.89	1.11	10.51	10.51	1.22	10.12	10.12	1.32										
31.3	16	27	9.70	9.70	0.56	9.70	9.70	0.56	9.70	9.70	0.58	9.70	9.70	0.59	9.70	9.70	0.60	9.70	9.70	0.60	9.70	9.70	0.60	9.70	9.70	0.60	9.70	9.70	0.60	11.84	11.84	1.01	11.40	11.40	1.12	11.03	11.03	1.22	10.58	10.58	1.32										

Symbols
 TC: Maximum total cooling capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 PI: Power input [kW]
 compressor + indoor and outdoor fan motors
 RH: Relative humidity [%]

Pair

	FAHG140H	FCAG140B	FVA140A	FHA140A	FBA140A
Cooling	2,15	2,28	2,39	2,32	2,25

Twin

	FAHG711A x 2	FCAG711B x 2	FHA711A x 2	FUA711A x 2	FAA711A x 2	FBA711A x 2
Cooling	2,15	2,15	2,10	2,11	2,19	2,06

Triple

	FCAG50B x 3	FHA50A x 3	FFA50A x 3	FDXM50F x 3	FBA50A x 3
Cooling	2,03	2,18	2,25	1,88	2,18

Double twin

	FCAG35B x 4	FHA35A x 4	FFA35A x 4	FDXM35F x 4	FBA35A x 4
Cooling	2,00	2,01	2,12	2,00	2,18

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - The capacities are based on the following conditions:
 Outdoor air: 85% RH
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m
 - For ·EDP· applications, it is recommended to use outdoor unit setting 2-57-2.
 - CPI· is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The rated power input for each model is mentioned in the table below.

3D125185

RZAG71NV1 RZAG71NY1

Performance characteristics for ·EDP· room


Indoor			Outdoor temperature [°C DB]																																																		
			-20				-15				-10				-5				0				5				10				15				20				25				30				35				40		
RH [%]	°CWB	°CDB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI												
41.8	11	18	6.02	5.05	0.33	6.02	5.05	0.33	6.02	5.05	0.34	6.02	5.05	0.35	6.02	5.05	0.36	6.02	5.05	0.37	6.02	5.05	0.37	6.02	5.05	0.38	6.02	5.05	0.38	6.02	5.05	0.39	6.02	5.05	0.39	8.41	4.97	0.46	8.41	4.97	0.48	5.90	5.90	0.98	5.85	5.85	1.09	5.80	5.80	1.19	5.76	5.76	1.30
31.4	11	20	6.02	5.05	0.33	6.02	5.05	0.33	6.02	5.05	0.34	6.02	5.05	0.35	6.02	5.05	0.36	6.02	5.05	0.37	6.02	5.05	0.37	6.02	5.05	0.38	6.02	5.05	0.38	6.02	5.05	0.39	6.02	5.05	0.39	8.41	4.97	0.46	8.41	4.97	0.48	5.90	5.90	0.98	5.85	5.85	1.09	5.80	5.80	1.19	5.76	5.76	1.30
44.9	13	20	6.02	5.05	0.33	6.02	5.05	0.33	6.02	5.05	0.34	6.02	5.05	0.35	6.02	5.05	0.36	6.02	5.05	0.37	6.02	5.05	0.37	6.02	5.05	0.38	6.02	5.05	0.38	6.02	5.05	0.39	6.02	5.05	0.39	8.41	4.97	0.46	8.41	4.97	0.48	5.90	5.90	0.98	5.85	5.85	1.09	5.80	5.80	1.19	5.76	5.76	1.30
52.0	14	20	6.62	5.76	0.34	6.62	5.76	0.34	6.62	5.76	0.35	6.62	5.76	0.36	6.62	5.76	0.37	6.62	5.76	0.37	6.62	5.76	0.38	6.62	5.76	0.38	6.62	5.76	0.39	6.62	5.76	0.39	8.41	4.97	0.46	8.41	4.97	0.48	5.90	5.90	0.98	5.85	5.85	1.09	5.80	5.80	1.19	5.76	5.76	1.30			
22.9	11	22	6.02	5.05	0.33	6.02	5.05	0.33	6.02	5.05	0.34	6.02	5.05	0.35	6.02	5.05	0.36	6.02	5.05	0.37	6.02	5.05	0.37	6.02	5.05	0.38	6.02	5.05	0.38	6.02	5.05	0.39	6.02	5.05	0.39	8.41	4.97	0.46	8.41	4.97	0.48	5.90	5.90	0.98	5.85	5.85	1.09	5.80	5.80	1.19	5.76	5.76	1.30
34.8	13	22	7.22	6.06	0.34	7.22	6.06	0.34	7.22	6.06	0.35	7.22	6.06	0.36	7.22	6.06	0.37	7.22	6.06	0.37	7.22	6																															

6 Capacity tables

6 - 2 Capacity Correction Factor

RZAG-NV1
RZAG-NY1

Capacity in function of field piping length

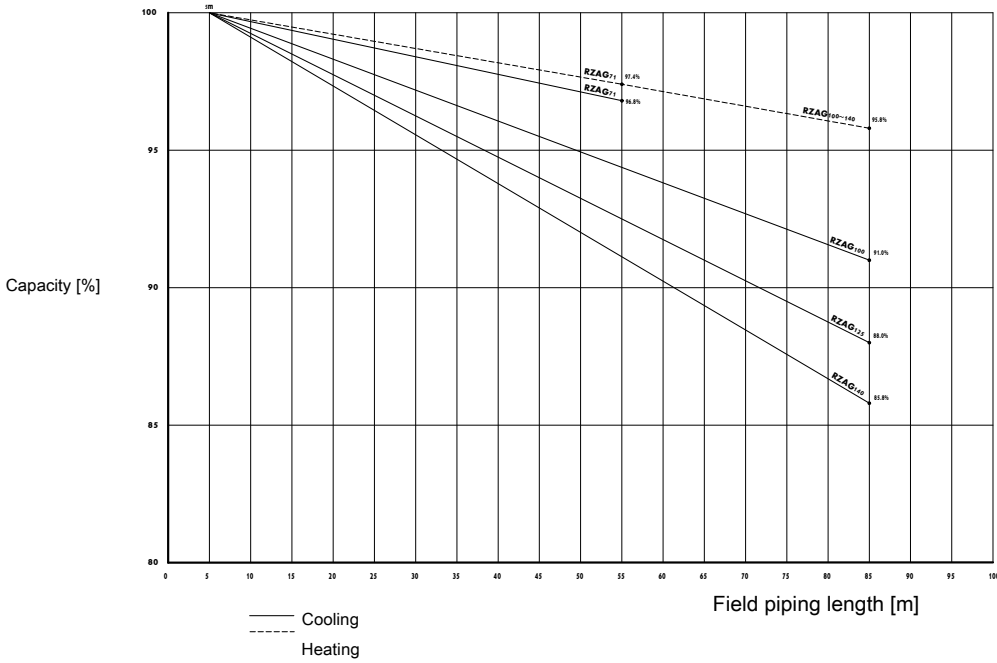


3D112162

7 Dimensional drawings

7 - 1 Dimensional Drawings

7

RZAG-NV1
RZAG-NY1

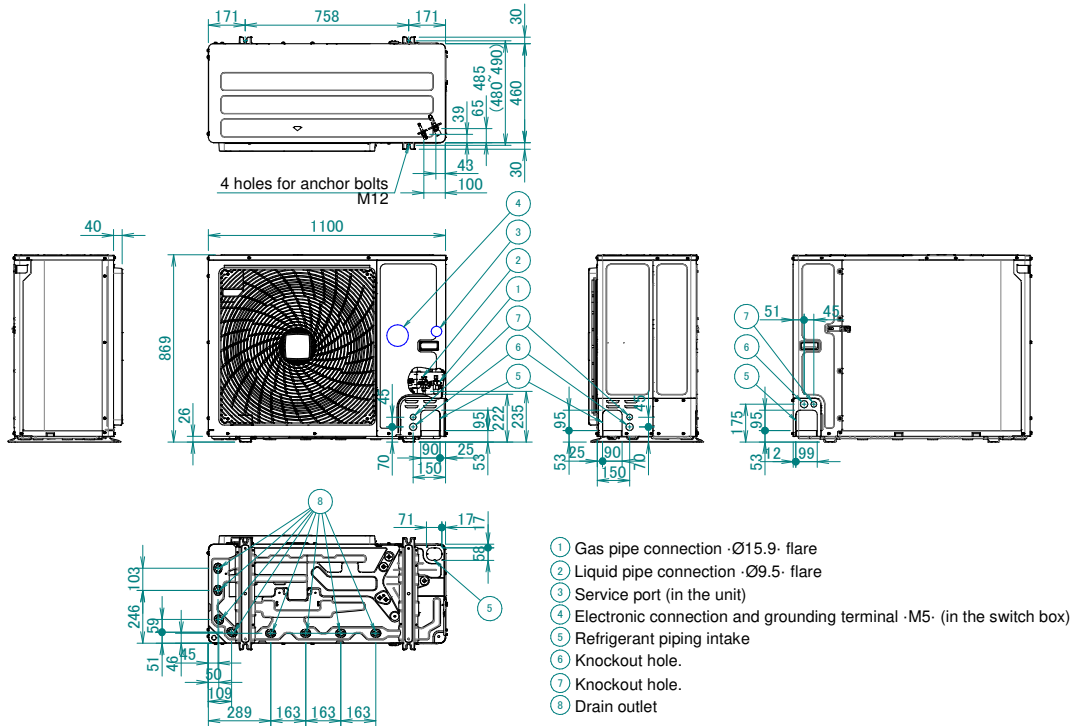


3D120936

8 Centre of gravity

8 - 1 Centre of Gravity

RZAG-NV1 RZAG-NY1

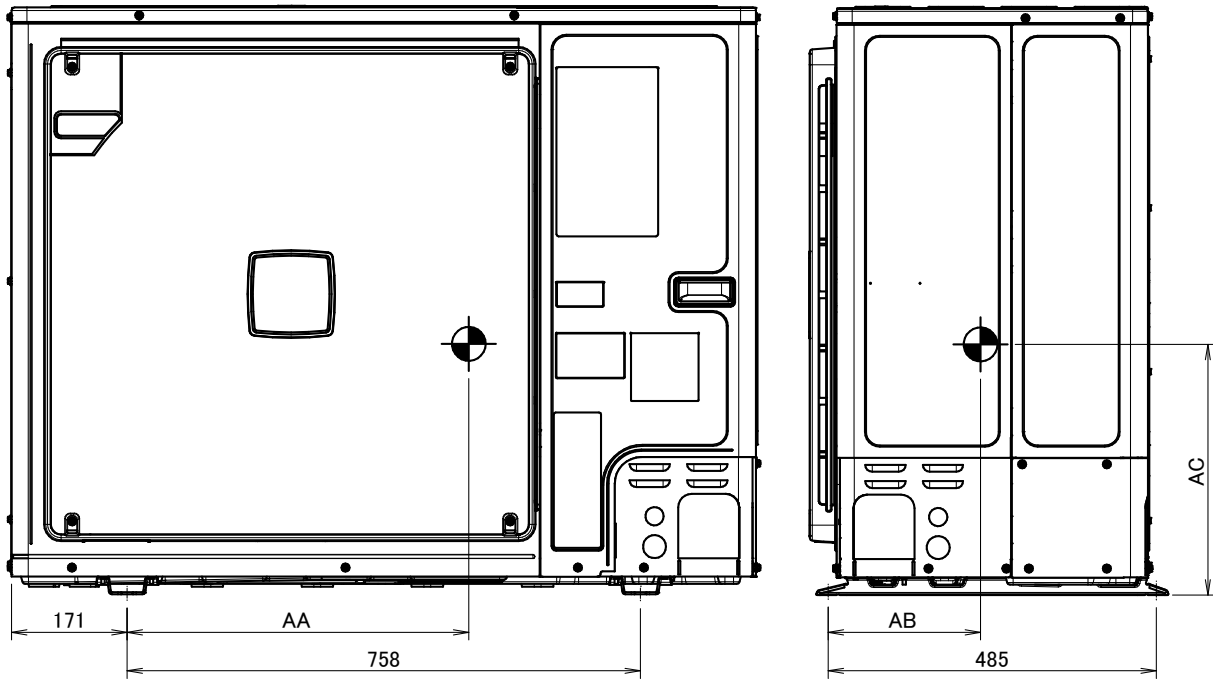

Model	AA	AB	AC
RZAG71N7V1B	520.3	238.7	357.8
RZAG71N7Y1B	525.9	224.7	359.8
RZAG100N7V1B	499.7	239.3	367.6
RZAG100N7Y1B	511.2	223.5	362.5
RZAG125/140N7V1B	486.3	229.2	371.8
RZAG125/140N7Y1B	493.4	215.8	372.2
RXYSA4/5/6A7V1B	530.4	249.9	389.0
RXYSA4/5/6A7Y1B			


4D120933B

9 Piping diagrams

9 - 1 Piping Diagrams

9

RZAG-NV1
RZAG-NY1

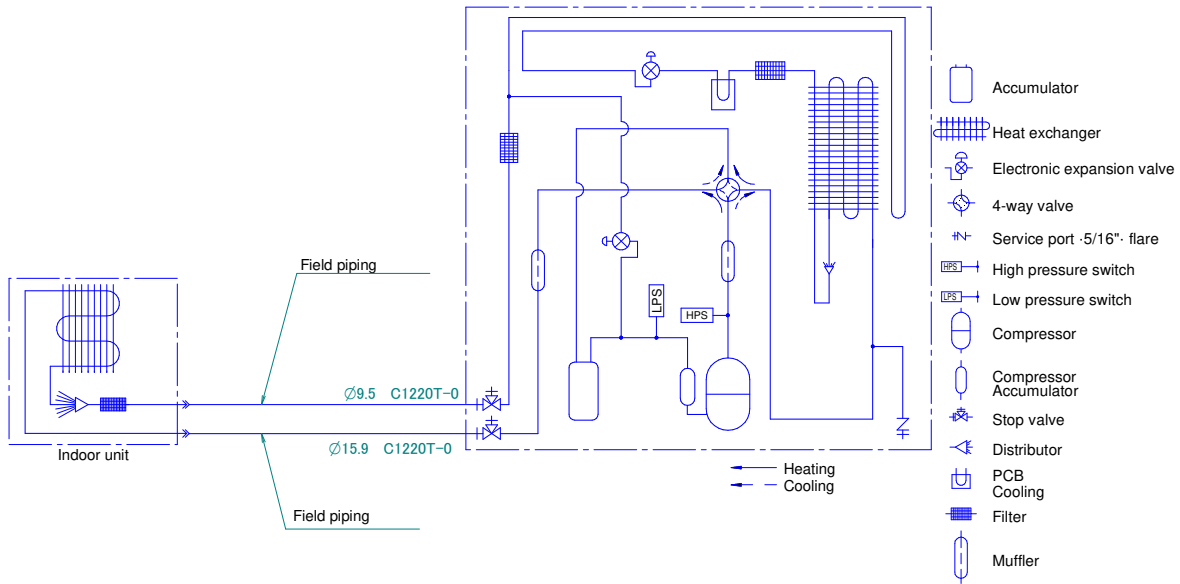

Notes


1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D120907

9 Piping diagrams

9 - 2 Piping Diagram Twin Application

RZAG-NV1
RZAG-NY1

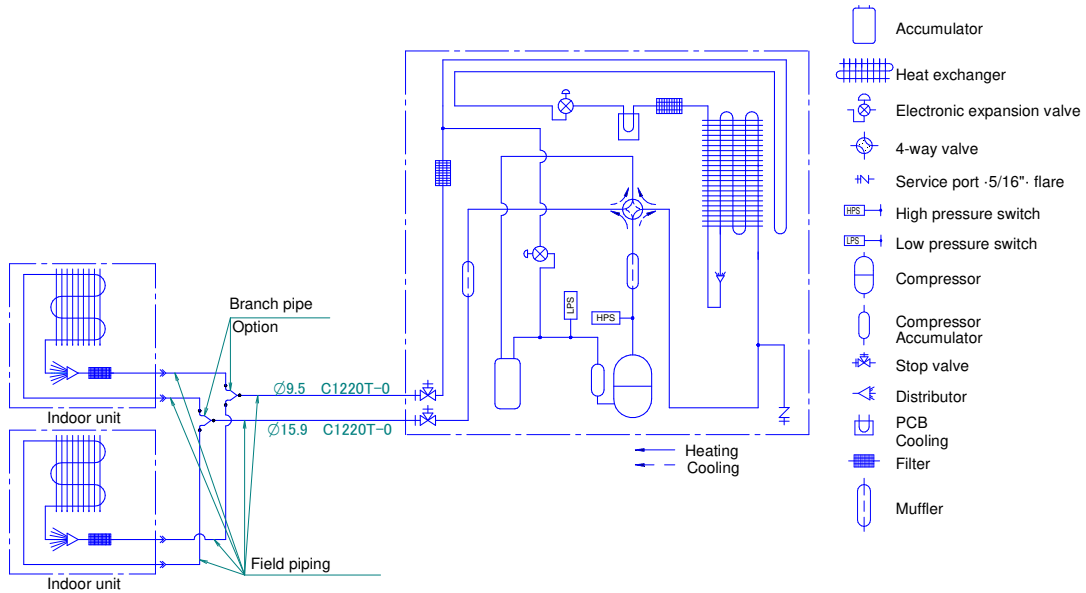

Notes

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.


3D120913

9 Piping diagrams

9 - 3 Piping Diagram Triple Application

9

RZAG100-140NV1
RZAG100-140NY1

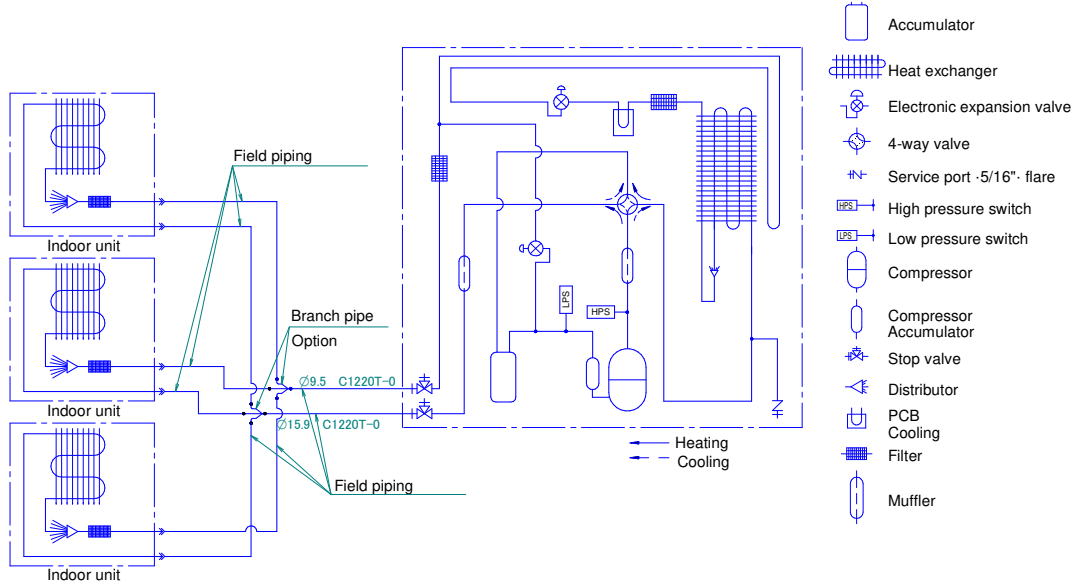

Notes


1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D120914

9 Piping diagrams

9 - 4 Piping Diagram Double Twin Application

RZAG125-140NV1
RZAG125-140NY1

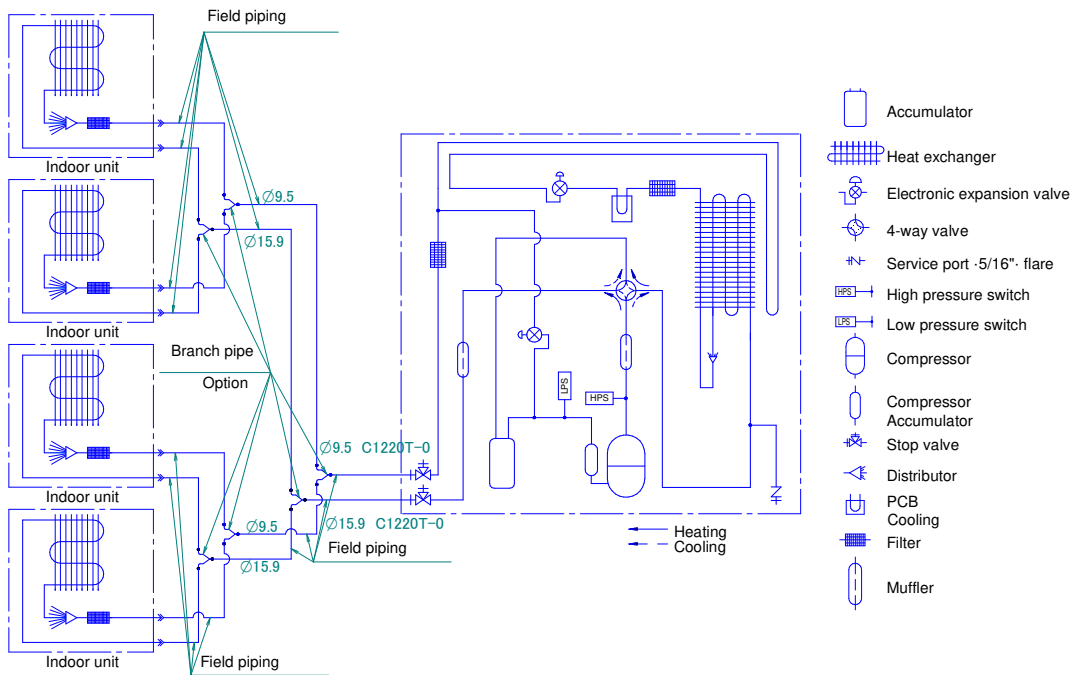

Notes

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.


3D120915

10 Wiring diagrams

10-1 Wiring Diagrams - Single Phase

10

RZAG-NY1

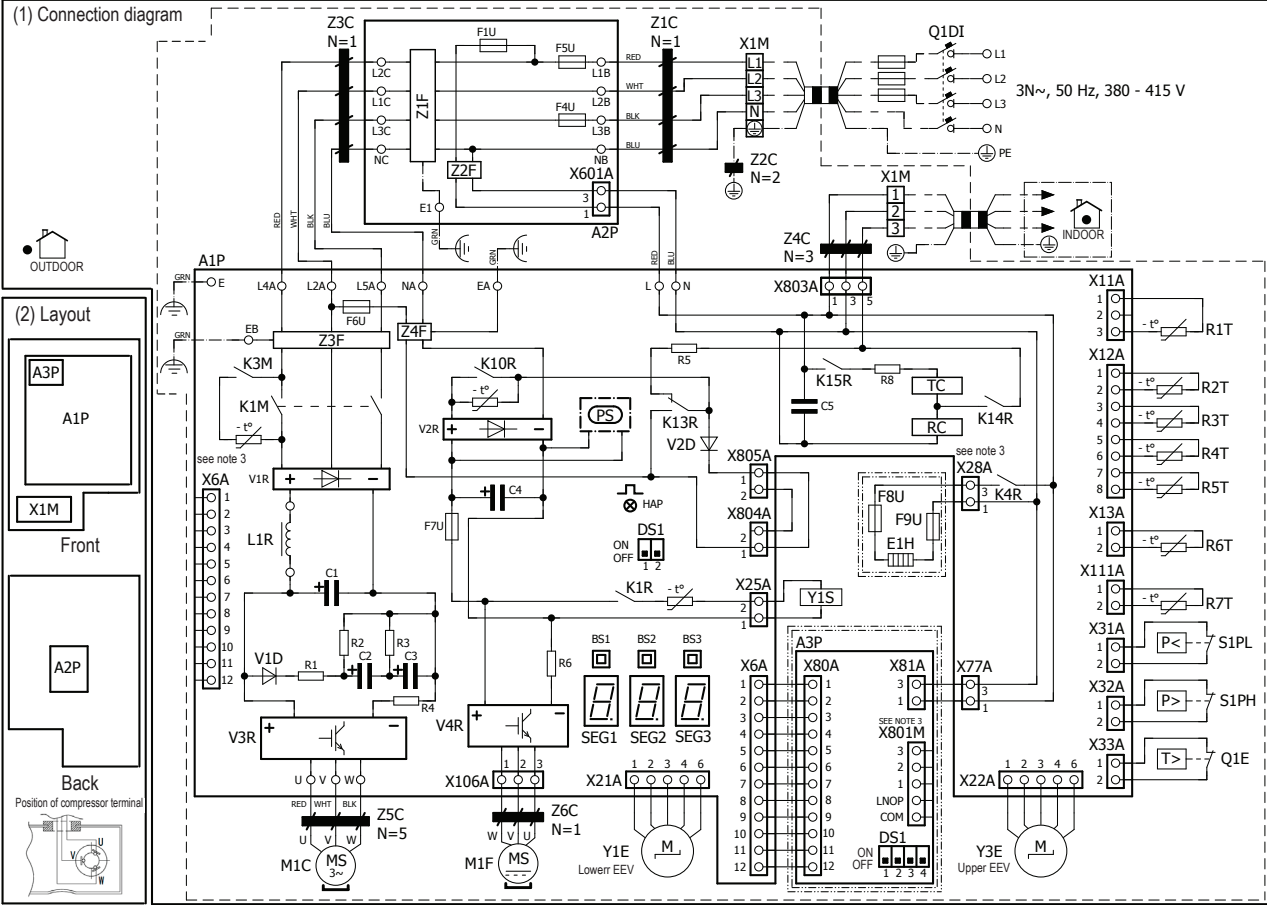

- (3) NOTES**
- : Connection
 - : Earth wiring
 - : Field supply
 - : Option
 - : switch box
 - : PCB
 - : Wiring depending on model
 - : Protective earth
 - : Field wire

(4) LEGEND

Part n°	Description
A1P	Printed circuit board (main)
A2P	Printed circuit board (noise filter)
A3P	* Printed circuit board (demand)
BS1-3 (A1P)	Push-button switch
C1-C5 (A1P)	Capacitor
DS1 (A1P, A3P)	Dipswitch
E1H	* Bottom plate heater
F1U (A2P)	Fuse T 6,3 A 250 V
F4U, F5U (A2P)	Fuse T 30 A 500 V
F6U (A1P)	Fuse T 6,3 A 250 V
F7U (A1P)	Fuse T 5 A 250 V
F8U, F9U	* Fuse F 1 A 250 V
HAP (A1P)	Light-emitting diode (service monitor is green)
K1M, K3M (A1P)	Magnetic contactor
K1R (A1P)	Magnetic relay (Y1S)
K4R (A1P)	Magnetic relay (E1H)
K10R	Magnetic relay
K13R-K15R (A1P)	Magnetic relay
L1R	Reactor
M1C	Compressor motor
M1F	Fan motor
PS (A1P)	Switching power supply
Q1DI	Earth leakage circuit breaker (30mA)

Part n°	Description
Q1E	Overload protection
R1-R6, R8 (A1P)	Resistor
R1T	Thermistor (air)
R2T	Thermistor (discharge)
R3T	Thermistor (suction)
R4T	Thermistor (heat exchanger)
R5T	Thermistor (heat exchanger middle)
R6T	Thermistor (liquid)
R7T	Thermistor (fin)
RC (A1P)	Signal receiver circuit
S1PH	High pressure switch
S1PL	Low pressure switch
SEG1-SEG3 (A1P)	7-segment display
TC (A1P)	Signal transmission circuit
V1D, V2D (A1P)	Diode
V1R, V2R (A1P)	Diode module
V3R, V4R (A1P)	IGBT power module
X1M	Terminal strip
Y1E, Y3E	Electronic expansion valve
Y1S	Solenoid valve (4-way valve)
Z1C-Z6C	Noise filter (ferrite core)
Z1F-Z4F (A1P-A2P)	Noise filter
L*A, L*B, NA, NB E*, U, V, W, X*A (A1P, A2P)	Connector

* : optional
: field supply


- NOTES**
- Refer to the wiring diagram sticker (on the back of the front plate) for how to use the BS1-BS3 and DS1 switches.
 - When operating, do not short-circuit protection device(s) S1PH, S1PL and Q1E.
 - Refer to the combination table and the option manual for how to connect the wiring to X28A and X801M.
 - Colours: BLK:black; RED:red; BLU:blue; WHT:white; GRN:green

4D120911

11 Sound data

11 - 1 Sound Power Spectrum

RZAG71NV1
RZAG71NY1

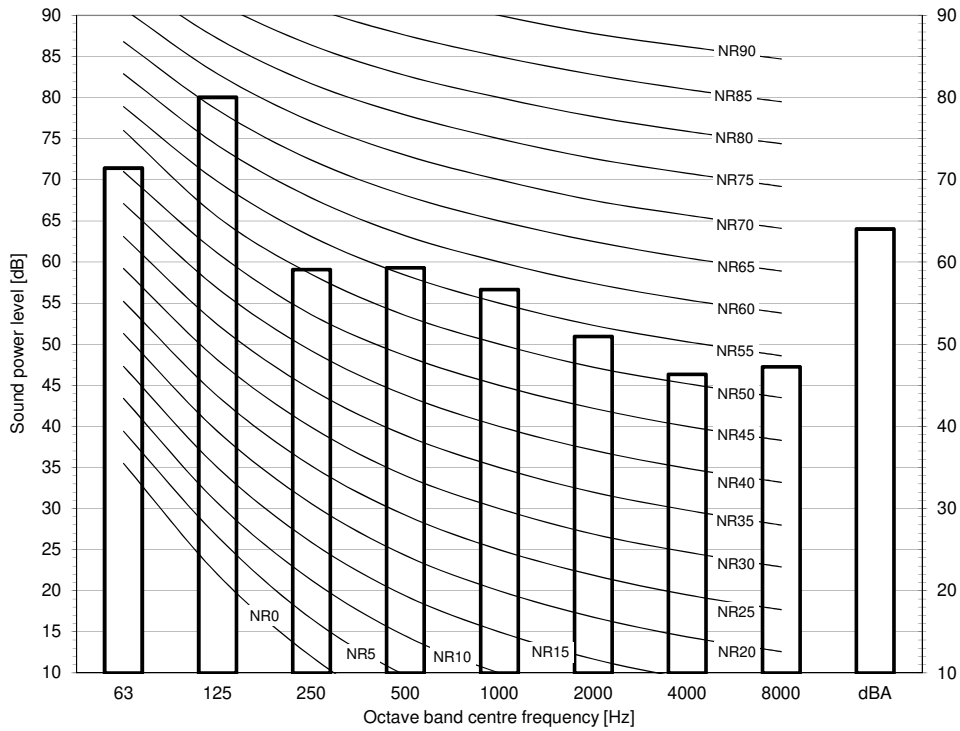


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $10E-6\mu W/m^2$.
- Measured according to ISO 3744

3D125149

RZAG100NV1
RZAG100NY1

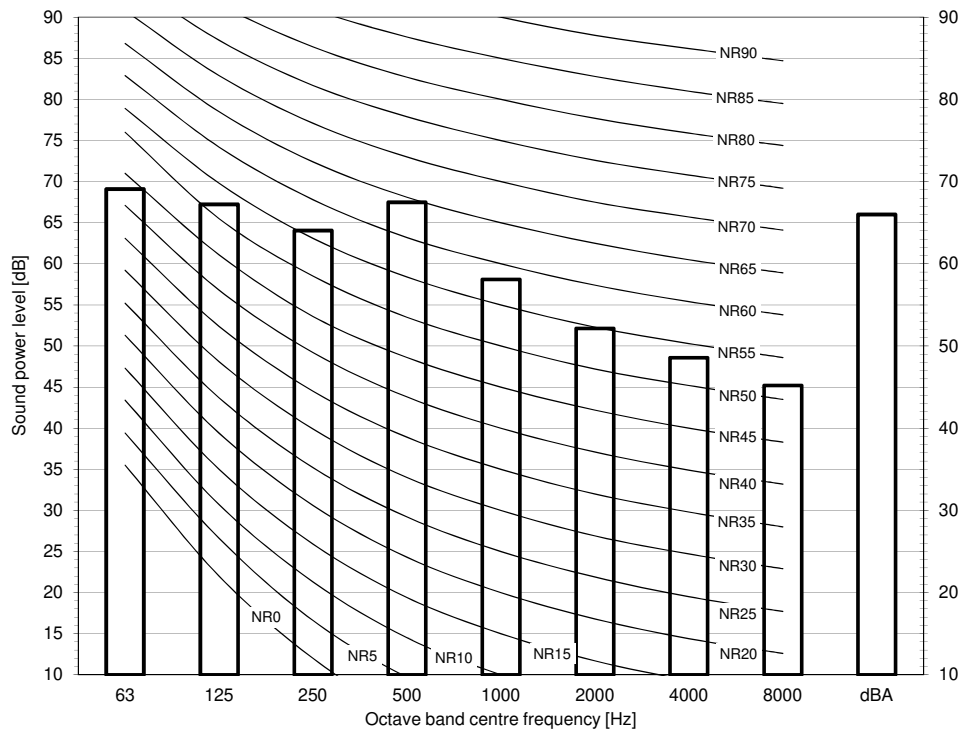

Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $10E-6\mu W/m^2$.
- Measured according to ISO 3744


3D125155

11 Sound data

11 - 1 Sound Power Spectrum

11

RZAG125NV1
RZAG125NY1

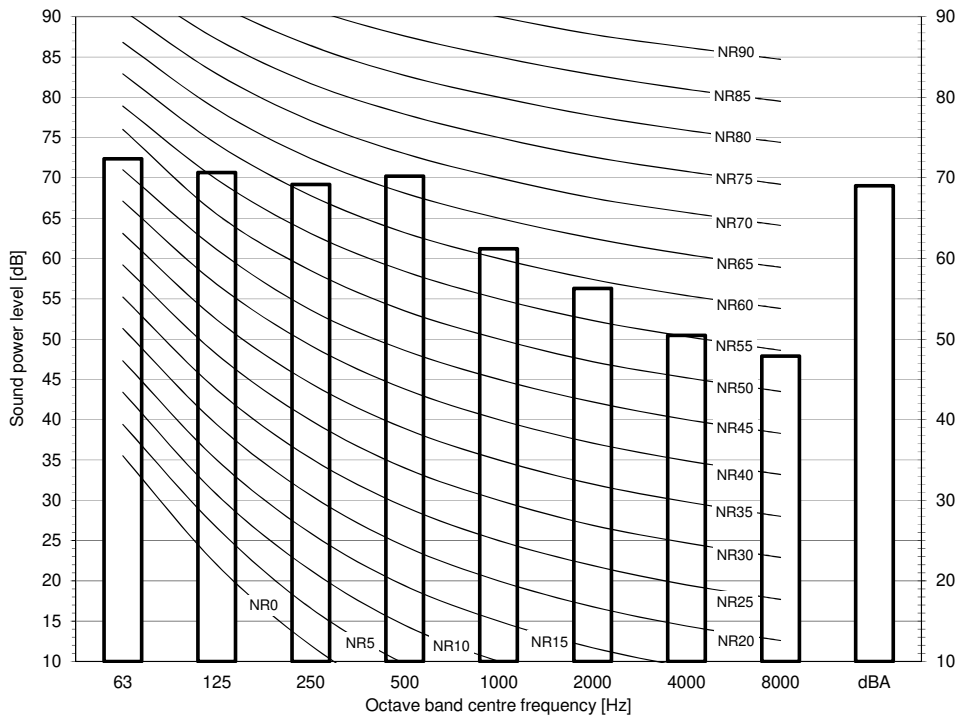


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $\cdot 10E-6\mu W/m^2$.
- Measured according to ISO 3744

3D125161

RZAG140NV1
RZAG140NY1

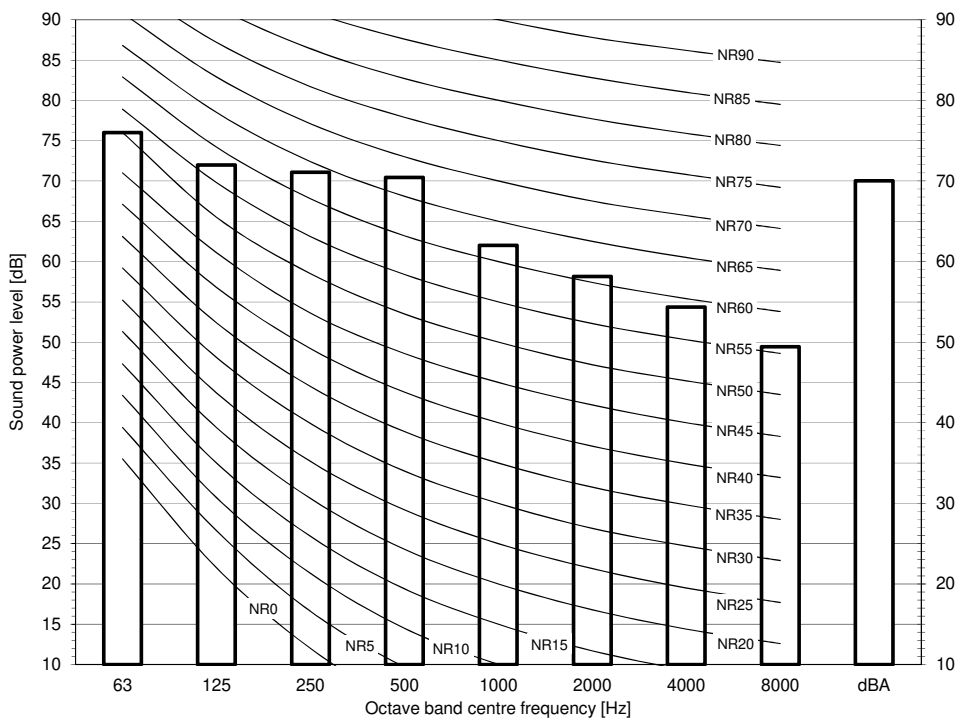

Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $\cdot 10E-6\mu W/m^2$.
- Measured according to ISO 3744


3D125167

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

RZAG71NV1

RZAG71NY1

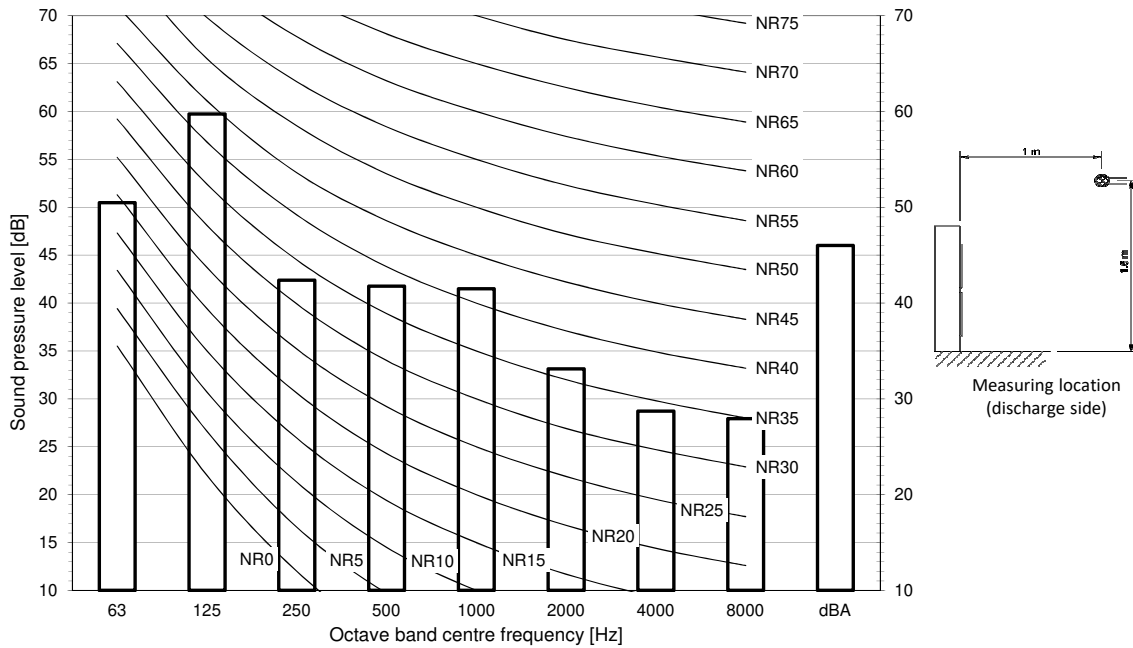


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125147

RZAG100NV1

RZAG100NY1

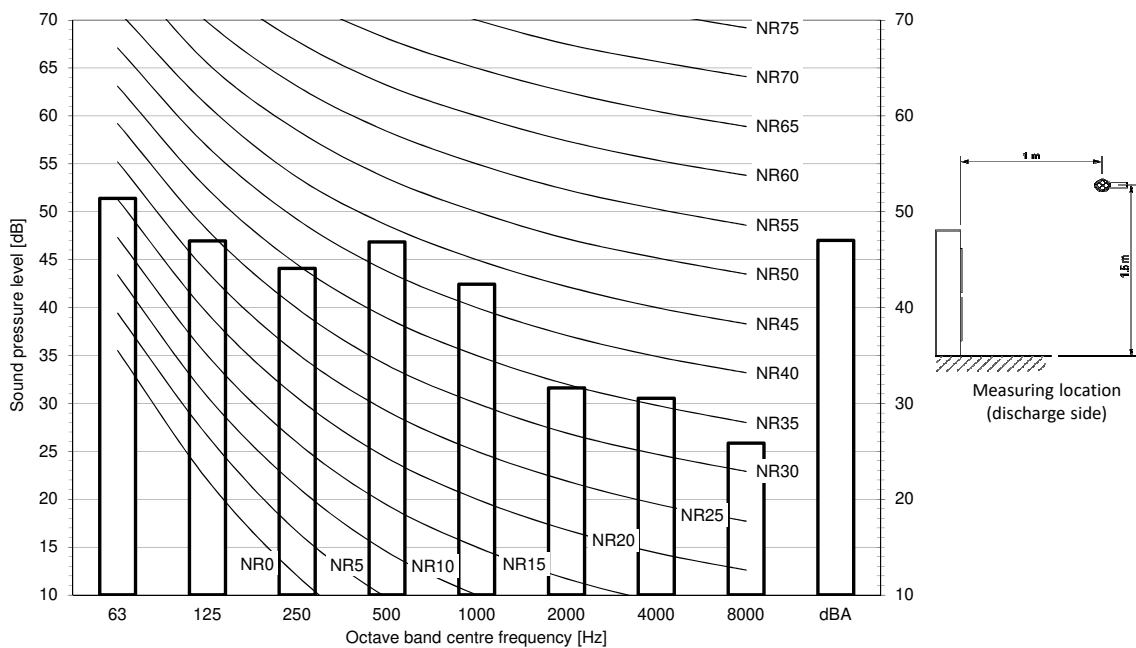

Notes



- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125153

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling



11

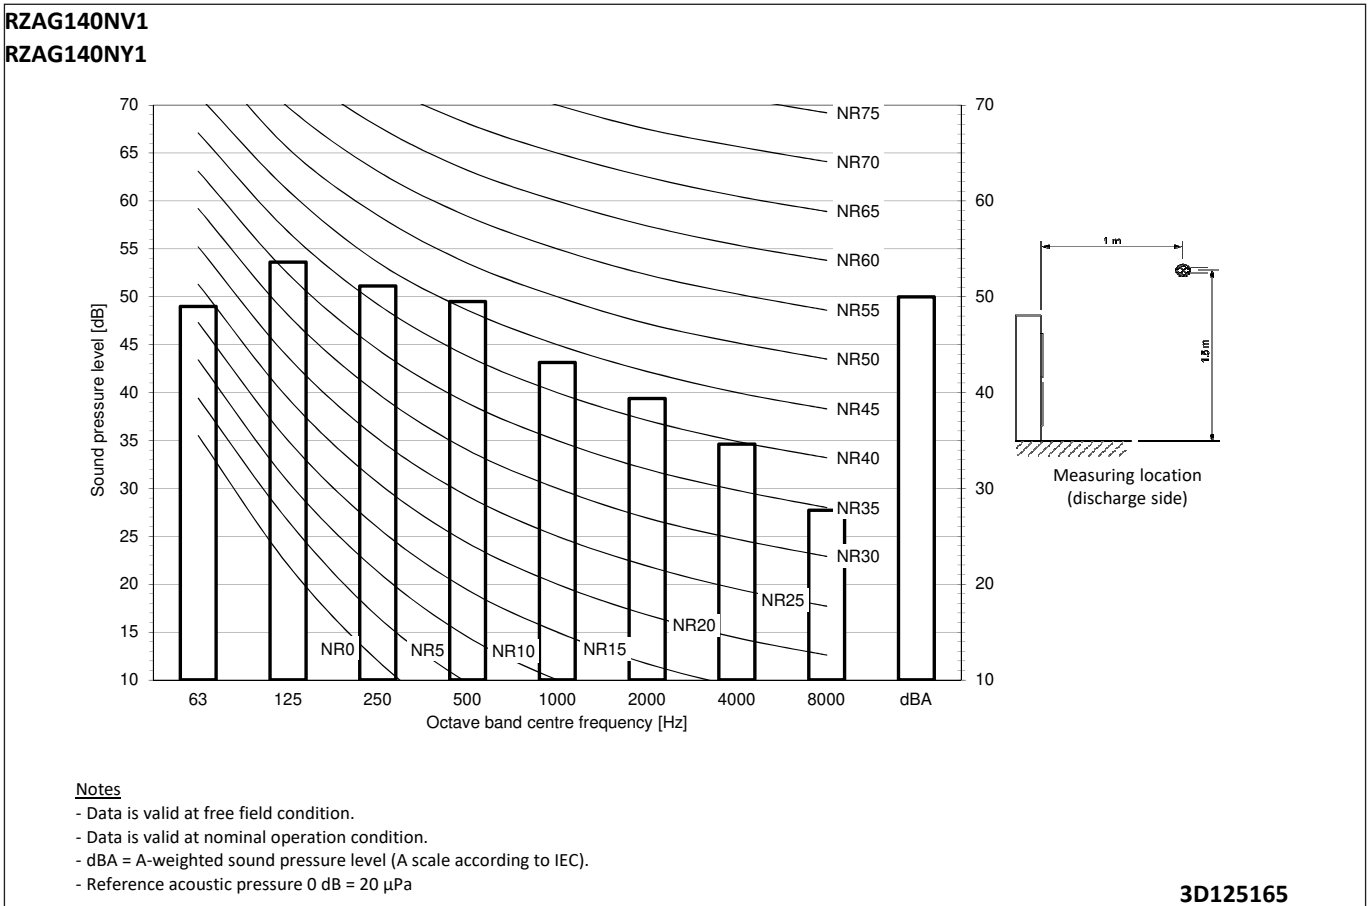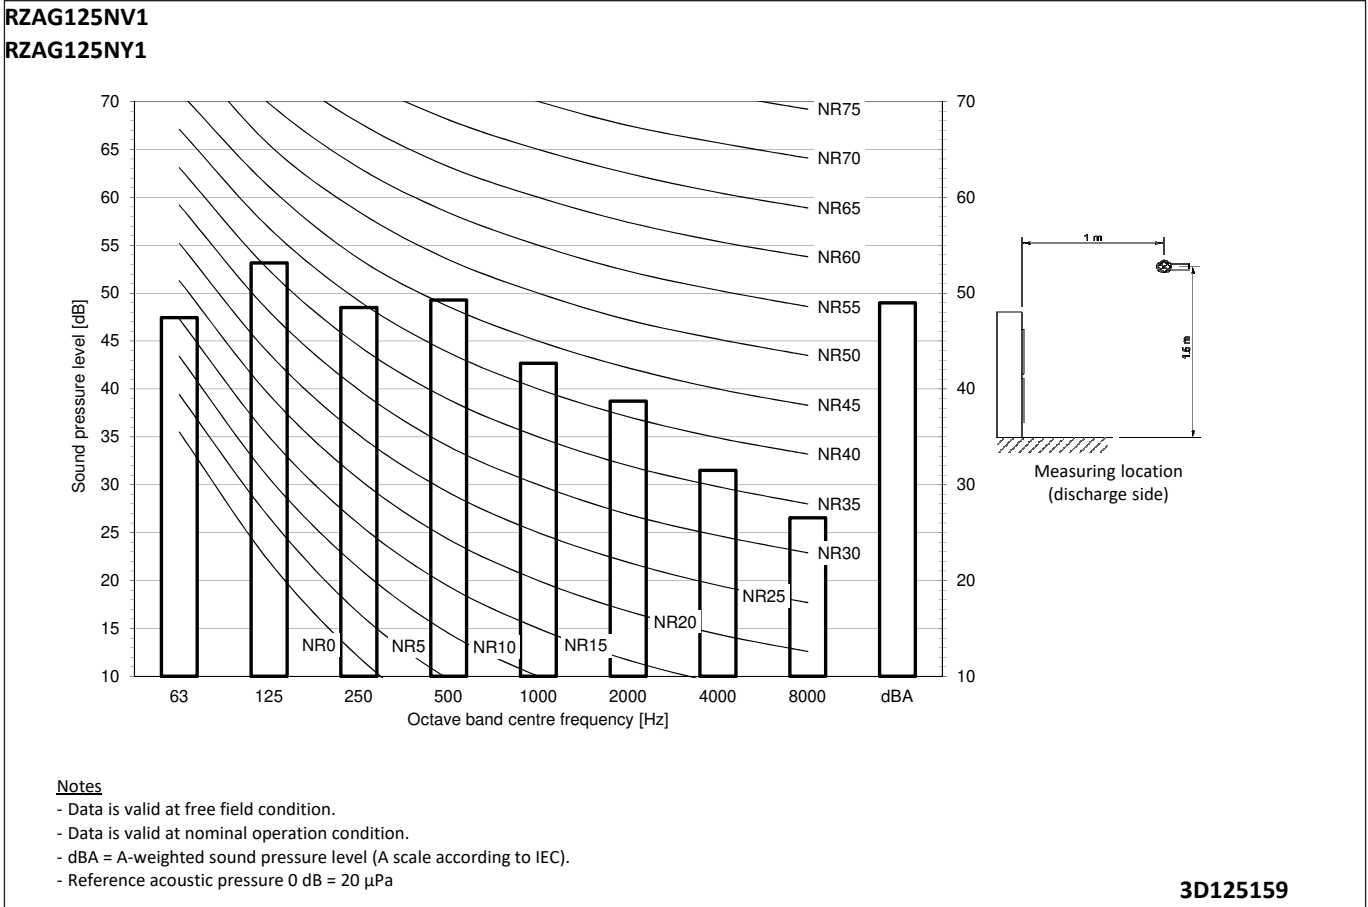

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

RZAG71NV1
RZAG71NY1


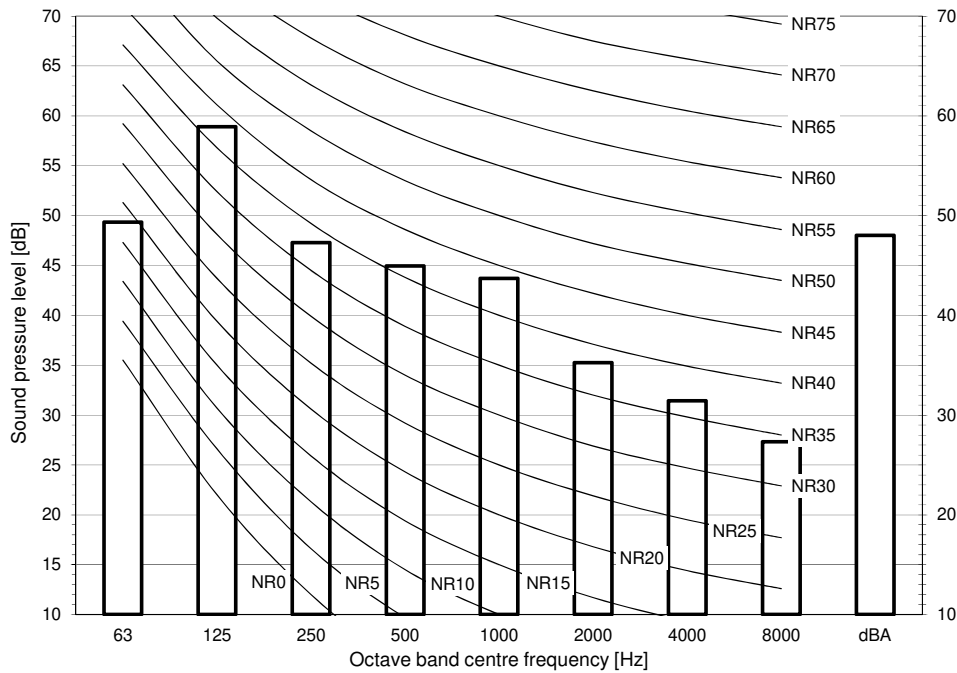


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125148

RZAG100NV1
RZAG100NY1

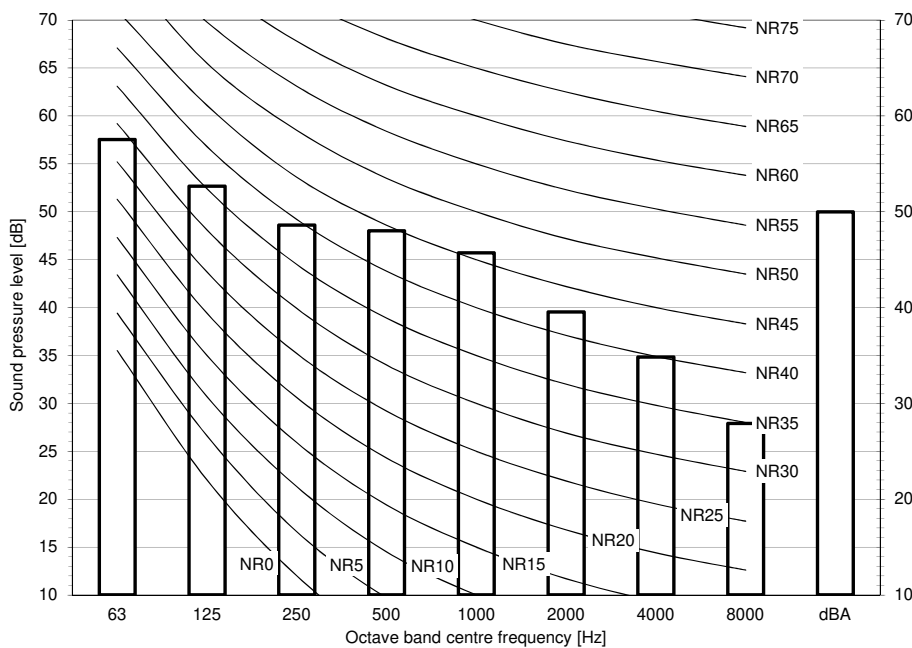

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa


3D125154

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

11

RZAG125NV1
RZAG125NY1

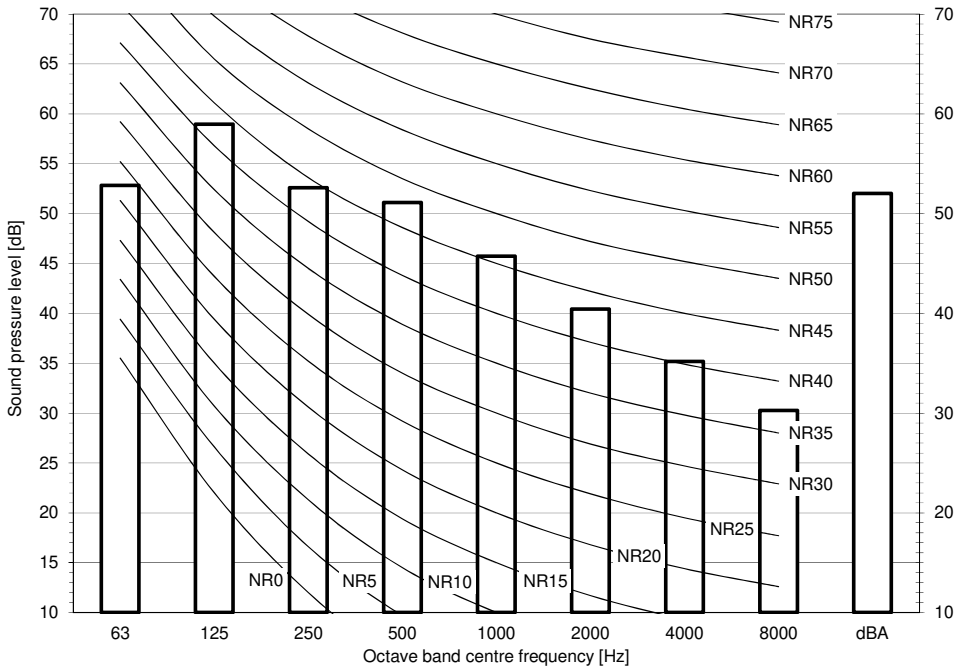


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125160

RZAG140NV1
RZAG140NY1

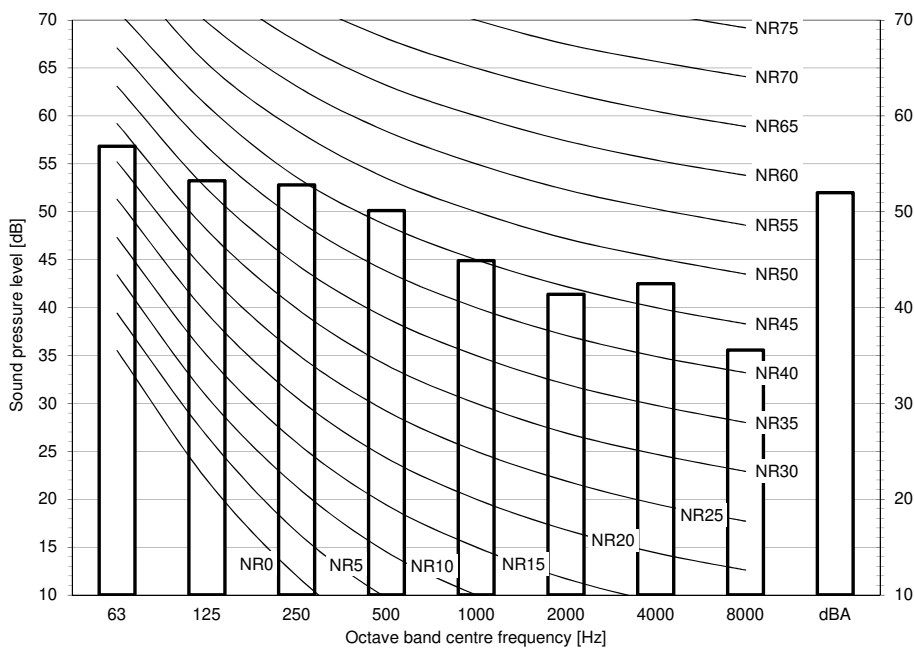



Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125166



11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode Level 1

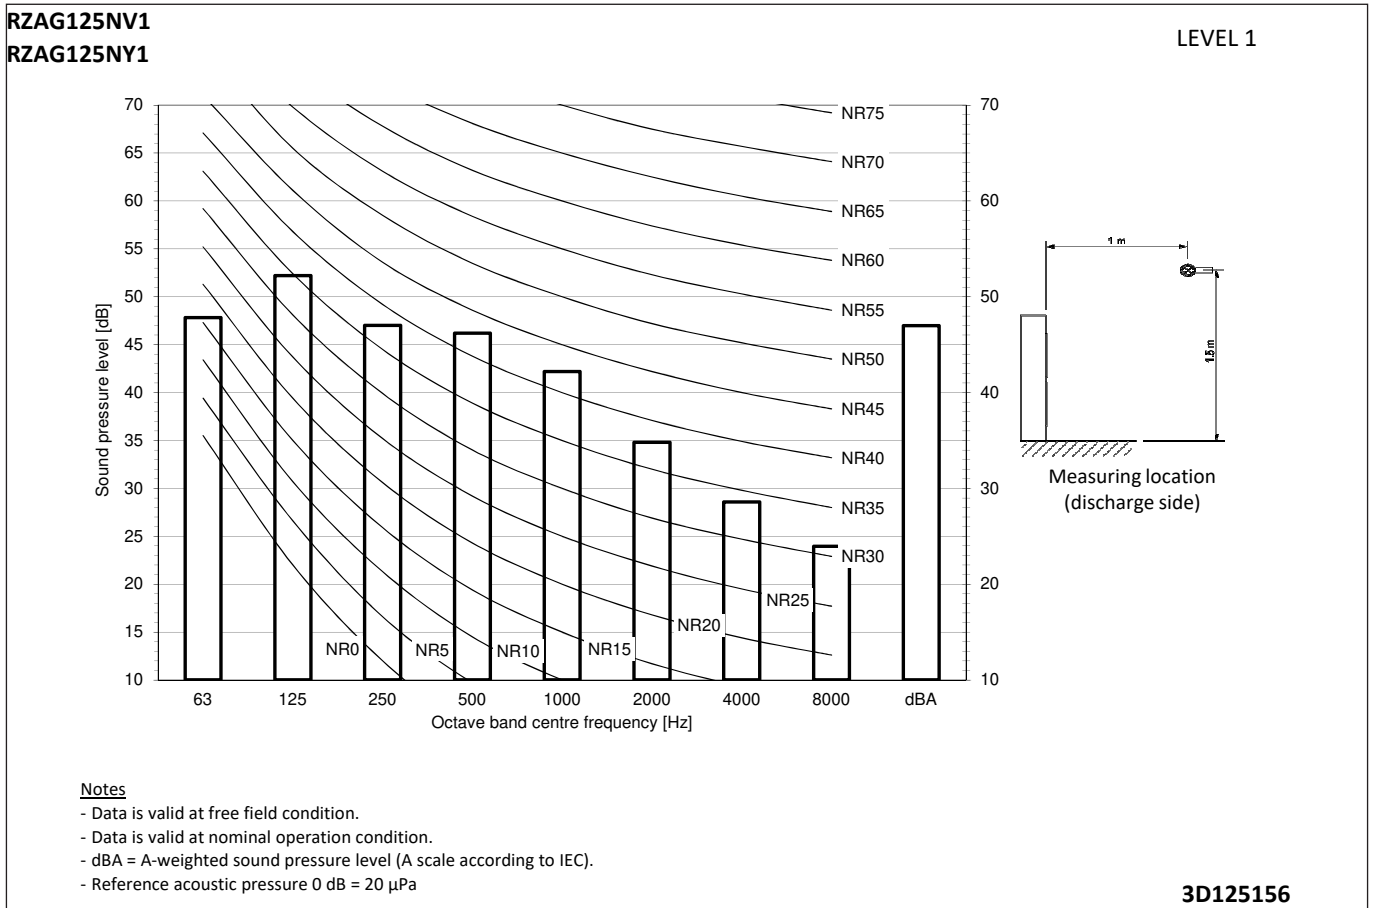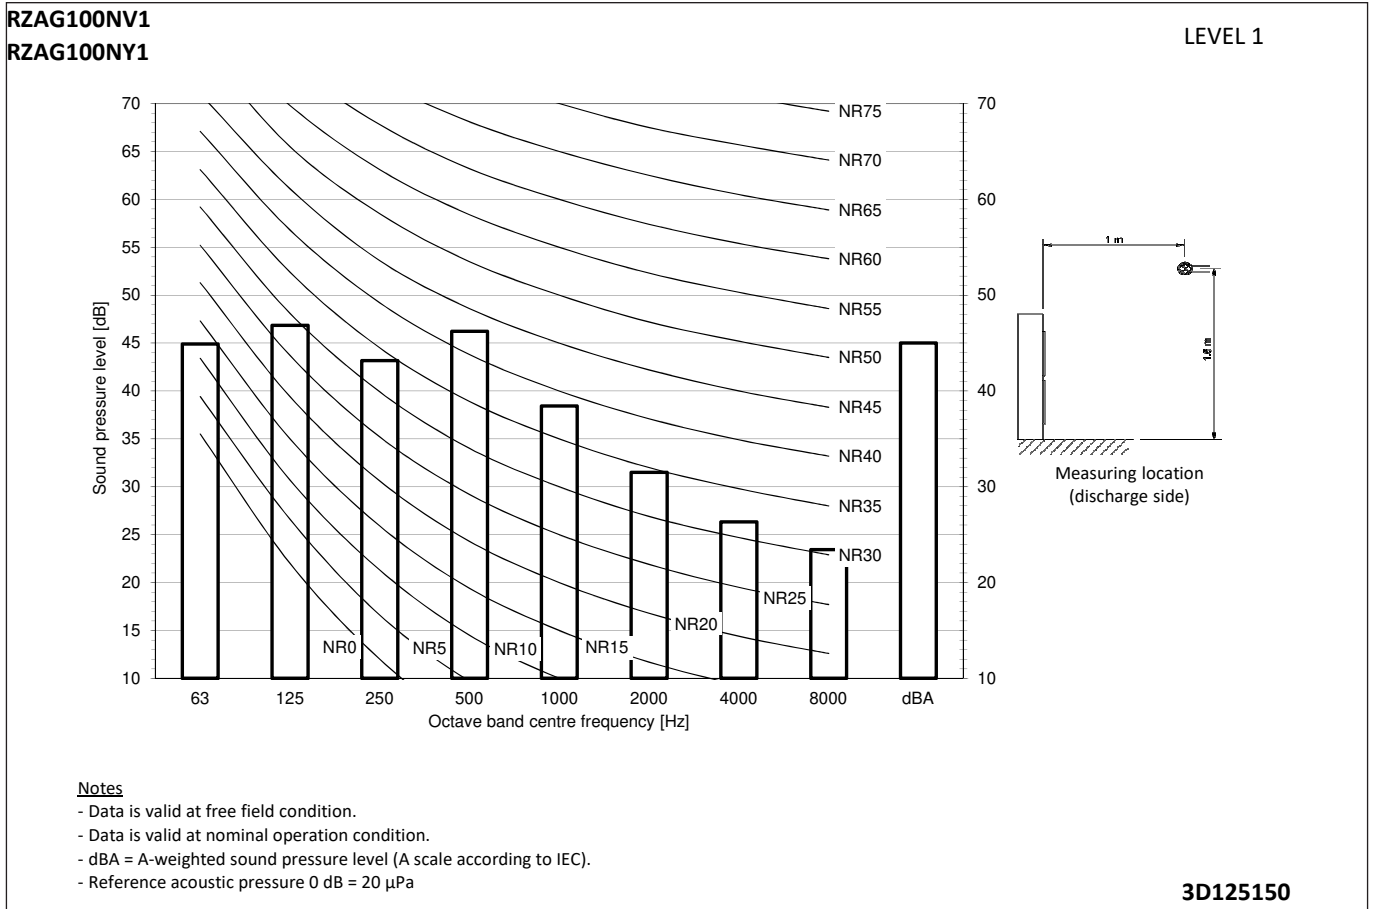



11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode Level 1

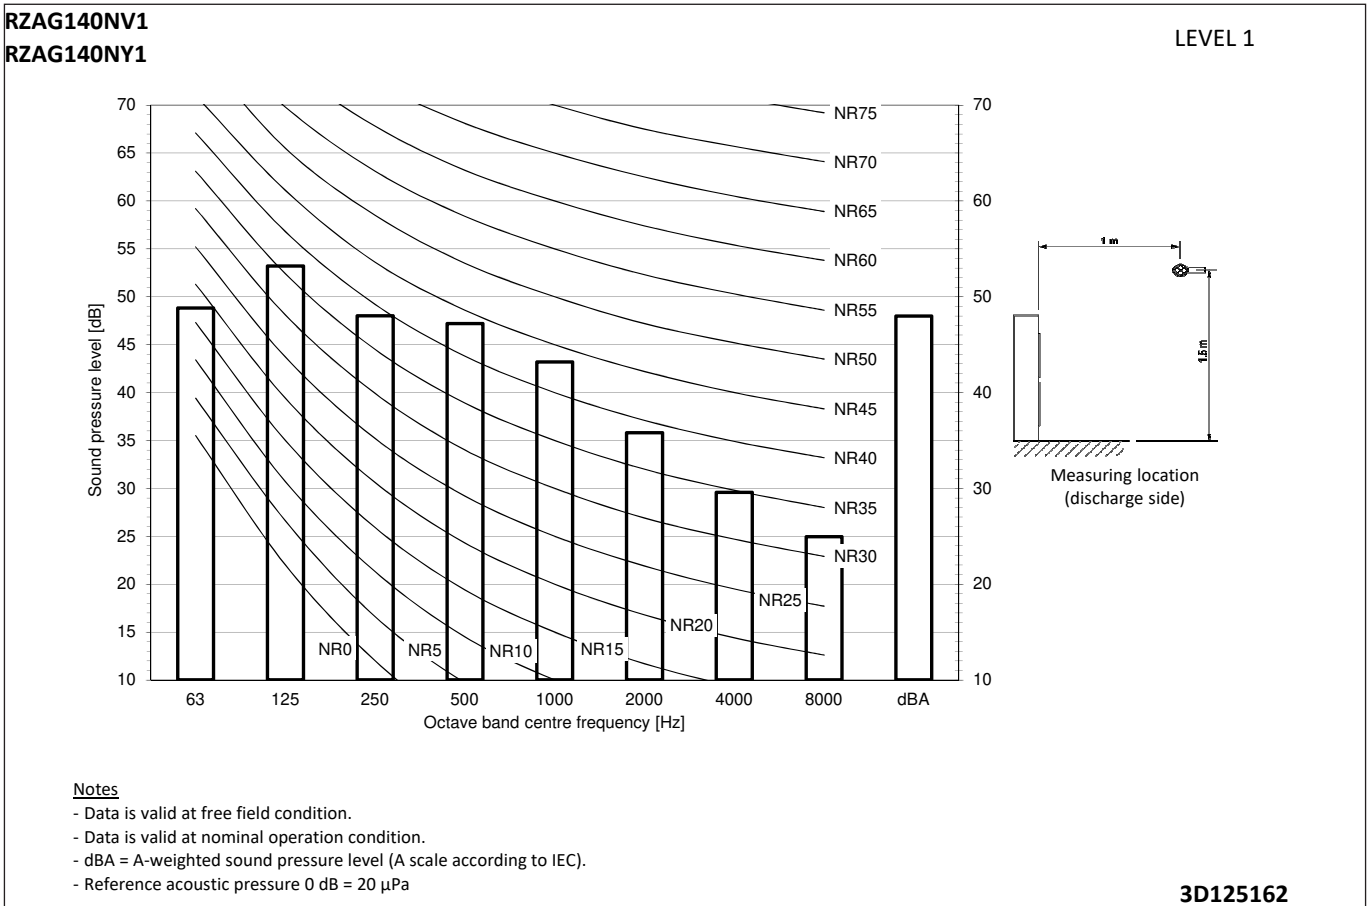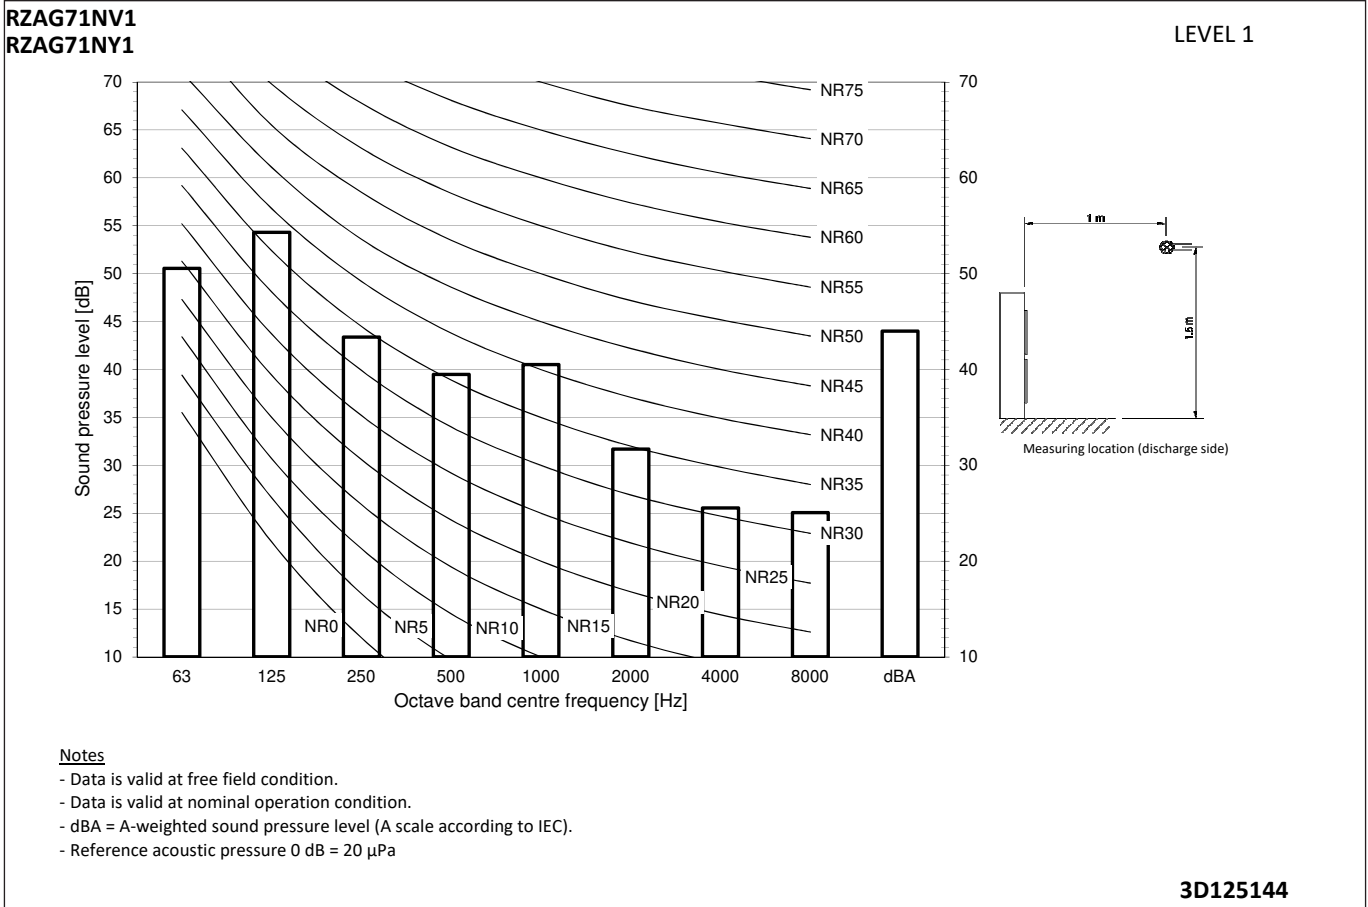

11 Sound data



11 - 5 Sound Pressure Spectrum Quiet Mode Level 2

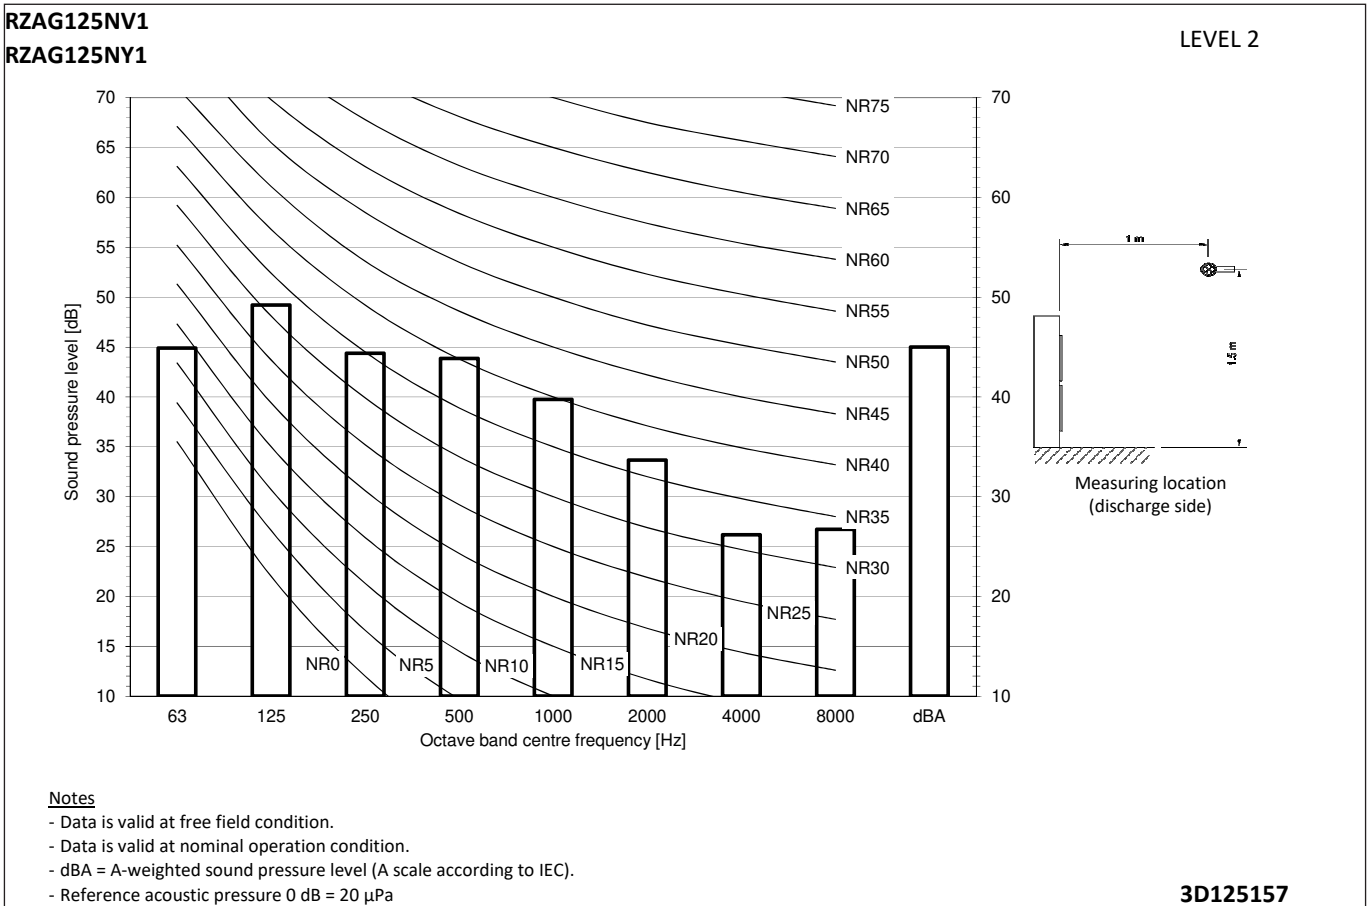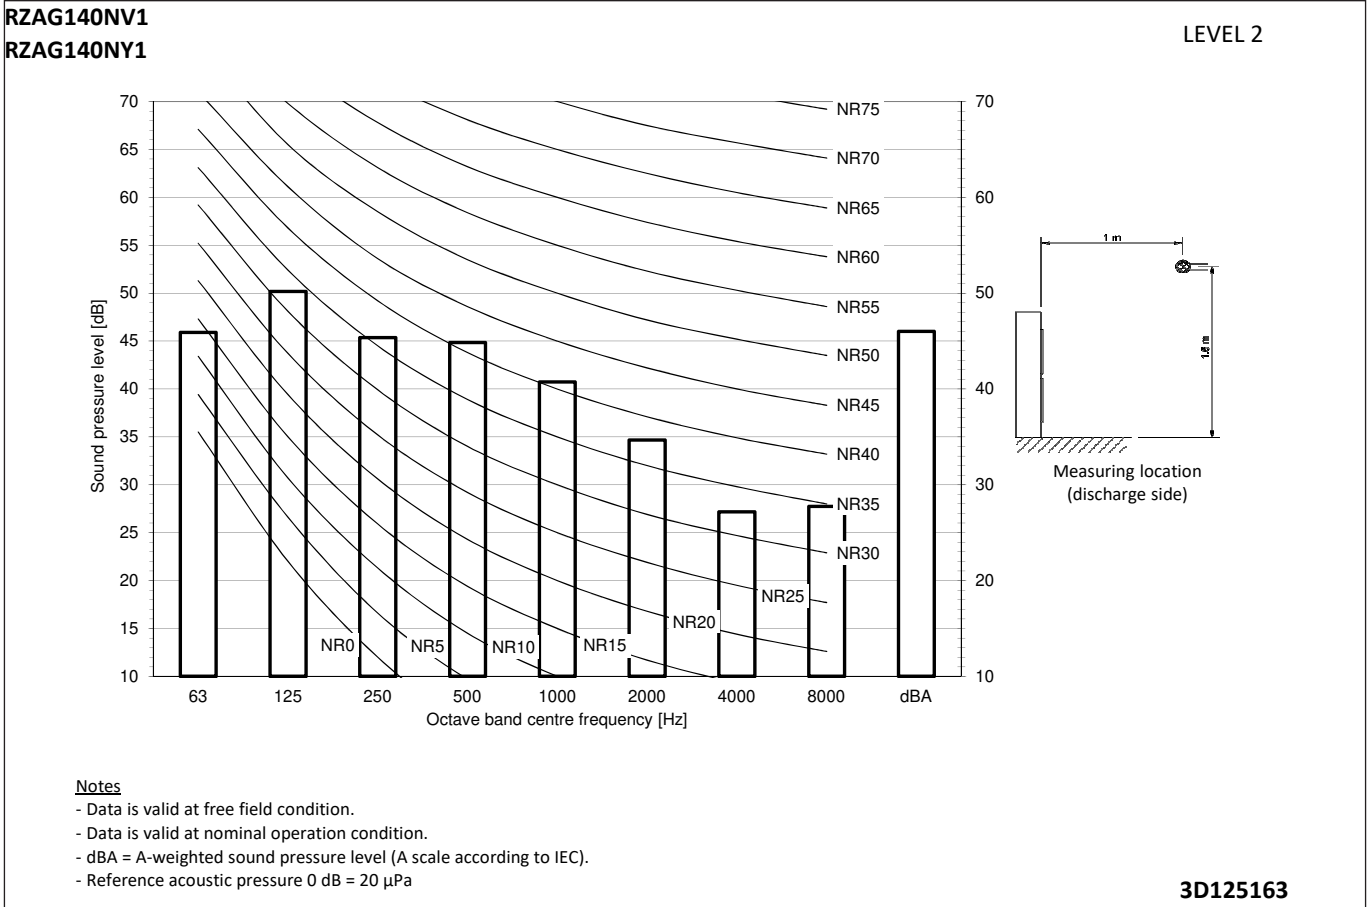

11 Sound data



11 - 5 Sound Pressure Spectrum Quiet Mode Level 2

11

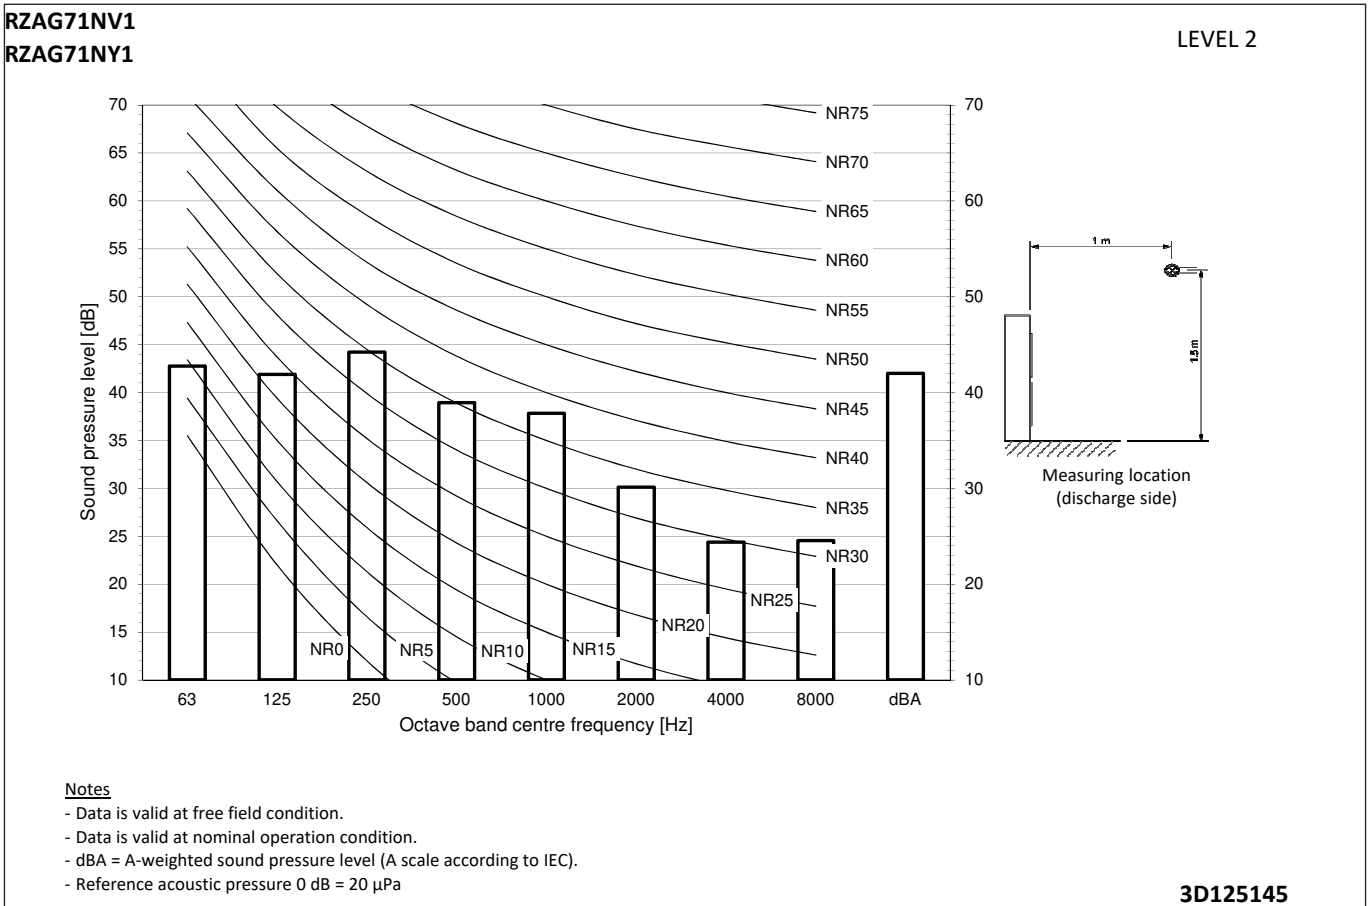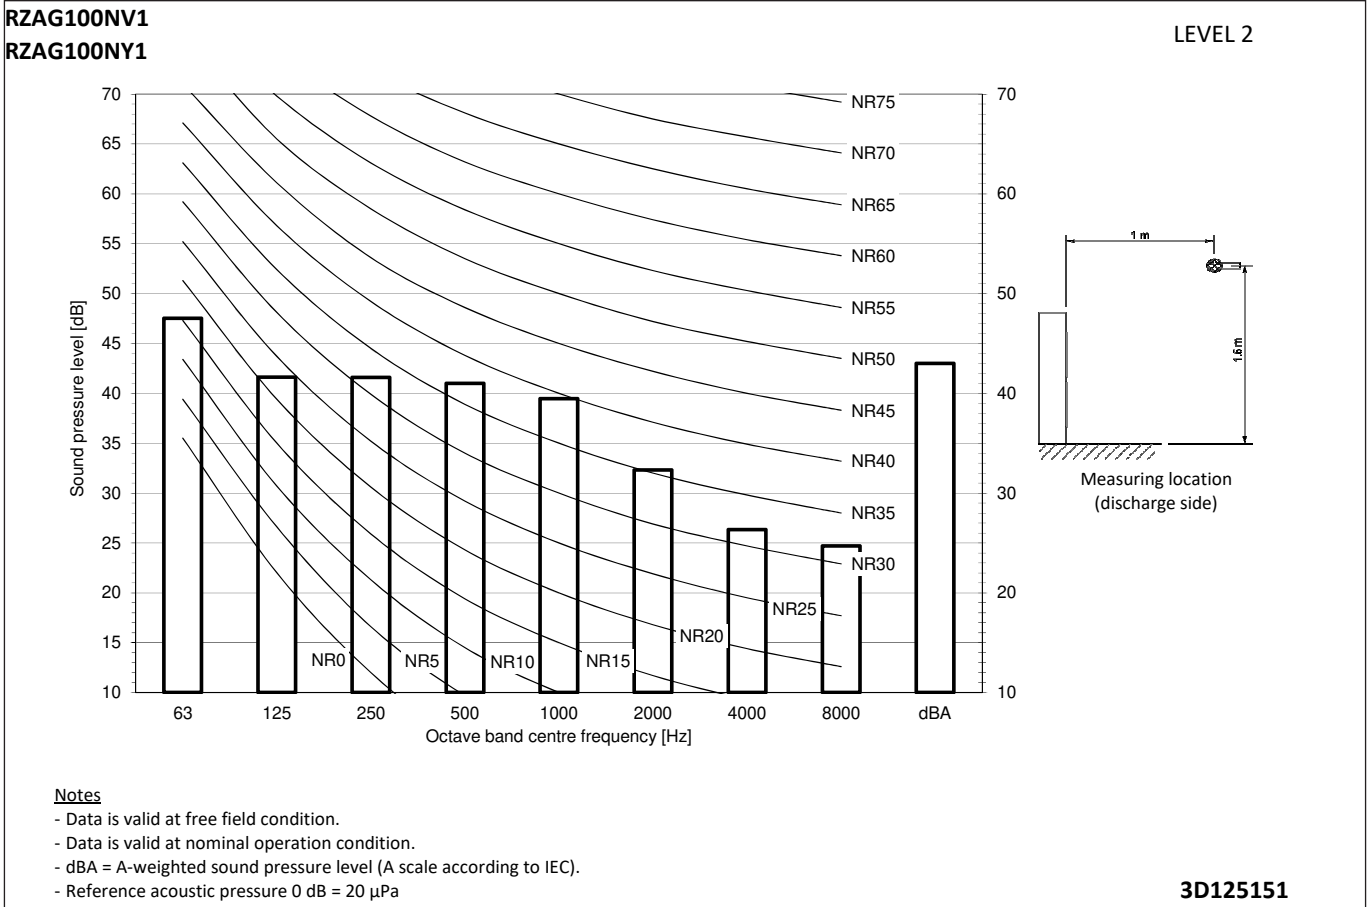

11 Sound data



11 - 6 Sound Pressure Spectrum Quiet Mode Level 3

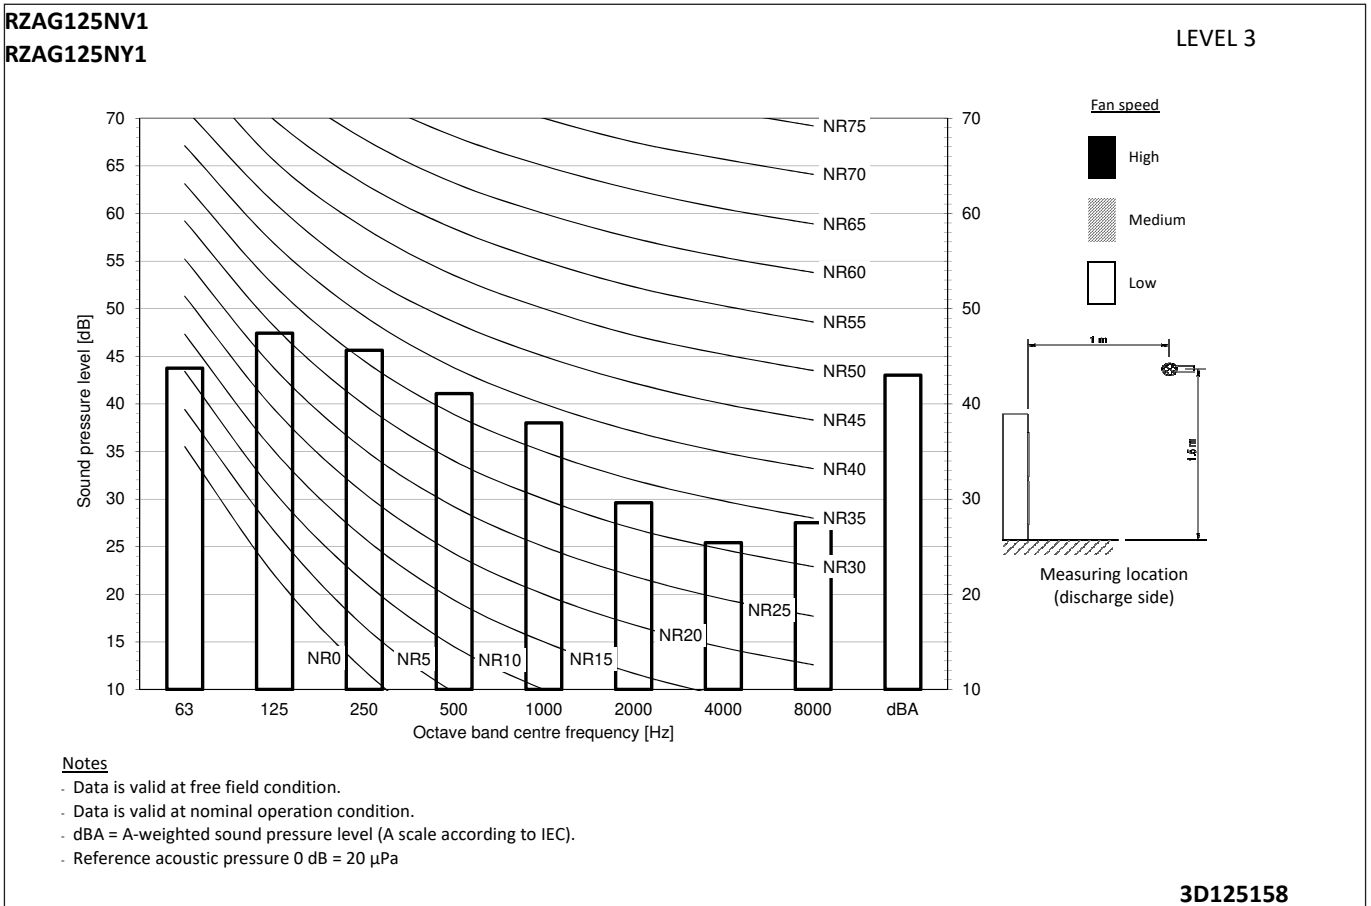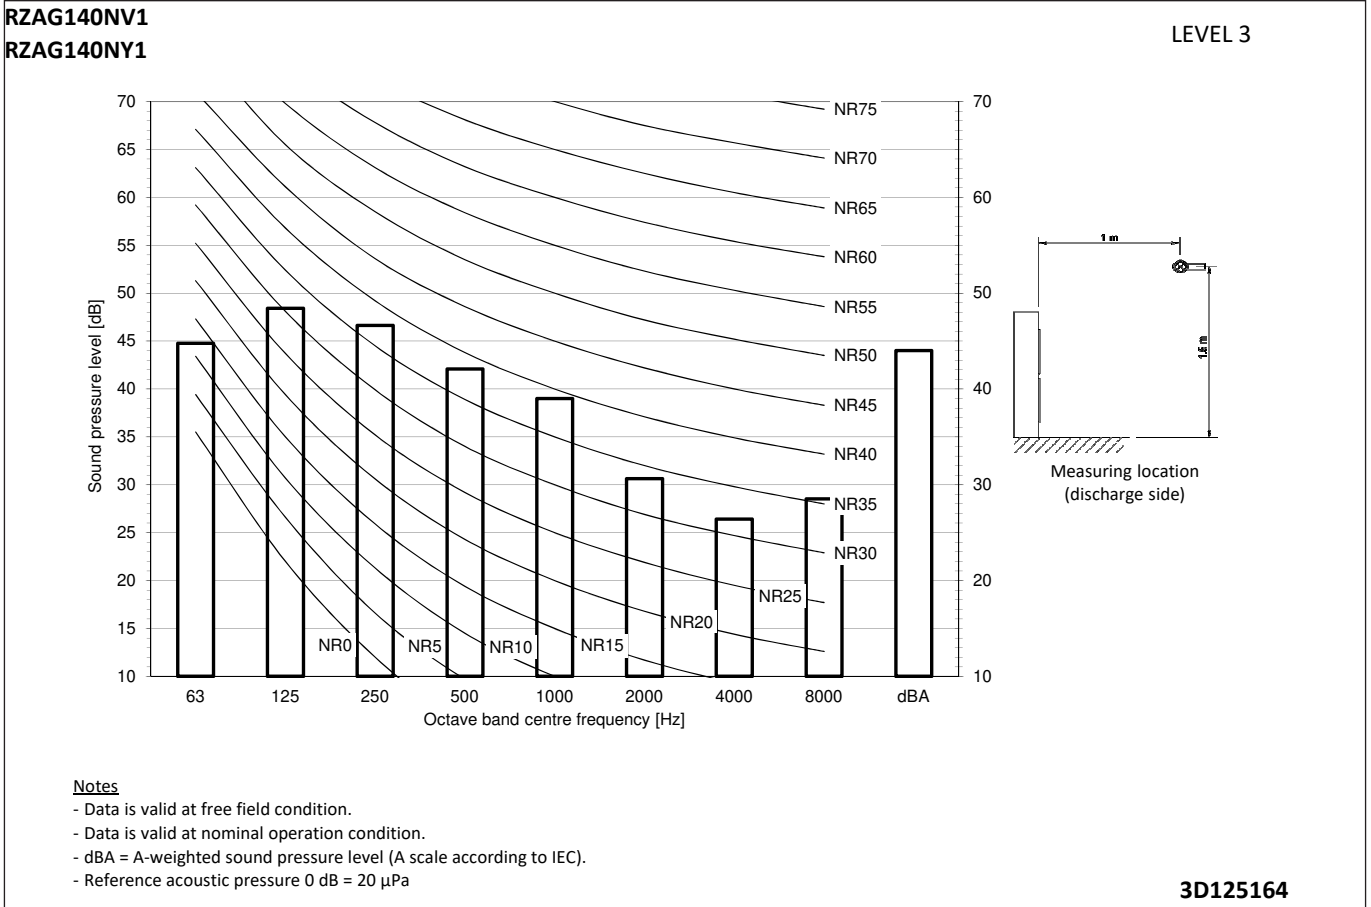

11 Sound data

11 - 6 Sound Pressure Spectrum Quiet Mode Level 3


11

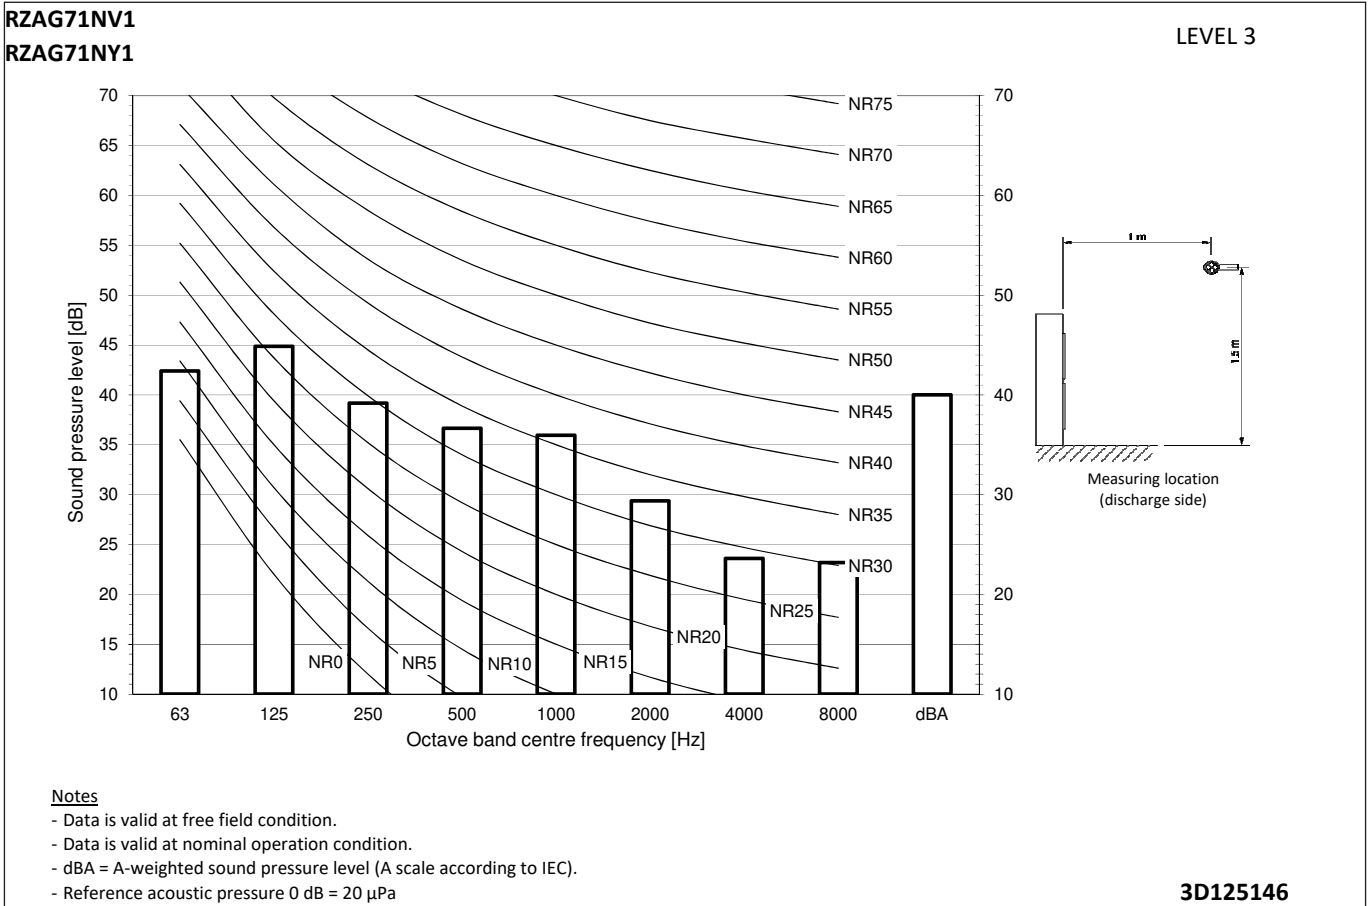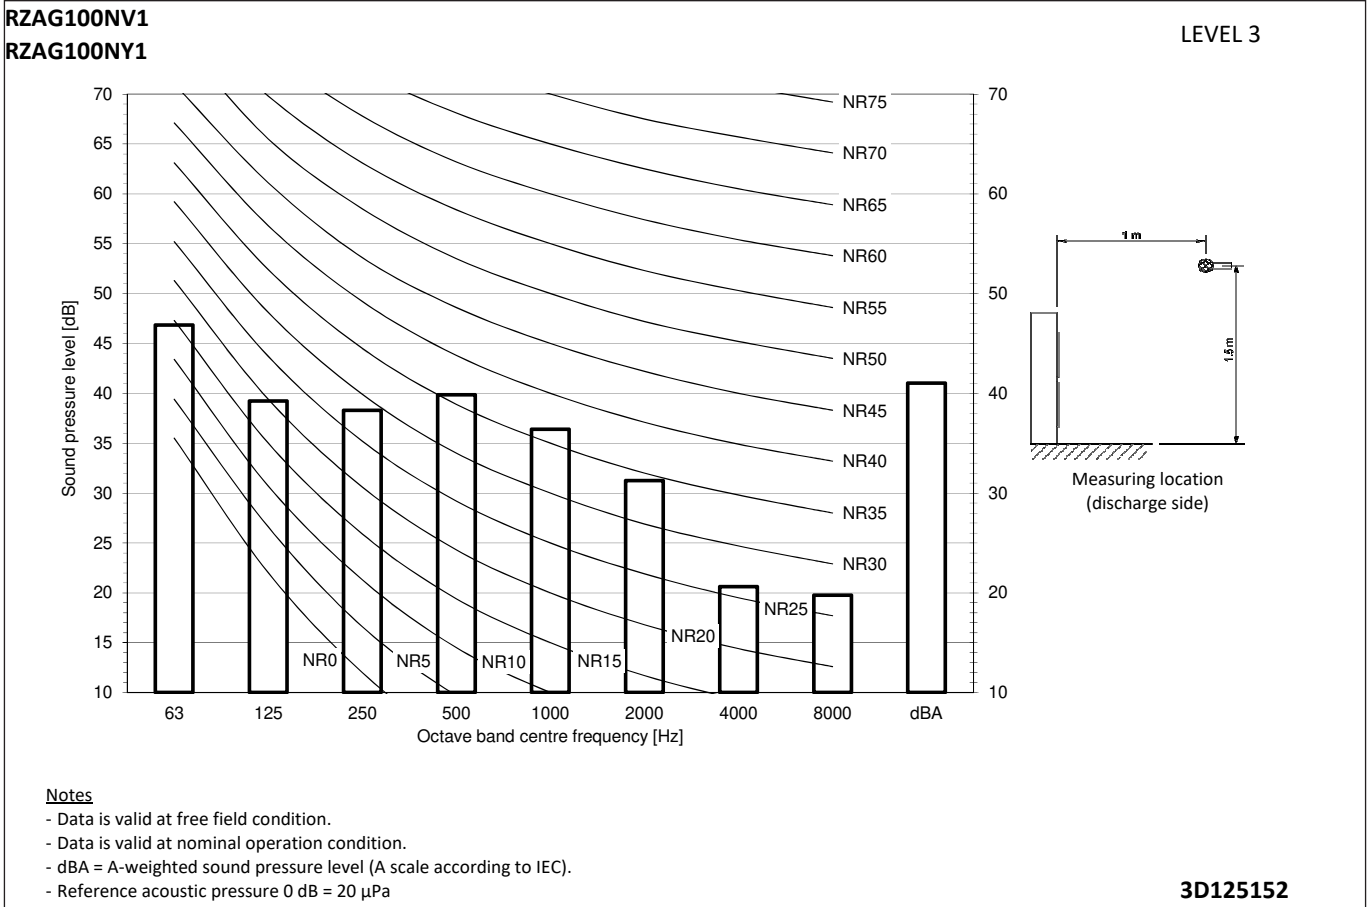


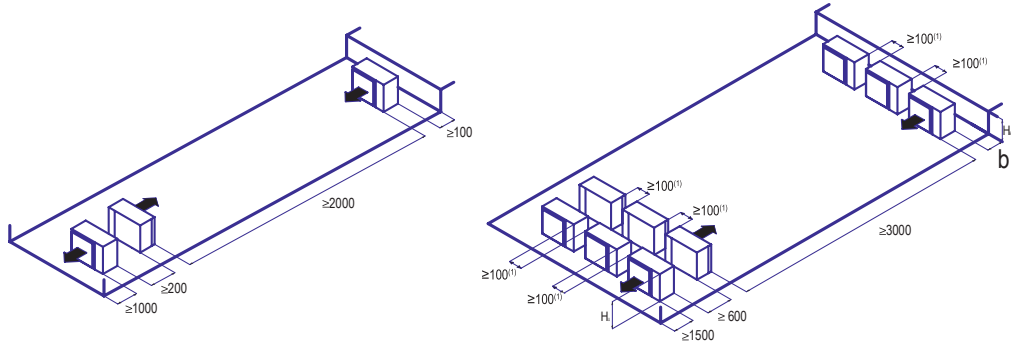
12 Installation

12 - 1 Installation Method

RZAG-NV1
RZAG-NY1

Multiple rows of units ()

Multiple rows of units ()



Hb Hu	b (mm)
$Hb \leq \frac{1}{2}Hu$	$b \geq 250$
$\frac{1}{2}Hu < Hb \leq Hu$	$b \geq 300$
$Hb > Hu$	⊘

- (1) For better serviceability, use a distance ≥ 250 mm
- ⊘ Not allowed

1D128513

12 Installation

12 - 1 Installation Method

12

RZAG-NV1
RZAG-NY1

Single unit (■) | Single row of units (■ ■ ■)

Suction side

In the illustration below, the service space at the suction side is based on 35°C DB and cooling operation. Foresee more space in the following cases:

- When the suction side temperature regularly exceeds this temperature.
- When the heat load of the outdoor units is expected to regularly exceed the maximum operating capacity.

Discharge side

Take refrigerant piping work into account when positioning the units. If your lay out does not match with any of the layouts below, contact your dealer.

Single unit (■) | Single row of units (■ ■ ■)

	A-E	Hb Hd Hu	(mm)									
			a	b	c	d	e	e _B		e _D		
	B	-		≥ 100								
	A,B,C	-	≥ 100(1)	≥ 100	≥ 100							
	B,E	-		≥ 100			≥ 1000		≤500			
	A,B,C,E	-	≥ 150(1)	≥ 150	≥ 150		≥ 1000		≤500			
	D	-					≥ 500					
	D,E	-					≥ 500	≥ 1000	≤500			
	B,D	Hd>Hu			≥ 100		≥ 500					
					≥ 100		≥ 500					
	B,D,E	Hd>Hu	Hb≤½Hu		≥ 250		≥ 750	≥ 1000	≤500			1
			½Hu>Hb≤Hu		≥ 250		≥ 1000	≥ 1000	≤500			
Hb>Hu						⊘						
Hd≤Hu		Hd≤½Hu		≥ 100		≥ 1000	≥ 1000	≤500				
		½Hu<Hd≤Hu		≥ 200		≥ 1000	≥ 1000	≤500				
	Hd>Hu					⊘						
	A,B,C	-	≥ 200(1)	≥ 300	≥ 1000							
	A,B,C,E	-	≥ 200(1)	≥ 300	≥ 1000		≥ 1000		≤500			
	D	-					≥ 1000					
	D,E	-					≥ 1000	≥ 1000	≤500			
	B,D	Hd>Hu			≥ 300		≥ 1000					1+2
					≥ 300		≥ 1500					
					≥ 300		≥ 1500					
	B,D,E	Hd>Hu	Hb≤½Hu		≥ 300		≥ 1000	≥ 1000	≤500			
			½Hu<Hb≤Hu		≥ 300		≥ 1250	≥ 1000	≤500			
			Hb>Hu				⊘					
Hd≤Hu		Hd≤½Hu		≥ 250		≥ 1500	≥ 1000	≤500				
		½Hu<Hd≤Hu		≥ 300		≥ 1500	≥ 1000	≤500				
	Hd>Hu					⊘						

(1) For better serviceability, use a distance ≥250 mm

A,B,C,D Obstacles (walls/baffle plates)

E Obstacle (roof)

a,b,c,d,e Minimum service space between the unit and obstacles A, B, C, D and E

e_B Maximum distance between the unit and the edge of obstacle E, in the direction of obstacle B

e_D Maximum distance between the unit and the edge of obstacle E, in the direction of obstacle D

Hu Height of the unit

Hb,Hd Height of obstacles B and D

1 Seal the bottom of the installation frame to prevent discharged air from flowing back to the suction side through the bottom of the unit.

2 Maximum two units can be installed.

⊘ Not allowed


1D128513





12 Installation

12 - 1 Installation Method

RZAG-NV1
RZAG-NY1

Stacked units (max.2 levels) 

Stacked units (max.2 levels) 

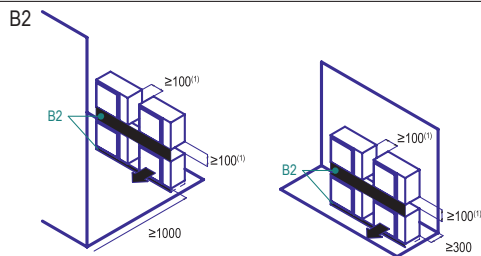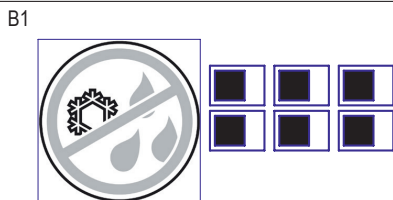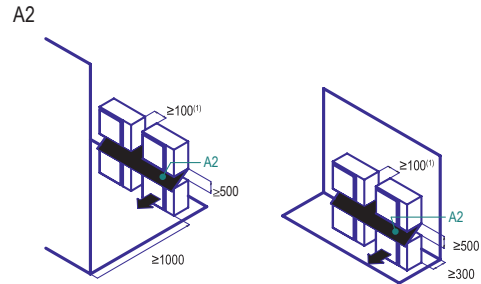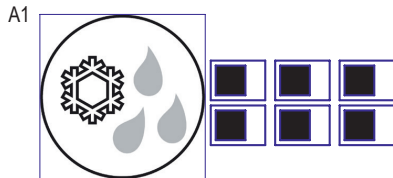

(1) For better serviceability, use a distance ≥ 250 mm

A1=>A2 (A1) If there is danger of drainage dripping and freezing between the upper and lower units...

(A2) Then install a roof between the upper and lower units. Install the upper unit high enough above the lower unit to prevent ice buildup at the upper unit's bottom plate.

B1=>B2 (B1) If there is no danger of drainage dripping and freezing between the upper and lower units...

(B2) Then it is not required to install a roof, but seal the gap between the upper and lower units to prevent discharged air from flowing back to the suction side through the bottom of the unit.


1D128513

13 Operation range


13 - 1 Operation Range

13

RZAG-NV1
RZAG-NY1

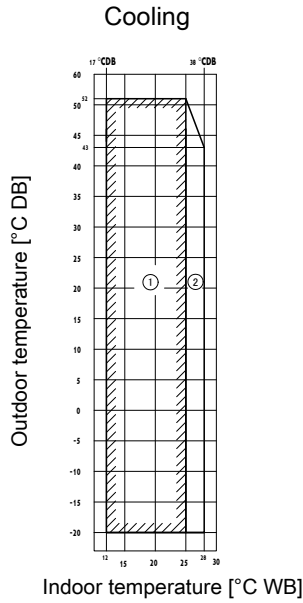

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

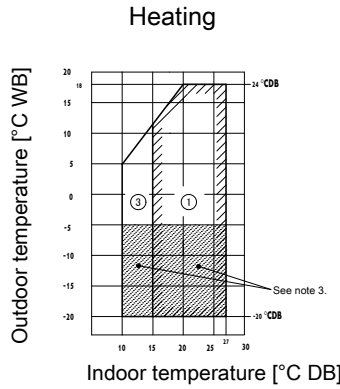


Notes


1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature < -5°C for 5 days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110020A

RZAG-NV1
RZAG-NY1

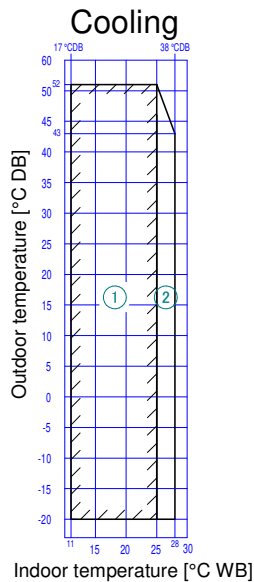

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

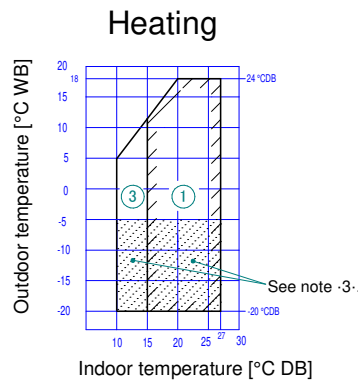

Notes

1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature < -5°C for -5- days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110022

14 Appropriate Indoors

14 - 1 Appropriate Indoors

RZAG-NV1

RZAG-NY1

ENER Lot 21

Appropriate indoor units

Connectable to RZAG125N7V1B / RZAG125N7Y1B and covered by ENER Lot 21:

FCAHG125	FCAG35	FFA35	FBA35	FNA35	FUA125	-	FDA125	FVA125	FDXM35	FHA35	-
-	FCAG50	FFA50	FBA50	FNA50	-	-	-	-	FDXM50	FHA50	-
-	FCAG60	FFA60	FBA60	FNA60	-	-	-	-	FDXM60	FHA60	-
-	FCAG125	-	FBA125	-	-	-	-	-	-	FHA125	-

Connectable to RZAG140N7V1B / RZAG140N7Y1B and covered by ENER Lot 21:

FCAHG71	FCAG35	FFA35	FBA35	FNA35	FUA71	FAA71	-	FVA71	FDXM35	FHA35	-
FCAHG140	FCAG50	FFA50	FBA50	FNA50	-	-	-	FVA140	FDXM50	FHA50	-
-	FCAG71	-	FBA71	-	-	-	-	-	-	FHA71	-
-	FCAG140	-	FBA140	-	-	-	-	-	-	FHA140	-

ENER Lot 10

Appropriate indoor units

Connectable to RZAG71N7V1B / RZAG71N7Y1B and covered by ENER Lot 10:

FCAHG71	FCAG35	FFA35	FBA35	FNA35	FUA71	FAA71	-	FVA71	FDXM35	FHA35	-
-	FCAG71	-	FBA71	-	-	-	-	-	-	FHA71	-

Connectable to RZAG100N7V1B / RZAG100N7Y1B and covered by ENER Lot 10:

FCAHG100	FCAG35	FFA35	FBA35	FNA35	FUA100	FAA100	-	FVA100	FDXM35	FHA35	-
-	FCAG50	FFA50	FBA50	FNA50	-	-	-	-	FDXM50	FHA50	-
-	FCAG100	-	FBA100	-	-	-	-	-	-	FHA100	-

3D120939

RZAG125-140NV1

RZAG125-140NY1

ENER Lot 21


Recommended combinations

Sky Air		High Cassette				Thin cassette				2x2 cassette			Duct (medium ESP)						Concealed floor standing type			Ceiling-mounted - 4-way blow			Wall mounted type		Duct (high ESP)						
Model		FCAHG71	FCAHG100	FCAHG125	FCAHG140	FCAG35	FCAG50	FCAG60	FCAG71	FCAG100	FCAG125	FCAG140	FFA35	FFA50	FFA60	FBA35	FBA50	FBA60	FBA71	FBA100	FBA125	FBA140	FNA35	FNA50	FNA60	FUA71	FUA100	FUA125	FAA71	FAA100	FDA125		
RZAG125N7V1B	RZAG125N7Y1B			P		4										4																	P
RZAG140N7V1B	RZAG140N7Y1B				P	4										4																	P

Sky Air		Floor standing type				Slim duct		Ceiling-suspended						Floor standing type	
Model		FVA71	FVA100	FVA125	FVA140	FDXM85	FDXM60	FHA35	FHA50	FHA60	FHA71	FHA100	FHA125	FHA140	AVA125
RZAG125N7V1B	RZAG125N7Y1B			P											P
RZAG140N7V1B	RZAG140N7Y1B				P										P

P= Pair
 2= Twin
 3= Triple
 4= Double twin

3D120939



EEDEN20

06/2020



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.